
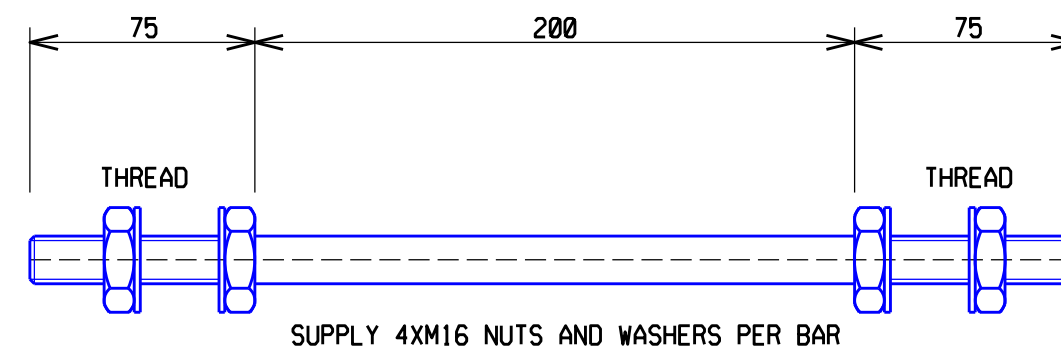


SECTION A-A

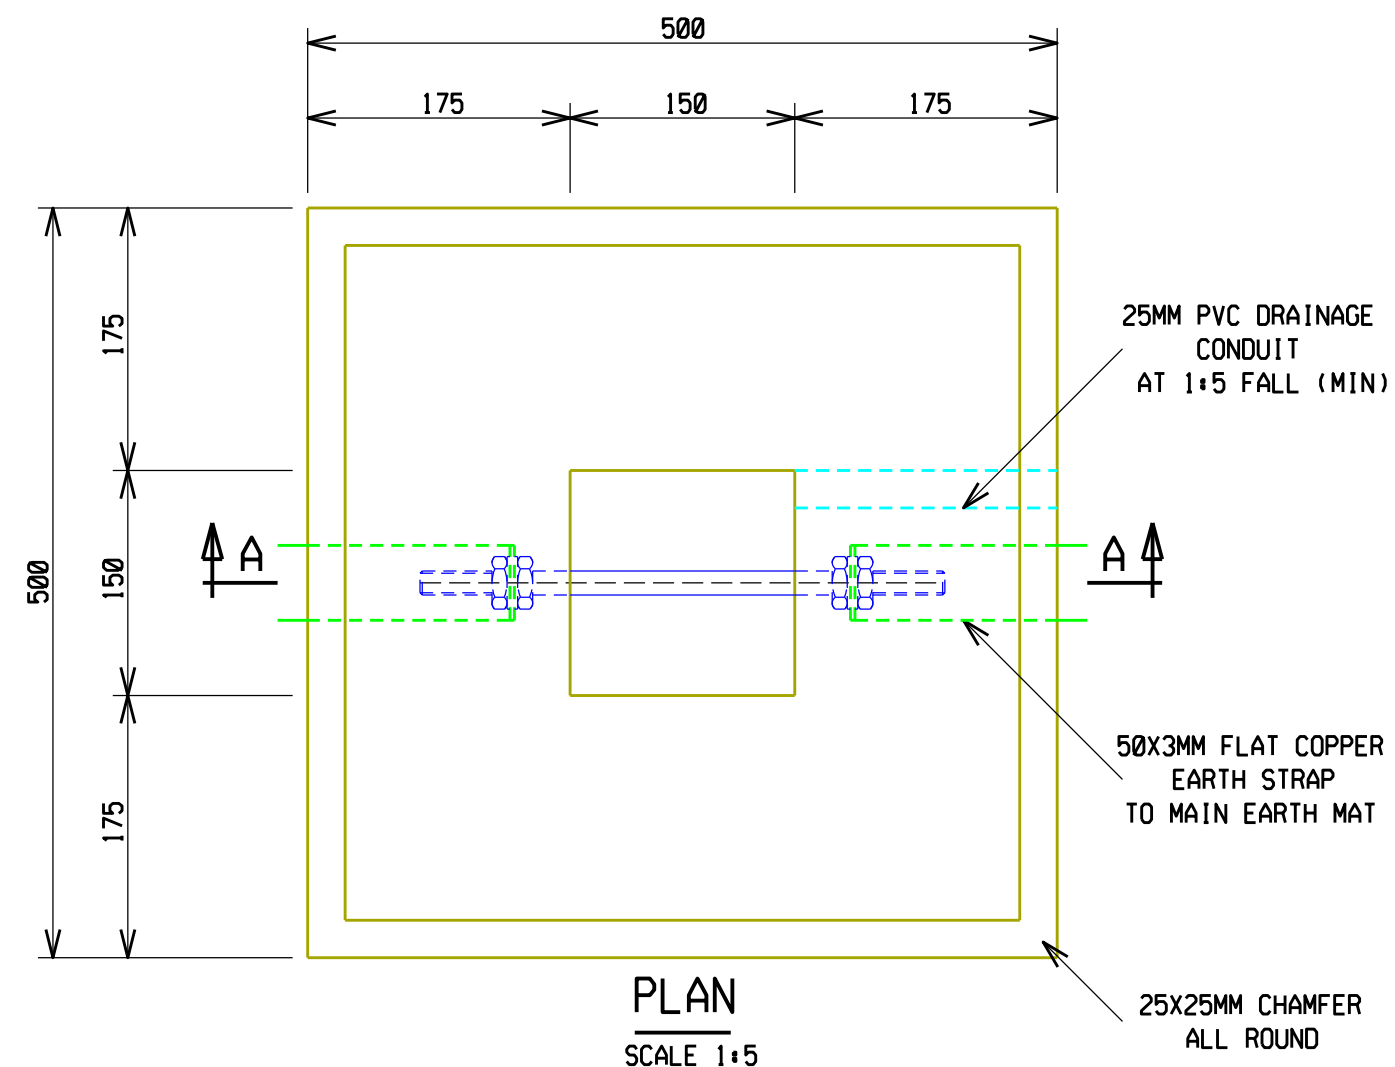


EARTHING BAR DETAIL

SCALE 1:2

NOTES

1. EARTHING BAR, NUTS AND WASHERS TO BE HOT DIP GALVANISED TO SABS ISO 1461.
2. CONCRETE MIX TO CLASS 2 - 25MPA AT 28 DAYS USING 19MM STONE.

						CHECKED	AUTHORIZED		SUBSTATION STANDARDS YARD CIVIL WORK MOBILE EARTHING POINT PLAN, SECTION & DETAIL	ER00241		
						DD	12/7/05	R. MAITLAND-STUART				
						DRAWN		12/7/05				
						TDOB	2/6/05					
						SCALE	AS SHOWN					
REV	DRAWN	CHKD	APPROVED	DATE	REVISION DESCRIPTION					SET	SHEET	REVISION
										16	08	00