NOTES:

1. CONCRETE WORK TO BE IN ACCORDANCE WITH SANS 1200.
2. CONCRETE STRENGTH TO BE 35MPa, WITH AN AGGREGATE STONE SIZE OF 13mm.
3. SLABS TO BE CAST IN STEEL MOULDS WITH END AND SIDES TAPERED 3°.
4. REINFORCING TO HAVE A MIN CONCRETE COVER OF 20mm.
5. NEWLY CAST SLABS TO BE THOROUGHLY COMPACTED BY USING A VIBRATOR TABLE.
6. NO OTHER METHOD OF CONSTRUCTION AND/OR PREFABRICATED SLABS WILL BE ACCEPTED WITHOUT APPROVAL.

SCHEDULE OF QUANTITIES
CONCRETE = 0.011m^3
WEIGHT = 30.80kg

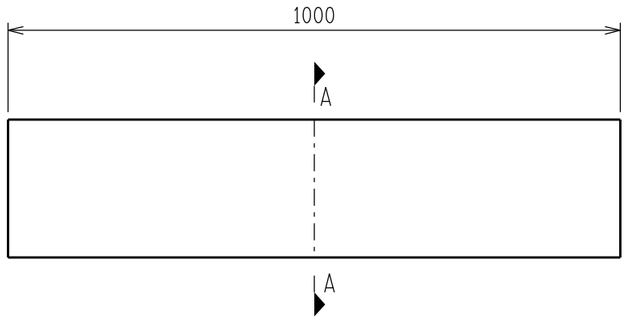

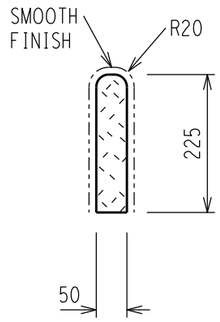

SECTION A-A

DRG NO.	SHEET NO:	REFERENCE DRAWINGS:

THIS DRAWING IS THE NEW OFFICIAL REVISION AND IT SUPERSEDES ALL OTHER PUBLISHED DRAWINGS

REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	PROJECT NO.
0	FIRST ISSUE				/ /	

Eskom

SUBSTATION

STONE KERBING - 1000mm (CONCRETE)

AUTH:	N WEBBER
DATE:	13/08/2014
CHKD:	B HLOMENDLIN
DATE:	06/08/2014
DRAWN:	G BEETGE
DATE:	15/04/2014

SAP No. 0599537

SCALE 1:10

THIS DRAWING IS THE PROPERTY OF ESKOM

D-DT-5254

SET	SHEET	REVISION
	2C	0

A3L