


2,5m MEDIUM EQUIPMENT CABLE BRACKET

M16 x 80mm STAINLESS STEEL THREADED ROD
WELDED BEFORE GALVANISING
2 x STAINLESS STEEL NUTS AND WASHERS
PER THREADED ROD
THREADED ROD TO BE WELDED TO THE BACK
OF THE ANGLE IRON

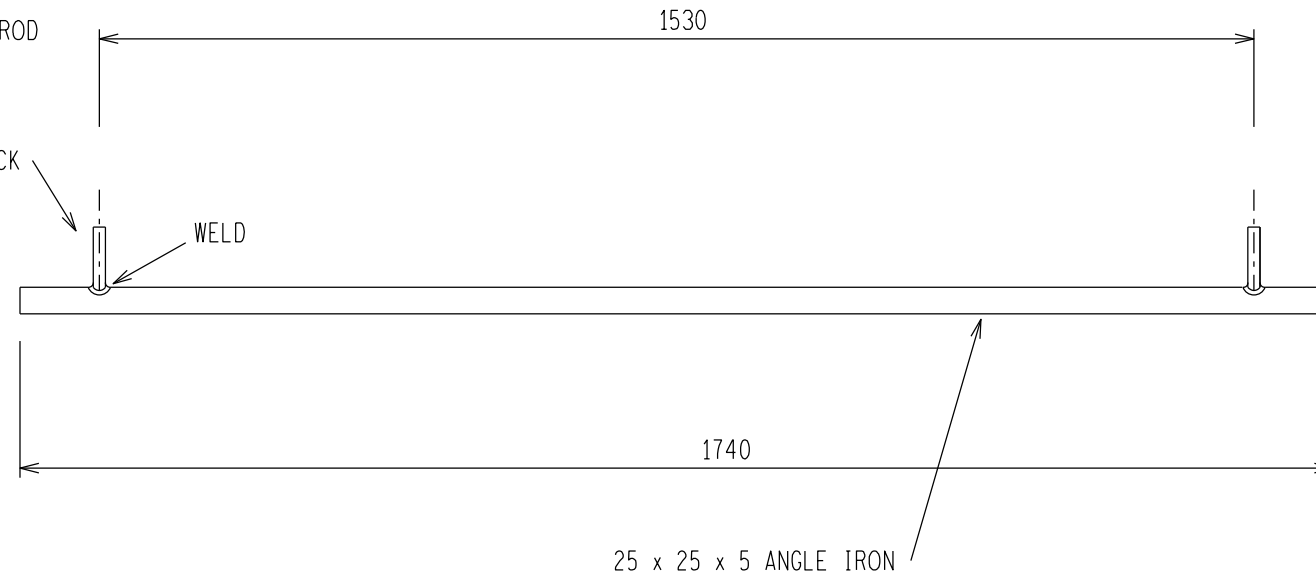


NOTES:

- 1 - ALL WELDING AND WELDING SYMBOLS SHALL CONFORM TO SABS 044 PART 1 TO PART 5.
- 2 - ALL WELDS TO BE SEAL WELDED.
- 3 - ALL BOLTS SECURING BRACKET TO THIS STRUCTURE TO BE SUPPLIED ARE TO BE SUPPLIED BY CONTRACTOR.
- 4 - BOLTS TO BE SUPPLIED ARE TO BE STAINLESS STEEL BOLTS
- 5 - ALL BOLTS AND NUTS TO CONFORM TO SABS 135. STRENGHT GRADE 4.6


2m MEDUIM EQUIPMENT CABLE BRACKET


M16 x 80mm STAINLESS STEEL THREADED ROD
WELDED BEFORE GALVANISING
2 x STAINLES STEEL NUTS AND WASHERS
PER THREADED ROD
THREADED ROD TO BE WELDED TO THE BACK
OF THE ANGLE IRON

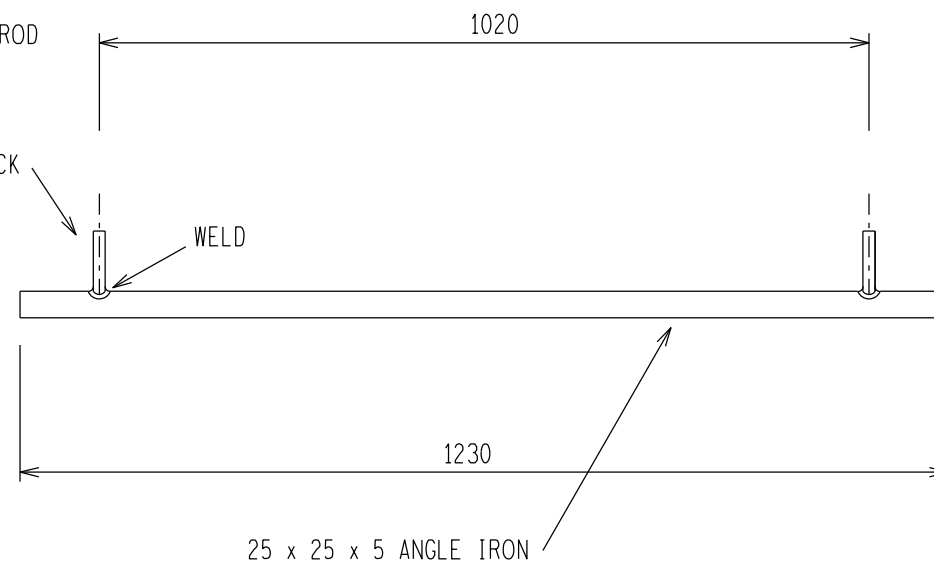

SIDE VIEW

SCALE 1:10

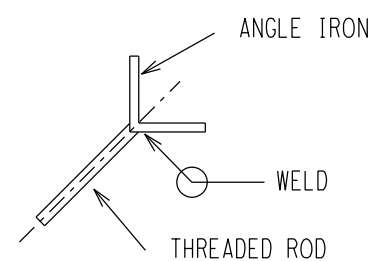[illegible]

				Dwg No.		REFERENCE DRAWINGS	
0	FIRST ISSUE				/ /		
REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	PROJECT NO.	
		<h1 style="text-align: center;">CABLE SUPPORT</h1> <h2 style="text-align: center;">BRACKET MOUNTED ON MEDIUM EQUIPMENT SUPPORT</h2>					
AUTH: N.Webber							
DATE: 20/09/2004							
CHKD: C. Lottering							
DATE: 15/09/2004		<h1 style="text-align: center;">D-EC-1783</h1>		SET	SHEET	REVISION	
DRAWN: A. Madikizela					2	0	
DATE: 15/09/2004							