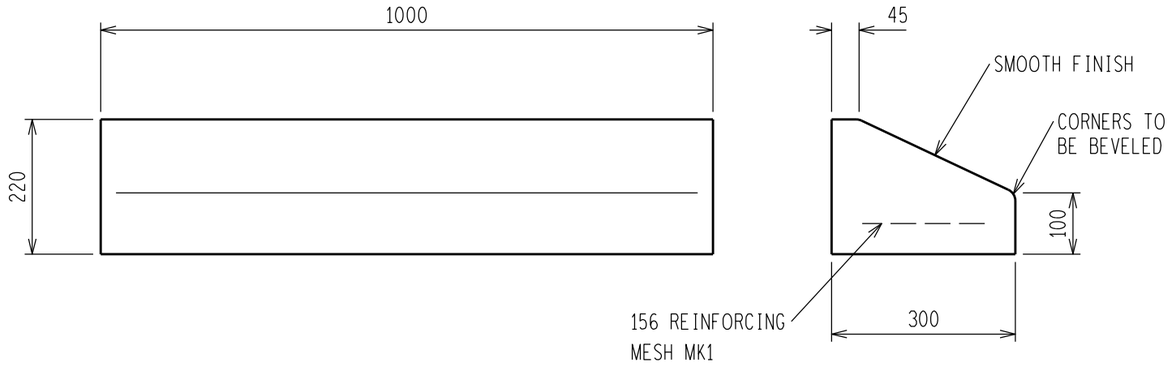

NOTES:

1. CONCRETE WORK TO BE IN ACCORDANCE WITH SANS 1200.
2. CONCRETE STRENGTH TO BE 35MPa, WITH AN AGGREGATE STONE SIZE OF 13mm.
3. SLABS TO BE CAST IN STEEL MOULDS WITH END AND SIDES TAPERED 3°.
4. REINFORCING TO HAVE A MIN CONCRETE COVER OF 20mm.
5. NEWLY CAST SLABS TO BE THOROUGHLY COMPACTED BY USING A VIBRATOR TABLE.
6. NO OTHER METHOD OF CONSTRUCTION AND/OR PREFABRICATED SLABS WILL BE ACCEPTED WITHOUT APPROVAL.

REINFORCEMENT SCHEDULE							
MK	TYPE & SIZE	TOTAL PER ITEM	CUTTING LENGTH	TOTAL LENGTH (m)	WEIGHT kg	SHAPE CODE	BENDING REMARKS
1	156	1	-	-	0.39	-	SIZE = 960 x 260

SCHEDULE OF QUANTITIES
CONCRETE = 0.051m^3
WEIGHT = 145kg

BEARING CAPACITY
ROAD KERBING = 1200kg

DRG NO.	SHEET NO.	REFERENCE DRAWINGS

THIS DRAWING IS THE NEW OFFICIAL REVISION AND IT SUPERSEDES ALL OTHER PUBLISHED DRAWINGS

REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	PROJECT NO.
					/ /	
0	FIRST ISSUE				/ /	

Eskom

SUBSTATION

ROAD KERBING - 1000mm (CONCRETE)

AUTH:	N WEBBER
DATE:	13/08/2014
CHKD:	B HLOMENDLIN
DATE:	06/08/2014
DRAWN:	G BEETGE
DATE:	15/04/2014

SAP No. 0599536

SCALE 1:10

THIS DRAWING IS THE PROPERTY OF ESKOM

D-DT-5254

SET	SHEET	REVISION
	2B	0

A3L