

A

B

C





D

E

F


G

H

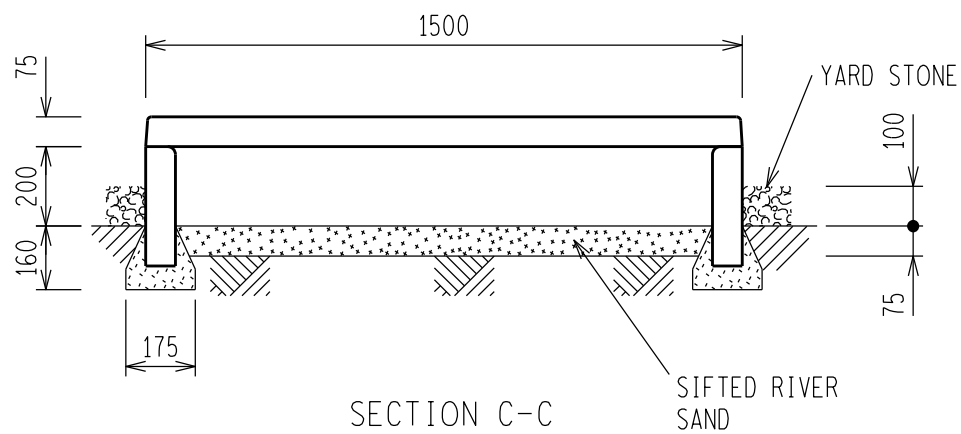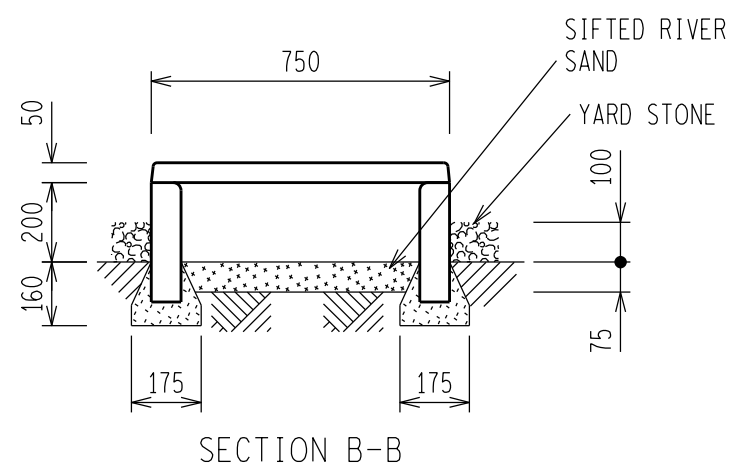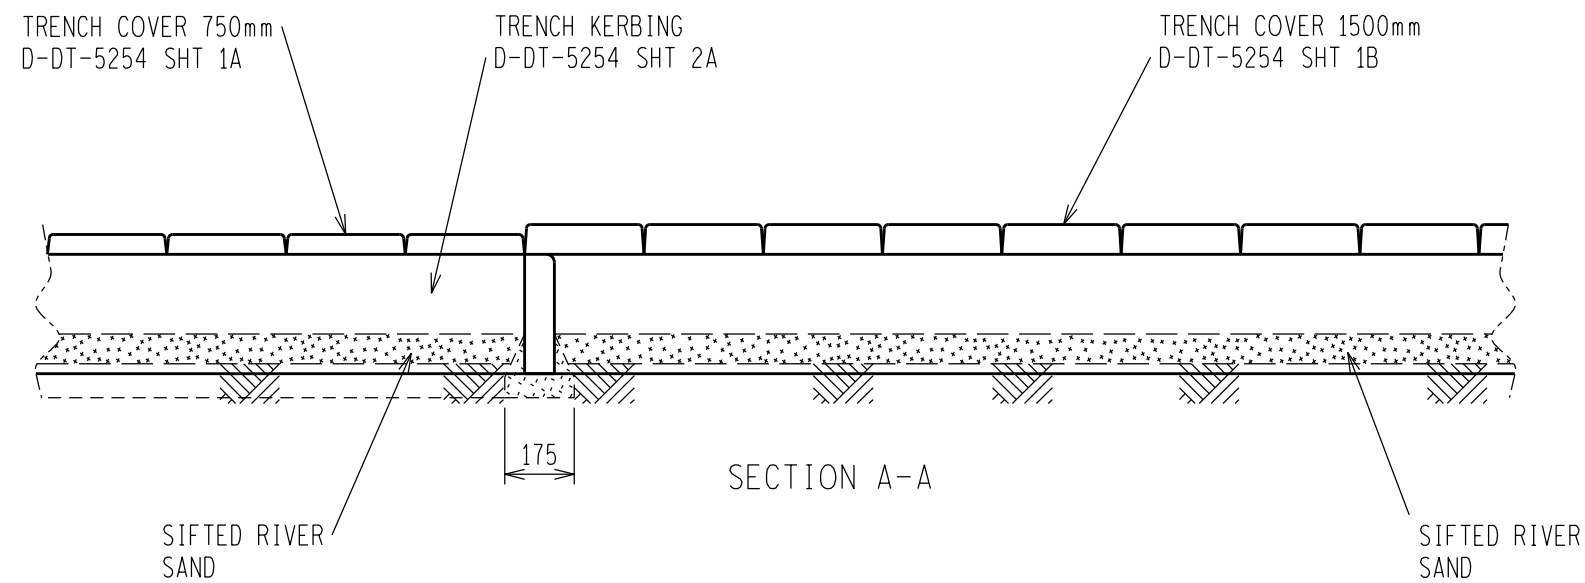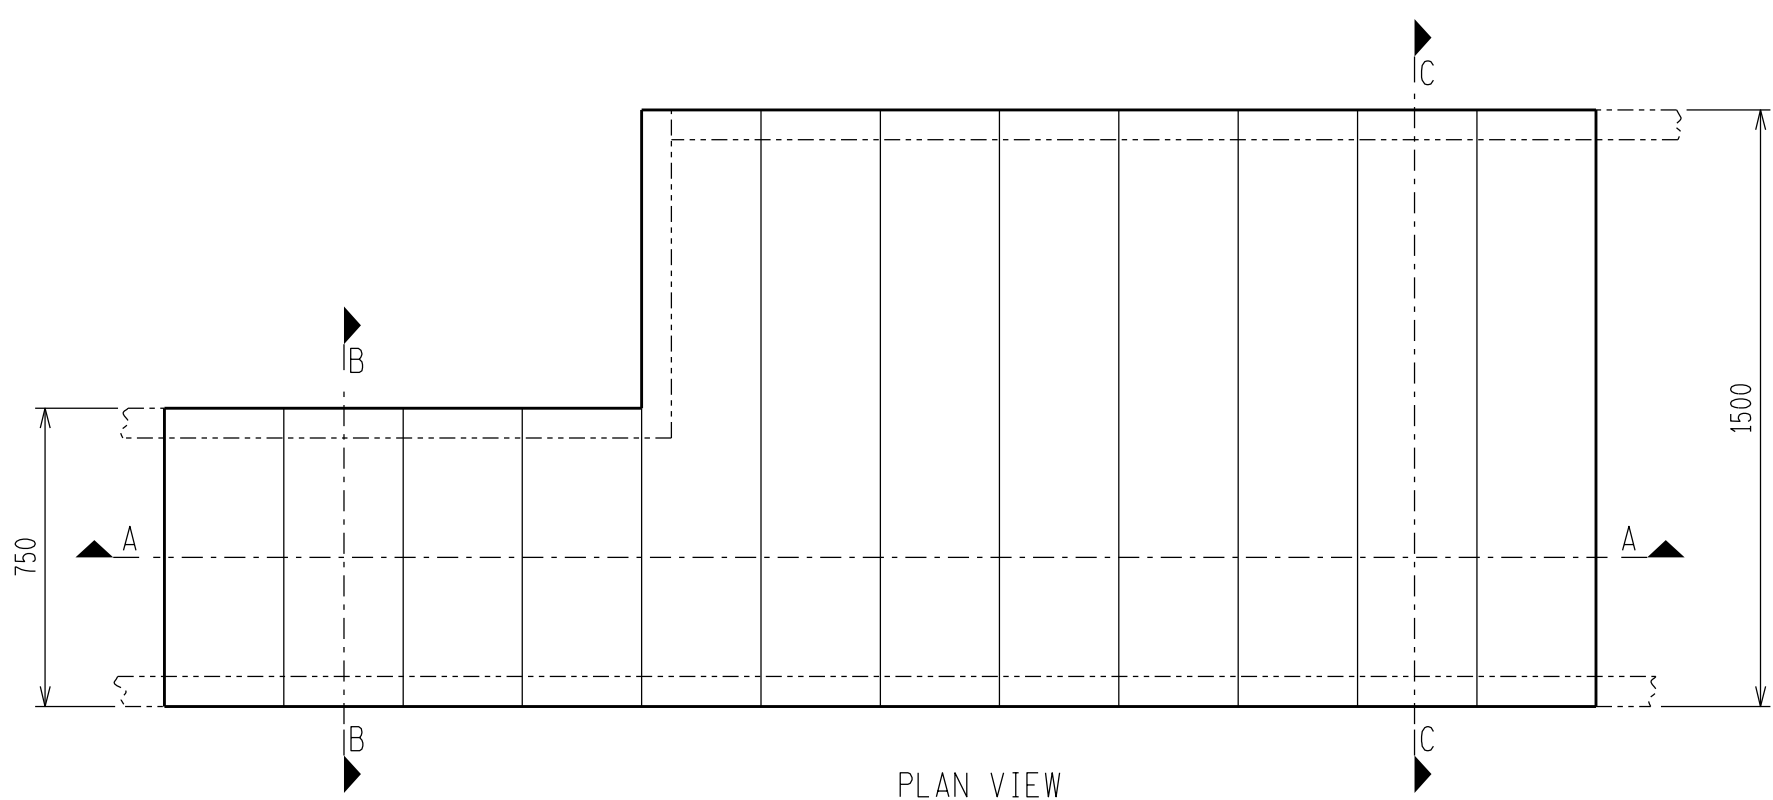

- NOTES:
- 1 FOR 750mm TRENCH COVER SEE DRAWING D-DT-5254 SHT 1A.
 - 2 FOR 1500mm TRENCH COVER SEE DRAWING D-DT-5254 SHT 1B.
 - 3 FOR TRENCH KERBING SEE DRAWING D-DT-5254 SHT 2A.
 - 4 TRENCH KERBING TO BE PLACED ON CONCRETE FOOTING AS PER DETAIL.
 - 5 TRENCH KERBING TO BE INSTALLED WITH ROUNDED EDGE TO INSIDE OF TRENCH TO PREVENT CABLE DAMAGE.
 - 6 TRENCHES MUST NOT BE USED AS WALKWAYS.

D-DT-5254	SHEET 50	TRENCH 750 - CABLE TRENCH RAMP
D-DT-5254	SHEET 5N	TRENCH 750 - 'X' TO 750 - STRAIGHT 1500
D-DT-5254	SHEET 5M	TRENCH 1500 - 'X' TYPE A TO 1500
D-DT-5254	SHEET 5L	TRENCH 750 - 'X' TYPE B TO 750
D-DT-5254	SHEET 5K	TRENCH 750 - 'X' TYPE A TO 750
D-DT-5254	SHEET 5J	TRENCH 1500 - 'T' TO 1500
D-DT-5254	SHEET 5I	TRENCH 750 - 'T' TO 1500
D-DT-5254	SHEET 5H	TRENCH 750 - 'T' TYPE B TO 750
D-DT-5254	SHEET 5G	TRENCH 750 - 'T' TYPE A TO 750
D-DT-5254	SHEET 5F	TRENCH 1500 - 90 DEG TYPE A BEND
D-DT-5254	SHEET 5E	TRENCH 750 - 90 DEG TYPE B BEND
D-DT-5254	SHEET 5D	TRENCH 750 - 90 DEG TYPE A BEND
D-DT-5254	SHEET 5B	TRENCH 1500 - STRAIGHT
D-DT-5254	SHEET 5A	TRENCH 750 - STRAIGHT
DRG NO.	SHEET NO:	REFERENCE DRAWINGS:

THIS DRAWING IS THE NEW OFFICIAL REVISION AND IT SUPERSEDES ALL OTHER PUBLISHED DRAWINGS							
					/ /		
0	FIRST ISSUE				/ /		
REV	REVISION DESCRIPTION			BY	CHKD	AUTH	
					DATE	PROJECT NO.	
		SUBSTATION TRENCH 750mm WIDE - STRAIGHT TO 1500mm WIDE INSTALLATION AND SECTIONS					
AUTH: N WEBBER							
DATE: 13/08/2014							
CHKD: B HLOMENDLINI							
DATE: 06/08/2014		D-DT-5254			SET	SHEET	REVISION
DRAWN: G BEETGE						5C	0
DATE: 15/04/2014							

SAP No.
SCALE 1 : 20
THIS DRAWING IS THE PROPERTY OF ESKOM