



DRAWING SEE SHEETS 3, 4 AND 5

SAP MATERIAL No.:	0168788
SHORT DESCRIPTION:	BOX DISTR:POLE TOP; 2-WAY; 50A;WD 180 MM

TECH. DESCRIPTION:

BOX, DISTRIBUTION: TYPE: POLE TOP;  
 2-WAY; 50A; WIDTH: 180 MM; LENGTH: 300 MM; DEPTH: 120 MM;  
 MATERIAL: NON-METAL; WITH TWO HOLES FOR 2 X M6 COACH SCREWS FOR SECURING TO WOOD  
 POLE; BOX SUPPLIED AND FITTED WITH THE FOLLOWING :-  
 2 X NUMBER X COMPRESSION GLANDS,  
 1 X 3-WAY NEUTRAL BAR, 2 X 1.5M X 16MM SQ.  
 UV STABLE PVC INSULATED COPPER LEADS;  
 1 X 50A MINIATURE CIRCUIT BREAKER (MCB) (D-DT-3083 );  
 DIN RAIL MOUNTING TO ALLOW FOR ADDITIONAL MCB; USED FOR 2 X 20 AMP CUSTOMERS \*  
 SUPPLIED WITH 2 X M6X40MM COACH SCREWS (ELECTROPLATED TO SANS 728),  
 AND 1 X EXTERNAL TOGGLE LEVER FOR LINK STICK;  
 WITH RESET LOOP NOT LESS THAN 30MM SQ. IN DIA; PROVISION FOR CONCRETE POLE MOUNTING  
 ESKOM DRAWING No. D-DT-3055 \*

ITEM		:- BOX,POLE TOP DIST 2, 4 AND 8-WAY								
MATERIAL SPECIFICATION		:-								
CORROSION SPECIFICATION		:-								
STANDARD SPECIFICATION		:- NRS 032								
ESKOM SPECIFICATION		:- 34-1705								
TEST & CERTIFICATION REQUIREMENTS :-										
INSPECTION		Yes	No	ESKOM RELEASE NOTE		Yes	No			
IDENTIFICATION:- INDELIBLE MANUFACTURES TRADEMARK & PART No. ON ALL ITEMS										
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS			JS	H GROENEWALD	H GROENEWALD	15.10.2021			
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB			P.A.T.	J. MAUDU	J. MAUDU	29.07.2015			
21	ESKOM SPEC. CORRECTED			P.A.T.	J. MAUDU	J. MAUDU	12.06.2014			
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED			P.A.T.	J. MAUDU	J. MAUDU	22.01.2010			
REV	REVISION DESCRIPTION			BY	CHKD	AUTH	DATE	REF. DWGS		
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	SCALE			SAP No:			
				NTS			0168788			
CHKD:		DATE:		CAD REF:			<b>D-DT-3055</b>	SET	SHEET	REV
				SERIES 3000				9	1	23
DRAWN:	Z. WATSON	DATE:	14-09-92	FILE No:						
				3055						





**D-DT-3055**

Unique Identifier: 240-48887441

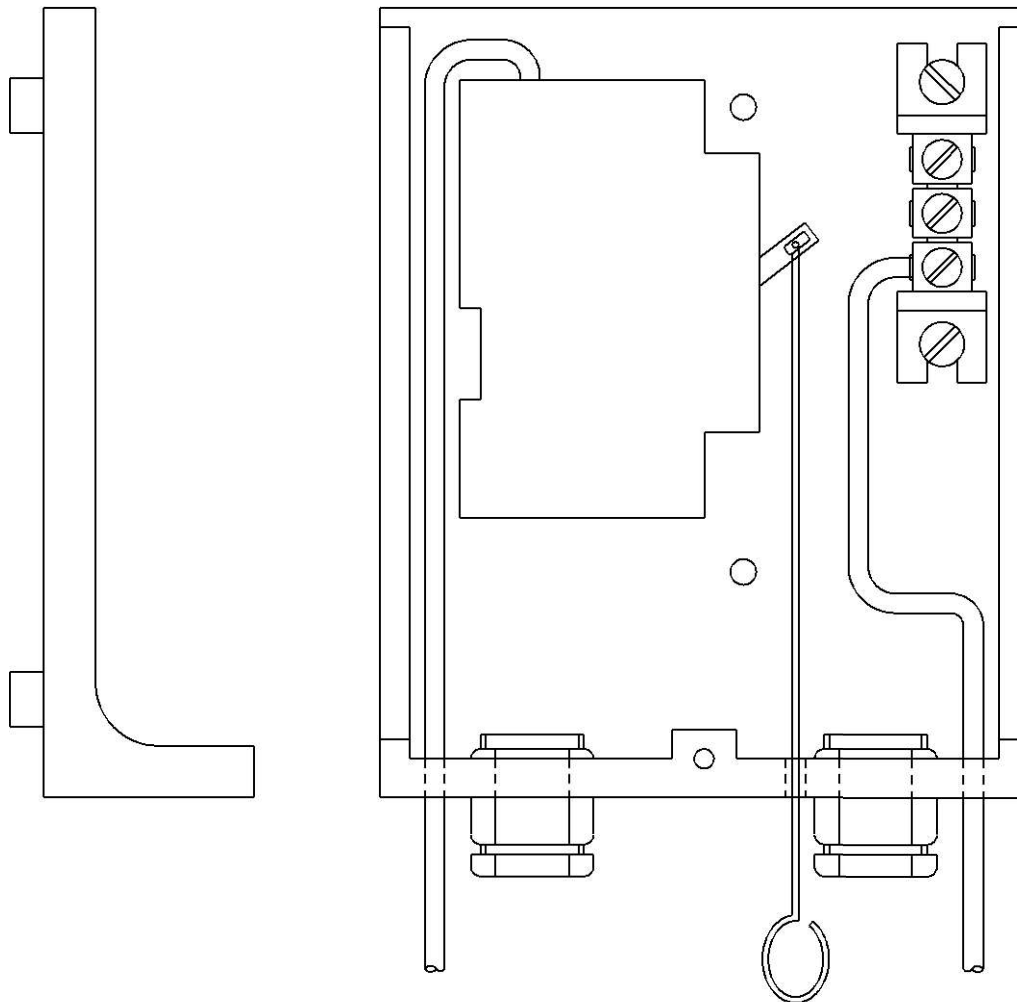
Revision 1

## SPEC SHEET

SAP MATERIAL No.:	0168574							
SHORT DESCRIPTION:	BOX DISTR:POLE TOP; 4-WAY; 50A;WD 340 MM							
TECH. DESCRIPTION:								
<p>BOX, DISTRIBUTION: TYPE: POLE TOP;            4-WAY; 50A; WIDTH: 340 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL;            PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING            AROUND A ROUND OR SQUARE POLE; BOX SUPPLIED AND FITTED WITH THE FOLLOWING :-            4 X NUMBER X COMPRESSION GLANDS, 1 X 13MM DIA.            STREETLIGHT ENTRY HOLE, 1 X 6-WAY LIVE BAR, 1 X 6-WAY NEUTRAL BAR,            2 X 16MM UV STABLE PVC INSULATED COPPER LEADS;            1 X 50A MINIATURE CIRCUIT BREAKER (MCB) (D-DT-3083);            AND 1 X EXTERNAL TOGGLE LEVER FOR LINK STICK WITH            RESET LOOP NOT LESS THAN 30MM IN DIA; USED FOR 4X20 AMP CUSTOMERS            ESKOM DRAWING No. D-DT-3055 *</p>								
SAP MATERIAL No.:	0168787							
SHORT DESCRIPTION:	BOX DISTR:POLE TOP; 4-WAY; 120A;120 MM							
TECH. DESCRIPTION:								
<p>BOX, DISTRIBUTION: TYPE: POLE TOP;            4-WAY; 120A; WIDTH: 340 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL;            PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING            AROUND A ROUND OR SQUARE POLE; BOX SUPPLIED AND FITTED WITH THE FOLLOWING :-            4 X NUMBER X COMPRESSION GLANDS, 1 X 13MM DIA.            STREETLIGHT ENTRY HOLE, 1 X 6-WAY LIVE BAR, 1 X 6-WAY NEUTRAL BAR,            4 X 1.5M X 16MM OR 2 X 1.5M X 25MM UV STABLE PVC INSULATED COPPER LEADS TO BE FITTED;            1 X 120A MINIATURE CIRCUIT BREAKER (MCB) (D-DT-3083);            1 X EXTERNAL TOGGLE LEVER FOR LINK STICK WITH RESET LOOP NOT LESS THAN 30MM IN DIA.;            USED FOR 4X60 AMP CUSTOMERS            ESKOM DRAWING No. D-DT-3055 *</p>								
SAP MATERIAL No.:	0168710							
SHORT DESCRIPTION:	BOX DISTR:POLE TOP; 8-WAY; 50A;WD 340 MM							
TECH. DESCRIPTION:								
<p>BOX, DISTRIBUTION: TYPE: POLE TOP;            8-WAY; 50A; WIDTH: 340 MM; LENGTH: 550 MM; DEPTH: 120 MM; MATERIAL: NON-METAL;            PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING            AROUND A ROUND OR SQUARE POLE;            BOX SUPPLIED AND FITTED WITH THE FOLLOWING :-            8 X NUMBER X COMPRESSION GLANDS, 1 X 13MM DIA.            STREETLIGHT ENTRY HOLE, 2 X 6-WAY LIVE BARS, 1 X 10-WAY NEUTRAL BAR,            3 X 1.5M X 16MM UV STABLE PVC INSULATED COPPER LEADS TO BE FITTED;            2 X 50A MINIATURE CIRCUIT BREAKERS (MCB'S) (D-DT-3083); USED FOR 8X20 AMP CUSTOMERS            ESKOM DRAWING No. D-DT-3055 *</p>								
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS		JS	H GROENEWALD	H GROENEWALD	15.10.2021		
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB		P.A.T.	J. MAUDU	J. MAUDU	29.07.2015		
21	ESKOM SPEC. CORRECTED		P.A.T.	J. MAUDU	J. MAUDU	12.06.2014		
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED		P.A.T.	J. MAUDU	J. MAUDU	22.01.2010		
REV	REVISION DESCRIPTION		BY	CHKD	AUTH	DATE	REF. DWGS	
AUTH:	S.A. CILLIERS	DATE:	MARCH 93			SAP No:		
CHKD:		DATE:				0168574		
						0168787		
				0168710		SET	SHEET	
DRAWN:	Z. WATSON	DATE:	14-09-92	D-DT-3055		9	2	
							23	



Unique Identifier: 240-48887441

Revision 1



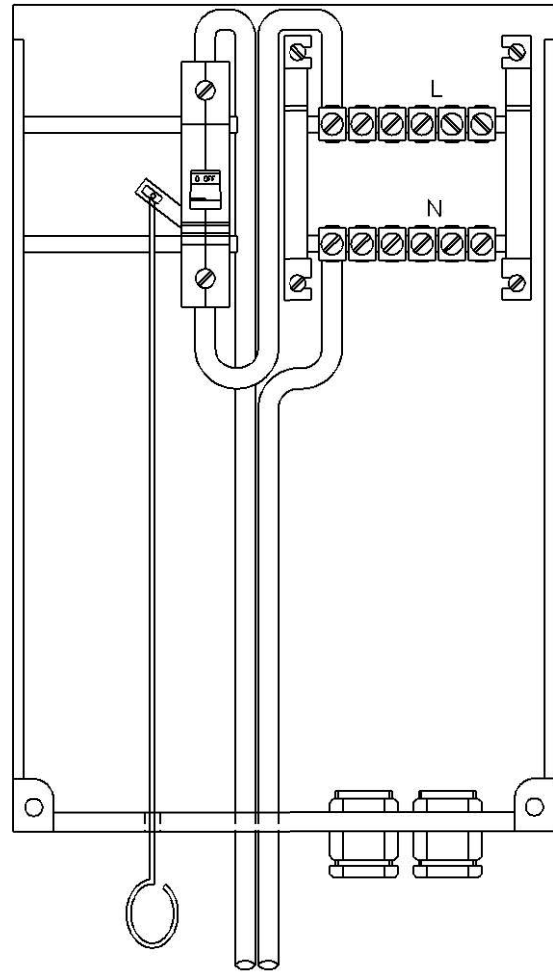
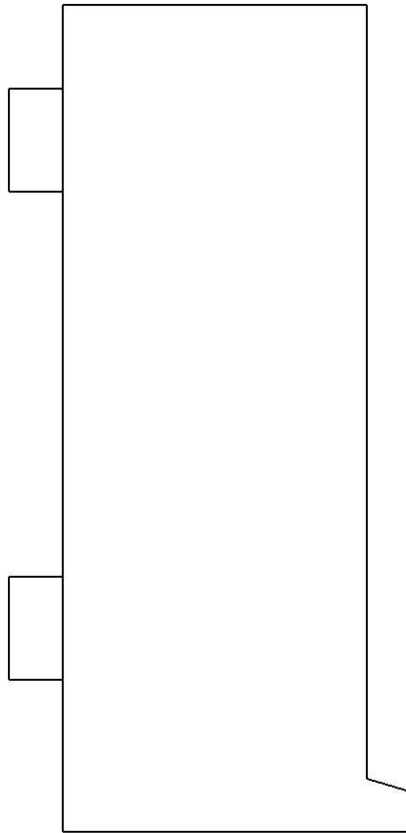
2 WAY BOX

NOTE :  
SKETCH NOT FOR  
MANUFACTURING PURPOSES.

23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS			JS	H GROENEWALD	H GROENEWALD	15.10.2021			
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB			P.A.T.	J. MAUDU	J. MAUDU	29.07.2015			
21	ESKOM SPEC. CORRECTED			P.A.T.	J. MAUDU	J. MAUDU	12.06.2014			
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED			P.A.T.	J. MAUDU	J. MAUDU	22.01.2010			
REV	REVISION DESCRIPTION			BY	CHKD	AUTH	DATE	REF. DWGS		
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	SCALE			SAP No:			
				NTS			0168788			
CHKD:		DATE:		CAD REF:						
				SERIES 3000	D-DT-3055		SET	SHEET	REV	
DRAWN:	Z. WATSON	DATE:	14-09-92	FILE No:			9	3	23	
				3055						

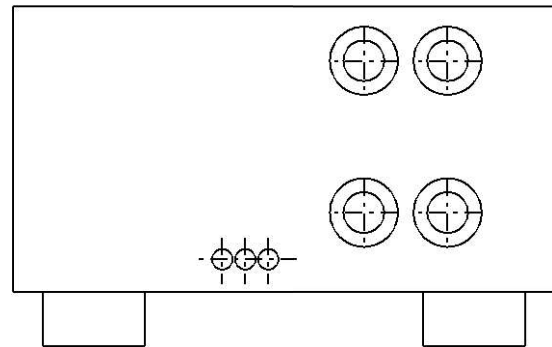
Unique Identifier: 240-48887441



Revision 1



4 WAY BOX

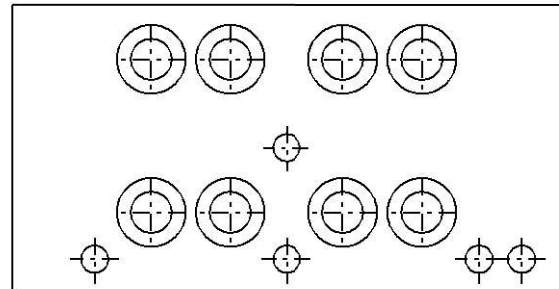
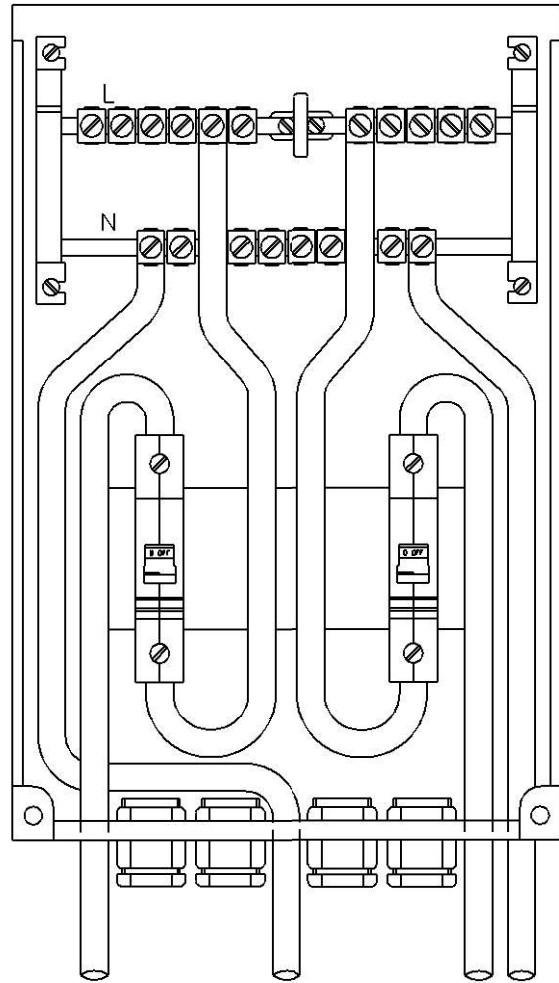
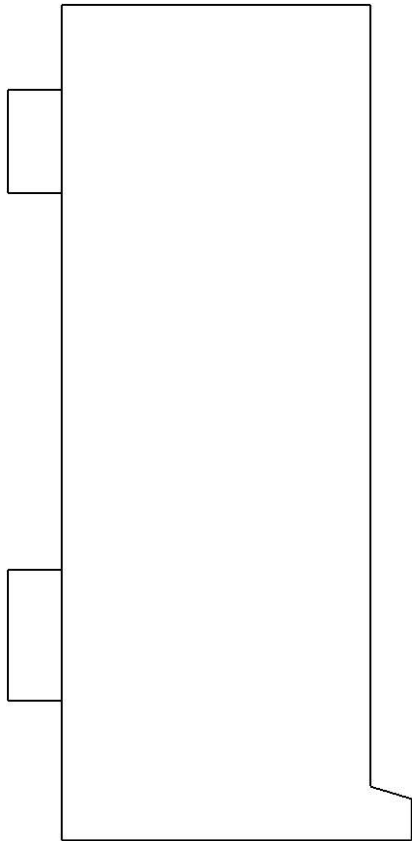
NOTE :  
SKETCH NOT FOR  
MANUFACTURING PURPOSES.



23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS			JS	H GROENEWALD	H GROENEWALD	15.10.2021			
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB			P.A.T.	J. MAUDU	J. MAUDU	29.07.2015			
21	ESKOM SPEC. CORRECTED			P.A.T.	J. MAUDU	J. MAUDU	12.06.2014			
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED			P.A.T.	J. MAUDU	J. MAUDU	22.01.2010			
REV	REVISION DESCRIPTION			BY	CHKD	AUTH	DATE	REF. DWGS		
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	SCALE NTS	 <b>D-DT-3055</b>		SAP No:			
CHKD:		DATE:		CAD REF:			0168574			
				SERIES 3000			0168787			
DRAWN:	Z. WATSON	DATE:	14-09-92	FILE No:	SET		SHEET	REV		
				3055	9		4	23		



Unique Identifier: 240-48887441

Revision 1



8 WAY BOX



NOTE :  
SKETCH NOT FOR  
MANUFACTURING PURPOSES.

23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS			JS	H GROENEWALD	H GROENEWALD	15.10.2021			
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB			P.A.T.	J. MAUDU	J. MAUDU	29.07.2015			
21	ESKOM SPEC. CORRECTED			P.A.T.	J. MAUDU	J. MAUDU	12.06.2014			
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED			P.A.T.	J. MAUDU	J. MAUDU	22.01.2010			
REV	REVISION DESCRIPTION			BY	CHKD	AUTH	DATE	REF. DWGS		
AUTH:		S.A. CILLIERS	DATE:	MARCH 93	 Eskom		SAP No:			
				NTS			0168710			
CHKD:			DATE:				CAD REF:			
					SERIES 3000		SET	SHEET	REV	
DRAWN:		Z. WATSON	DATE:	14-09-92	D-DT-3055		9	5	23	
							FILE No:			
					3055					

Unique Identifier: 240-48887441

Revision 1



## SPEC SHEET

SAP MATERIAL No.:	0245949							
SHORT DESCRIPTION:	BOX DISTR:POLE TOP SPLIT METER 2-WAY 20A							
<b>TECH. DESCRIPTION:</b> BOX, DISTRIBUTION: TYPE: POLE TOP SPLIT METER 2-WAY 20A; WIDTH: 180 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 5 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 2 X 1.5M X 10MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 1 X 50A MINIATURE CIRCUIT BREAKER (MCB) (D-DT 3083), 1 X NEUTRAL BUSBAR INTERNAL WIRING 1 X DIN RAIL FOR THE FITMENT OF THE MCB AND METERS AND 1 X 5KA/5KV SURGE ARRESTOR; USED FOR 2 X 20 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1042; ESKOM DRAWING No. D-DT-3055 *								
SAP MATERIAL No.:	0670228							
SHORT DESCRIPTION:	BOX DISTR:POLE TOP SPLITMETER 2-WAY 60A							
<b>TECH. DESCRIPTION:</b> BOX, DISTRIBUTION: TYPE: POLE TOP SPLITMETER 2-WAY 60A; WIDTH: 180 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 5 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 2 X 1.5M X 25MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 2 X 63A MINIATURE CIRCUIT BREAKER (MCB) (D-DT 3083), 1 X NEUTRAL BUSBAR INTERNAL WIRING 1 X DIN RAIL FOR THE FITMENT OF THE MCB AND METERS AND 1 X 5KA/5KV SURGE ARRESTOR; USED FOR 2 X 60 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1042; ESKOM DRAWING No. D-DT-3055 *								
ITEM	:- BOX,POLE TOP SPLIT METER BOX							
MATERIAL SPECIFICATION	:-							
CORROSION SPECIFICATION	:-							
STANDARD SPECIFICATION	:- NRS 032							
ESKOM SPECIFICATION	:- 240-75659760, D-DT-1042, 1043, 1044, 1045							
TEST & CERTIFICATION REQUIREMENTS :-								
INSPECTION	Yes	No	ESKOM RELEASE NOTE			Yes	No	
IDENTIFICATION:- INDELIBLE MANUFACTURES TRADEMARK & PART No. ON ALL ITEMS								
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS		JS	H GROENEWALD	H GROENEWALD	15.10.2021		
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB		P.A.T.	J. MAUDU	J. MAUDU	29.07.2015		
21	ESKOM SPEC. CORRECTED		P.A.T.	J. MAUDU	J. MAUDU	12.06.2014		
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED		P.A.T.	J. MAUDU	J. MAUDU	22.01.2010		
REV	REVISION DESCRIPTION		BY	CHKD	AUTH	DATE	REF. DWGS	
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	 <b>D-DT-3055</b>		SAP No:		
CHKD:		DATE:				0245949		
						0670228		
DRAWN:	Z. WATSON	DATE:	14-09-92			SET	SHEET	
						9	6	
							23	

Unique Identifier: 240-48887441

Revision 1



## SPEC SHEET

SAP MATERIAL No.:	0229922							
SHORT DESCRIPTION:	BOX DISTR:POLE TOP SPLIT METER 4-WAY 20A							
<b>TECH. DESCRIPTION:</b> BOX, DISTRIBUTION: TYPE: POLE TOP SPLIT METER 4-WAY 20A; WIDTH: 340 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 7 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 4 X 1.5M X 10MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 2 X 50A MINIATURE CIRCUIT BREAKERS (MCB) (D-DT 3083), 1 X NEUTRAL BUSBAR INTERNAL WIRING 1 X DIN RAIL FOR THE FITMENT OF THE MCBS AND METERS AND 2 X 5KA/5KV SURGE ARRESTORS; USED FOR 4 X 20 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1043; ESKOM DRAWING No. D-DT-3055 *								
SAP MATERIAL No.:	0245950							
SHORT DESCRIPTION:	BOX DISTR:POLETOP SPLIT METER 4-WAY 60A							
<b>TECH. DESCRIPTION:</b> BOX, DISTRIBUTION: TYPE: POLETOP SPLIT METER 4-WAY 60A; WIDTH: 340 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 9 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 4 X 1.5M X 25MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 4 X 63A MINIATURE CIRCUIT BREAKER (MCB) (D-DT 3083), 1 X NEUTRAL BUSBAR INTERNAL WIRING 1 X DIN RAIL FOR THE FITMENT OF THE MCBS AND METERS AND 2 X 5KA/5KV SURGE ARRESTORS; USED FOR 4 X 60 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1043; ESKOM DRAWING No. D-DT-3055 *								
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS		JS	H GROENEWALD	H GROENEWALD	15.10.2021		
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB		P.A.T.	J. MAUDU	J. MAUDU	29.07.2015		
21	ESKOM SPEC. CORRECTED		P.A.T.	J. MAUDU	J. MAUDU	12.06.2014		
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED		P.A.T.	J. MAUDU	J. MAUDU	22.01.2010		
REV	REVISION DESCRIPTION		BY	CHKD	AUTH	DATE	REF. DWGS	
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	 <b>D-DT-3055</b>		SAP No:		
CHKD:		DATE:				0229922		
						0245950		
DRAWN:	Z. WATSON	DATE:	14-09-92			SET	SHEET	REV
						9	7	23

Unique Identifier: 240-48887441

Revision 1



## SPEC SHEET

SAP MATERIAL No.:	0670312							
SHORT DESCRIPTION:	BOX DISTR:POLETOP SPLIT METER 6-WAY 20A							
<b>TECH. DESCRIPTION:</b> BOX, DISTRIBUTION: TYPE: POLETOP SPLIT METER 6-WAY 20A; WIDTH: 340 MM; LENGTH: 550 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR THREE STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 11 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 6 X 1.5M X 10MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 3 X 50A MINIATURE CIRCUIT BREAKERS (MCB) (D-DT 3083), 2 X NEUTRAL BUSBARS INTERNAL WIRING 2 X DIN RAILS FOR THE FITMENT OF THE MCBS AND METERS AND 3 X 5KA/5KV SURGE ARRESTORS; USED FOR 6 X 20 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1044; ESKOM DRAWING No. D-DT-3055 *								
SAP MATERIAL No.:	0670315							
SHORT DESCRIPTION:	BOX DISTR:POLETOP SPLIT METER 6-WAY 60A							
<b>TECH. DESCRIPTION:</b> BOX, DISTRIBUTION: TYPE: POLETOP SPLIT METER 6-WAY 60A; WIDTH: 340 MM; LENGTH: 550 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR THREE STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 13 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 6 X 1.5M X 25MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 6 X 63A MINIATURE CIRCUIT BREAKERS (MCB) (D-DT 3083), 2 X NEUTRAL BUSBARS INTERNAL WIRING 2 X DIN RAILS FOR THE FITMENT OF THE MCBS AND METERS AND 3 X 5KA/5KV SURGE ARRESTORS; USED FOR 6 X 60 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1044; ESKOM DRAWING No. D-DT-3055 *								
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS		JS	H GROENEWALD	H GROENEWALD	15.10.2021		
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB		P.A.T.	J. MAUDU	J. MAUDU	29.07.2015		
21	ESKOM SPEC. CORRECTED		P.A.T.	J. MAUDU	J. MAUDU	12.06.2014		
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED		P.A.T.	J. MAUDU	J. MAUDU	22.01.2010		
REV	REVISION DESCRIPTION		BY	CHKD	AUTH	DATE	REF. DWGS	
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	 <b>D-DT-3055</b>		SAP No:		
CHKD:		DATE:				0670312		
						0670315		
DRAWN:	Z. WATSON	DATE:	14-09-92			SET	SHEET	REV
						9	8	23

Unique Identifier: 240-48887441



## SPEC SHEET

SAP MATERIAL No.:	0229921							
SHORT DESCRIPTION:	BOX DISTR:POLE TOP SPLIT METER 8-WAY 20A							
TECH. DESCRIPTION: BOX, DISTRIBUTION: TYPE: POLE TOP SPLIT METER 8-WAY 20A; WIDTH: 340 MM; LENGTH: 550 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR THREE STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 13 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 4 X 1.5M X 16MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 4 X 50A MINIATURE CIRCUIT BREAKERS (MCB) (D-DT 3083), 2 X NEUTRAL BUSBARS INTERNAL WIRING 2 X DIN RAILS FOR THE FITMENT OF THE MCBS AND METERS AND 2 X 5KA/5KV SURGE ARRESTORS; USED FOR 8 X 20 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1045; ESKOM DRAWING No. D-DT-3055 *								
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS		JS	H GROENEWALD	H GROENEWALD	15.10.2021		
22	EXTERNAL TOGGLE LEVERS ADDED TO 120A PTB		P.A.T.	J. MAUDU	J. MAUDU	29.07.2015		
21	ESKOM SPEC. CORRECTED		P.A.T.	J. MAUDU	J. MAUDU	12.06.2014		
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED		P.A.T.	J. MAUDU	J. MAUDU	22.01.2010		
REV	REVISION DESCRIPTION		BY	CHKD	AUTH	DATE	REF. DWGS	
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	 <b>D-DT-3055</b>		SAP No:		
CHKD:		DATE:				0229921		
DRAWN:	Z. WATSON	DATE:	14-09-92			SET	SHEET	REV
						9	9	23

Unique Identifier: 240-48887441

Revision 1