

	Standard	Technology
---	-----------------	-------------------

Title: **Hydrogen Systems Standard** Unique Identifier: **240-56227413**

Alternative Reference Number: **36-803**

Area of Applicability: **Engineering**

Documentation Type: **Standard**

Revision: **2**

Total Pages: **45**

APPROVED FOR AUTHORISATION


☒ TECHNOLOGY ENGINEERING
DOCUMENT CENTRE ☎ x4962

Next Review Date: **October 2021**

Disclosure Classification: **CONTROLLED
DISCLOSURE**

Compiled by	Approved by	Authorised by
		
M. Maunye	H.J. Van Staden	M. Verby
GT-LPS Senior Engineering Technologist	GT- PEIC Senior Consultant	GT-LPS CoE Manager
Date: 2017/03/31	Date: 2017-04-03	Date: 2017-04-03

Supported by

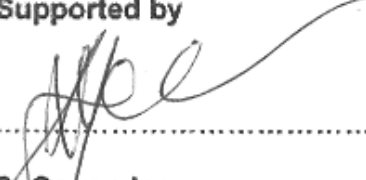

S. Govender
TC Chairperson
Date: 3/04/2017

PCM Reference : 240-53458738

SCOT Study Committee Number/Name : Design Low Pressure Services

CONTENTS

	Page
1. INTRODUCTION	5
2. SUPPORTING CLAUSES	5
2.1 SCOPE	5
2.1.1 Purpose	5
2.1.2 Applicability	5
2.2 NORMATIVE/INFORMATIVE REFERENCES	5
2.2.1 Normative	5
2.2.2 Informative	5
2.2.2.1 International and Local Government References	5
2.2.2.2 Eskom References	6
2.3 DEFINITIONS	7
2.3.1 Classification	10
2.4 ABBREVIATIONS	10
2.5 ROLES AND RESPONSIBILITIES	10
2.6 PROCESS FOR MONITORING	10
2.7 RELATED/SUPPORTING DOCUMENTS	10
3. STANDARD FOR HYDROGEN SYSTEMS	10
3.1 HEALTH AND SAFETY	10
3.2 SAFE PLANT OPERATING PHILOSOPHY	11
3.3 GENERAL REQUIREMENTS	12
3.4 HYDROGEN PRODUCTION QUALITY	12
3.5 PRODUCTION CAPACITY AND HYDROGEN GAS STORAGE CAPACITY	13
3.6 HYDROGEN FACILITIES	13
3.7 BUILDINGS	13
3.7.1 Building Design or Bulk Storage Walls or Weather Shelter	13
3.7.2 Location and QD (Quantity Distance) Guidelines	14
3.7.3 Access	15
3.7.4 Signage, Posting and Labelling	15
3.7.5 Layout	15
3.7.6 Safety Showers and Eye Washers	16
3.7.7 Ventilation	16
3.7.8 Drains	16
3.8 FIRE PROTECTION	16
3.9 PURGING	17
3.9.1 Carbon dioxide purging and Cylinders	17
3.9.2 Nitrogen purging	18
3.9.3 Air purging	18
3.10 HYDROGEN AND HYDROGEN FIRE DETECTION	18
3.10.1 Hydrogen Detection	18
3.10.2 Hydrogen Detection Specifications	18
3.10.3 Hydrogen fire detection systems	19
3.11 PROTECTIVE MEASURES FOR SLIPRINGS AND COUPLED EXCITERS	19
3.12 MECHANICAL PLANT	19
3.13 HYDROGEN STORAGE	20
3.13.1 Bulk storage	20
3.13.1.1 Vessels	20
3.13.2 Hydrogen cylinder supply	21
3.13.3 Hydrogen cylinder pallets	22
3.13.4 Mobile hydrogen supply	22
3.14 PIPING SYSTEMS	22
3.14.1 Piping systems	22

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

3.14.2 Supports	23
3.14.3 Piping for hydrogen	23
3.14.4 Bending and forming piping	23
3.14.5 Double block-and-bleed	23
3.15 COMPONENTS	24
3.15.1 Joints in piping and tubing	24
3.15.2 Threaded joints	24
3.15.3 Flanged joints	24
3.15.4 Silver braze joints	25
3.15.5 Soft solder joints	25
3.15.6 Pipe connections	25
3.15.7 Flanges	25
3.15.8 Flexible hoses	25
3.15.9 Expansion joints	25
3.15.10 Valves	26
3.15.10.1 Excess Flow Valves (EFVs)	26
3.15.10.2 Emergency Isolation Valves (EIVs)	26
3.15.10.3 Isolating Valves	26
3.15.10.4 Gas Cylinder Valves	27
3.15.10.5 Non Return Valves (NRVs)	27
3.15.11 Gauges	27
3.15.12 Hydrogen venting	27
3.15.13 Transfer connections	27
3.15.14 Compressor machines	28
3.15.15 Hydrogen dryers	28
3.15.16 Generator hydrogen dryers	29
3.15.17 Condensate traps	30
3.15.18 Cooling water systems	30
3.16 OVERPRESSURE PROTECTION OF STORAGE VESSELS AND PIPING SYSTEMS	30
3.16.1 Safety Valves	30
3.17 PRESSURE REGULATOR	30
3.17.1 Supplemental pressure relief	31
3.17.2 Failure modes	31
3.18 ELECTRICAL CONSIDERATIONS	31
3.18.1 Electrical installation	31
3.18.2 Bonding and grounding	31
3.18.3 Electric motors	31
3.18.4 Transformer	32
3.18.5 Electrical controls	32
3.18.6 Electrical connections and cabling	32
3.19 CONTROLS AND INSTRUMENTATION	33
3.19.1 Plant operation and instrumentation	33
3.19.2 Mass flow meter	34
3.19.3 Analysing Apparatus (Indicating)	34
3.19.4 Alarms and tips	35
3.20 PRODUCTIONS QUALITY AND QUANTITY MANAGEMENT	35
3.20.1 Electrolytic cells	36
3.20.2 Before storage	36
3.20.3 After storage	36
3.20.4 At the generator	36
3.20.5 Additional plant monitoring requirements	37
3.21 CORROSION PROTECTION	37
3.22 MAINTAINABILITY	37
3.23 MATERIALS FOR HYDROGEN SERVICE	37
4. AUTHORISATION	38

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

5. REVISIONS	38
6. DEVELOPMENT TEAM	38
7. ACKNOWLEDGEMENTS	39
APPENDIX A	40
8.1 ANNEXURE A.1 MATERIAL DATA SPECIFICATION	40
8.2 ANNEXURE A.2 HYDROGEN EMBRITTLEMENT	40
8.2.1 Low Temperature Effects	41
8.2.1.1 General	41
8.2.2 Low-Temperature Embrittlement	42
8.2.3 Thermal contraction	42
8.2.4 Material Suitability for Hydrogen Service	42
APPENDIX B	45
9.1 HYDROGEN GENERATING PLANT FACTORY ACCEPTANCE TESTING GUIDELINE	45

FIGURES

Figure 1: Hydrogen Concentration	17
Figure 2: Double Block-and-Bleed Arrangement	24

TABLES

Table 1: Hydrogen embrittlement susceptibility of some commonly used metals	41
Table 2: Suitability of some selected materials for hydrogen service	43
Table 3: (Continued): Suitability of some selected materials for hydrogen service	43

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

1. INTRODUCTION

This document consists of the Standard applicable to the Hydrogen Systems within Eskom.

2. SUPPORTING CLAUSES

2.1 SCOPE

2.1.1 Purpose

Hydrogen is used at the power station as a cooling medium for large two-pole and four-pole generators. A need has been identified for a document which contains general and specific information relating to the hydrogen plant, hydrogen reticulation system and generator hydrogen cooling system. This document defines the minimum requirements for selection of equipment and materials to meet the need, purpose, functions and safety requirements of these hydrogen systems.

2.1.2 Applicability

This document shall apply throughout Eskom Holdings Limited Divisions.

- a. This Standard addresses Eskom's requirements for hydrogen production plant installations, associated controls, measuring equipment, storage vessels, reticulation system, generator hydrogen cooling system and plant safety.
- b. This standard is applicable to the generator cooling system and includes the inert gas purging system of the generator.
- c. Immediate compliance is required for safety critical items to ensure safe plant operation.
- d. Within one year of the authorisation of this standard, compliance of all existing plant shall be evaluated and future upgrades and/or refurbishment planned accordingly.
- e. Within three years there shall be compliance to this standard, or alternatives as authorised by the Chief Officer.
- f. The safety requirements stipulated in this standard are also applicable to hydrogen gas supply companies. Hydrogen supplied to Eskom, will be accepted only from plants that meets the minimum safety requirements stipulated in this specification.

2.2 NORMATIVE/INFORMATIVE REFERENCES

Parties using this document shall apply the most recent edition of the documents listed in the following paragraphs.

2.2.1 Normative

None

2.2.2 Informative

2.2.2.1 International and Local Government References

- [1] NASA Standard NSS 1740.16, Safety Standard for Hydrogen and Hydrogen Systems: Guidelines for Hydrogen System Design, Materials, Selection, Operations, Storage, and Transportation. National Aeronautics and Space Administration, Washington, DC, USA
- [2] IGC 15/961E, Gaseous Hydrogen Stations. Industrial Gases Council, Brussels, Belgium
- [3] NFPA 50A, Standard for Gaseous Hydrogen Systems at Consumer Sites. National Fire Protection Association, Quincy, MA, USA, 1999
- [4] NFPA 50B, Standard for Liquefied Hydrogen Systems at Consumer Sites. National Fire Protection Association, Quincy, MA, USA, 1999

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

- [5] ANSI/AIAA G-095-2004, American Institute of Aeronautics and Astronauts, Guide to Safety of Hydrogen and Hydrogen Systems, American National Standard Institute, Reston, VA, USA, 2005
- [6] DOL, Occupational Health and Safety Act 85 of 1993, Labour Relations Act, South Africa, 1993.
- [7] ASME B31.3-1996, Process Piping.
- [8] PD 5500:2015 Specification for unfired fusion welded pressure vessels.
- [9] SANS 10108, The Classification of Hazardous Locations and the Selection of Apparatus for use in such locations.
- [10] NFPA 850, Recommended Practice for Fire Protection for Electric Generating Plants and High Voltage Direct Current Converter Stations.
- [11] SANS 10119, Reduction of Explosion Hazards Presented by Electrical Equipment Segregation. Ventilation and Pressurization.
- [12] SANS 10140, Identification Colour Markings (parts 1 to 4).
- [13] SANS 1507, Electric cables with extruded solid dielectric insulation for fixed installations (300/5000V to 1900/3300V).
- [14] SANS 1574, Electrical cables — Flexible cords.
- [15] SANS 1123, Pipe Flanges.
- [16] OHS Act [85 of 1993], Occupational Health and Safety Act of South Africa.
- [17] ISO 11114, Transportable gas cylinders- Compatibility of cylinder and valve material with gas contents.
- [18] ISO 11625, Gas cylinders – Safe handling.
- [19] ISO 13769, Gas cylinders – Stamp marking.
- [20] ISO 16111, Transportable gas storage devices – Hydrogen absorbed in reversible metal hydride
- [21] ISO 22734-1, Hydrogen generators using water electrolysis process —Part 1: Industrial and commercial applications.

2.2.2.2 Eskom References

- [22] CGA G-5.4, Standard for Hydrogen Piping Systems at Consumer Locations.
- [23] 32-303 Requirements for the Safe Processing, Storage, Removing and Handling of Asbestos and Asbestos Containing Material, Equipment and Articles.
- [24] 240-114767031, Specification for the Identification of the Contents of Pipelines and Vessels.
- [25] 240-101712128 (Standard for the Internal Corrosion Protection of Water Systems, Chemical Tanks and Vessels and Associated Piping with Linings).
- [26] 240-56536505, Management of Hazardous Locations.
- [27] 240-53114002, Engineering Change Management Procedure.
- [28] 240-53114193, Occurrence and Incident Management Procedure.
- [29] 36-681, Generation Plant Safety Regulations.
- [30] NWS 1409, Specification for Indoor Resin-Encapsulated Dry-Type Transformers.
- [31] NWS 1551, Asynchronous Electric Motors.
- [32] RES/RR/01/14931, TSI Research Report, Status of the Hydrogen Plants within Eskom, S Wilshire, Nov 2001.
- [33] 240-54937450, Fire Protection and Life Safety Design Standard.
- [34] 240-56737448 Fire detection and life safety design standard.
- [35] CGA G-5, Hydrogen.
- [36] CGA G-5.3, Commodity Specification for Hydrogen.
- [37] CGA G-5.4, Standard for Hydrogen Piping Systems at Consumer Locations.
- [38] RES/RR/01/14931, TSI Research Report, Status of the Hydrogen Plants within Eskom, S Wilshire, Nov 2001
- [39] CGA G-5.5, Hydrogen Vent Systems.
- [40] CGA G-5.6, Hydrogen Pipeline Systems.
- [41] CGA G-5.8, High Pressure Hydrogen Piping Systems at Consumer Locations.

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

- [42] NASA Standard NSS 1740.16, Safety Standard for Hydrogen and Hydrogen Systems: Guidelines for Hydrogen System Design, Materials, Selection, Operations, Storage, and Transportation. National Aeronautics and Space Administration, Washington, DC, USA.
- [43] IGC 15/96/E, *Gaseous Hydrogen Stations*. Industrial Gases Council, Brussels, Belgium.
- [44] 240-56356396: Earthing and Lightning Protection Standard.
- [45] 240-56227443: Requirements for Control and Power Cables for Power Station Standard.
- [46] 240-76368574: High Security Mesh Fencing.

2.3 DEFINITIONS

Definition	Description
AC Ripple	The Alternating Current component of a Direct Current (DC) supply. This is possible in cases where the DC is obtained from a rectified AC supply. It is easiest measured using a multi-meter set for AC voltage measurement.
Arrested Flame	Combustion process which is stopped or flame which is put out
Atmospheric Dew Point	The dew point of a gas that is at atmospheric pressure, normally regarded as 1bar or 101 kPa. Generally, plant dew point measurements are at higher pressures and will need to be adjusted, through calculations, to provide an atmospheric dew point value.
Authorised Inspection Authority (AIA)	Person responsible for the plant (normally the Government Ticket Holder) refer to definition in vessels under pressure regulations.
Code	Regulations, requirements or standards that have been made binding and mandatory by a local or national government or design standard organisation.
Component	Any discrete part of a complete item or system.
Confined Space	Space not normally occupied by personnel NOTE Confined space has limited or restricted openings for entry and exit, may lack adequate ventilation, and may contain or produce "dangerous air contamination". Therefore, it may not be safe for entry.
Confinement	Physical restriction, sufficient to influence the combustion process.
Deluge System	Water spray system that is used to keep equipment, especially hydrogen storage vessels, cool in the event of a fire and fire extinguishing in high risk areas in which hydrogen is used.
Detonation	Exothermic chemical reaction coupled to a shock wave that propagates through a detonable mixture or medium. Note 1 the thermal energy of the reaction sustains the shock wave, and the shock wave compresses unreacted material, producing the high temperatures necessary to drive the reaction. Note 2 the detonation process is characterised by a propagation speed that is greater than the speed of sound in the unburned mixture.
Detonation Limits	Explosion limit maximum and minimum concentrations of a gas, vapour, mist, spray or dust, in air or oxygen, for stable detonation to occur. Note the limits are controlled by the size and geometry of the environment, the concentration of the fuel, as well as the means by which ignition occurs.
Dewpoint	The temperature, for a given pressure, at which a relative humidity of 100% will be reached. At this point the water vapour- and partial-pressures are equal and condensation will take place if the temperature is further reduced or the pressure increased.
Diluent	Inert component within a gas mixture that reduces the concentration of the remaining (active) materials
Entrainment	Process in which the flow of a gas pulls or draws liquid droplets along with the

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

	<p>gas flow.</p> <p>Note: this is of special concern in the vent system for a liquid hydrogen storage vessel, and is most likely to occur with rapid vent rates. It is undesirable because of the considerable volume expansion of the liquid, which would have an effect on the vent rate, including the vent capability of relief devices, and the loss of the liquid product that occurs.</p>
Explosion	<p>Rapid equilibrium of pressure between the region of energy release (system) and its surroundings.</p> <p>Note: explosions can occur through mechanical failure of vessels containing high-pressure fluids (which includes a gas) or through rapid chemical reactions producing large volumes of hot gases (see detonation limits).</p>
Facility	Group of buildings or equipment used for specific operations at one geographic location.
Fail-Safe	Ability to sustain a failure without causing loss of equipment, injury to personnel, or loss of operating time.
Fire	<p>Rapid chemical reaction that produces heat and light; sustained burning as manifested by any or all of the following: light, flame, heat, and smoke; stationary flame with the flammable mixture fed into the reaction zone.</p> <p>Note hydrogen flames are nearly invisible in daylight and are without smoke, unless other materials are entrained in the flames.</p>
Flammability	Degree to which a material is easily ignited in an oxidising atmosphere; concentration of a fuel in an oxidiser below which a burning reaction cannot be sustained.
Flammability Limits	<p>Lower (LFL) and upper (UFL) vapour concentrations of fuel in a flammable mixture that will ignite and propagate a flame.</p> <p>NOTE 1: These limits are functions of temperature, pressure, diluents and ignition energy.</p> <p>NOTE 2: These limits are usually expressed as percent (volume fraction).</p>
Hydrogen Embrittlement	Deleterious changes in the physical properties of a metal that exposure to hydrogen can produce.
Ignite	<p>Cause to burn or to catch fire</p> <p>Note: the process involves the raising of a substance to its ignition point (the minimum temperature at which a substance will continue to burn without additional application of external heat).</p>
Ignition Energy	Energy required to initiate flame propagation through a flammable mixture.
Maximum Allowable Working Pressure (MAWP)	<p>Maximum gauge pressure permissible in a storage vessel (at its top) or piping system for a designated temperature.</p> <p>Note 1: the MAWP is the basis for the pressure setting of the pressure-relief devices protecting the vessel or piping system.</p> <p>Note 2: the MAWP may also be the maximum allowable operating pressure rating of pressure vessels manufactured in accordance with national pressure vessel codes.</p>
Normal Temperature and Pressure (NTP)	Temperature of 273,15 K and absolute pressure of 101,325 kPa
NRV Valve	Valve that operates on differential pressure and allows flow in one direction only
Overpressure	In a blast wave pressure above atmospheric pressure
Overpressure	Within a containment structure pressure that exceeds the maximum allowable working pressure of the containment structure
Pressure Regulator	<p>Device that is used in a system to regulate the pressure to a set value</p> <p>Note: the regulator limits a variable high-pressure input to a constant lower-</p>

CONTROLLED DISCLOSURE

	pressure output.
Pressure-Relief Device	<p>Basic safety device used to prevent the pressure within a system from exceeding the MAWP</p> <p>NOTE 1: This device is installed so that excessive pressure within the containment structure can be relieved before damage to the containment structure occurs.</p> <p>NOTE 2: A pressure-relief device is typically a spring-loaded valve that will open at a set pressure or Temperature or a rupture disk that contains a membrane designed to rupture at a set pressure.</p>
Purge	<p>Process used to remove or displace gases.</p> <p>Note for example, before admitting hydrogen to a system, the air in the system is removed to avoid the formation of a combustible mixture within the system.</p>
Q-D Quantity Distance	<p>Relationship between quantity of flammable or explosive material and distance separation from the exposed object(s) that provide(s) a defined type of protection.</p> <p>Note 1: these relationships are based on levels of risk considered acceptable for the stipulated exposures and are tabulated in appropriate q-d tables.</p> <p>Note 2: relationships include separation distances for safe operations between facilities, roadways, etc. And total quantities of energetic materials that can interact in a given location.</p> <p>Note 3: this approach to safety is commonly used for hydrogen in aerospace and military applications.</p>
Quench	Terminate a chemical reaction or the propagation of a flame.
Quenching Distance	Gap dimension required to prevent the propagation of an open flame through a flammable fuel/air mixture.
Quenching Gap	Between electrodes spark gap between two flat parallel-plate electrodes at which ignition of a combustible fuel/air mixture is suppressed NOTE: Smaller gaps totally suppress spark ignition.
Quenching Gap	The passage gap dimension required to prevent propagation of an open flame through a flammable fuel/air mixture that fills the passage
Redundancy	Use of more than one independent means to accomplish a given function
Risk	<p>Exposure to the possibility of injury or loss as applies to safety.</p> <p>Note: risk is a function of the possible frequency of occurrence of an undesired event, of the potential severity of resulting consequences, and of the uncertainties associated with the frequency and severity.</p>
Soft Goods	<p>Non-metallic material</p> <p>Note: for example polymers, coatings or lubricants. In a valve, the term soft goods would refer to items such as the seals, possibly the seat, and the O-rings.</p>
Standard	Generally agreed-upon set of criteria specifically designed to define a safe product, practice, mechanism, arrangement, process or environment based on currently available scientific and experimental knowledge concerning the relevant subject or scope.
Stoichiometric Mixture	Mixture of reactants in a chemical reaction that optimises production of the reaction products.
System	<p>Assembly of components in which hydrogen is delivered, stored or used.</p> <p>Note 1: a system can include components such as storage vessels, piping, valves, pressure-relief devices, pumps, expansion joints and gauges.</p> <p>Note 2: a system can refer to a new site, a new facility at a site, or a new installation at a facility.</p>

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

2.3.1 Classification

Controlled Disclosure: Controlled Disclosure to External Parties (either enforced by law, or discretionary).

2.4 ABBREVIATIONS

N/A

2.5 ROLES AND RESPONSIBILITIES

None

2.6 PROCESS FOR MONITORING

None

2.7 RELATED/SUPPORTING DOCUMENTS

- Annexure A — Material Data Specification
- Annexure B — Hydrogen Generating Plant Factory Acceptance Testing

3. STANDARD FOR HYDROGEN SYSTEMS

3.1 HEALTH AND SAFETY

- The conditions of the Occupational Health and Safety Act (OHS Act) in its entirety shall apply. This document shall not be interpreted in any way which contravenes the requirements of the OHS Act. Should any inconsistencies arise, these should be brought to the attention of the Group Technology Department.
- All hydrogen systems shall comply with 240-56536505, Management of Hazardous Locations.
- The following are considered to be critical to the safe operation of hydrogen plant and no plant shall operate without meeting these requirements:
 - a. Oxygen content measurement of produced Hydrogen after the cells on atmospheric electrolyzers.
 - b. Hydrogen purity after the dryers including oxygen content (before bulk storage).
 - c. Minimum flow through analysers is ensured.
 - d. Hydrogen leak detection.
 - e. Water seals (or flashback arrestors) on all vents.
 - f. Approved area classification.
 - g. Hydrogen fire detection.
 - h. Hydrogen in oxygen measurement on the oxygen stream.
 - i. Dew point on generator.
 - j. Minimum quantity of inert gas connected to perform emergency purge on production and generators.
 - k. Emergency depressurisation system on generators with flashback arrestor.
- Hydrogen Plant meets the criteria of "Level 1" as per the Engineering Change Classification. Any modifications to this plant must comply with 240-53114002, Engineering Change Management Procedure.
- Specifically, Regulation 18 (Major Hazard Installation) of the OHS Act is relevant to Hydrogen Plant. Inter alias, the following shall be noted:

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

- a. A Risk Assessment shall be carried out at intervals not exceeding five years on all hazardous installations by an Approved Inspection Authority.
- b. The Risk Assessment shall be reviewed "forthwith if there is any reason to suspect that the preceding assessment is no longer valid".
- c. "Temporary Installations" are to be considered "installations" at their points of departure and arrival. Consequently, tube-trailers shall be considered "installations" and the above mentioned Risk Assessments shall specifically address the tube trailer supplies.
- d. There shall be a readily available emergency plan, reviewed not less than every three years and formally tested at least once per year. This plan shall be submitted to local relevant government department for approval.
- e. Any activation of the emergency plan shall be reported to Chief Inspector (Department of Labour) and all near misses shall be recorded in a register that is available for inspection.
- f. All certificates required by the OHS Act shall be available on site.
- g. The area housing the hydrogen plant and associated equipment shall be classified in accordance with SANS 10108 and classification of the area shall be conducted by a Government Approved Inspection Authority.
- h. All equipment supplied for permanent installation, as well as any portable equipment used from time to time, shall be suitable for operating in classified area (as per 4.1.5). Specification for all equipment used shall make specific reference to the use in Hydrogen containing areas.
- i. The Generation Division's Plant Safety Regulations shall apply.
- j. All equipment utilised in the classified area, shall conform to meet the level of classification e.g. tools, clothing, shoes etc. shall be non-static.
- k. Hot work procedures shall be compiled for all maintenance and testing conducted in the hydrogen plant. This shall be incorporated into the power station permit to work system.
- l. Asbestos used shall be managed in accordance with the relevant Eskom Corporate Directive (ESKADAAI8, The Safe Processing, Storage, Removing and Handling of Asbestos and Asbestos Containing Materials) and Procedure (ESKPVAAG5 Requirements for the Safe Processing, Storage, Removing and Handling of Asbestos and Asbestos Containing Material, Equipment and Articles).

3.2 SAFE PLANT OPERATING PHILOSOPHY

The occurrence of a flammable or explosive hydrogen-air/oxygen mixture must be classified as a level 1 incident in accordance to 240-53114193 "Occurrence and Incident Management Procedure". A flammable or explosive hydrogen-air/oxygen mixture may not be vented before a detailed plan, design and procedure has been approved via "240-53114002, Engineering Change Management Procedure" before execution, except on a hydrogen cooled generator where an approved emergency procedure must be in place.

Ensure the minimum volume of diluent as stipulated in this standard, to execute an emergency generator purge must be connected to the distribution manifold, before a generator is filled with hydrogen. Generator hydrogen leakage must be monitored on-line or manually on a daily basis. When the leakage exceeds the maximum value as indicated by the original manufacturer a risk assessment in accordance to 36-962 "Plant Risk Assessment and Reporting". Only if the risk can be mitigated to a level of no risk of injury or risk to life, may the generator remain on load.

In the case where hydrogen is produced on site, by means of water electrolysis, safe plant operation of the generator must be ensured by implementing the following philosophy:

- The hydrogen purity in the generator must always be maintained above the high flammability limit of hydrogen and oxygen mixture of 96 % hydrogen purity and 4% oxygen.
- Running the generator at hydrogen purity levels lower than 96 % is allowed only if the oxygen content of the gas is measured and the oxygen measured is less than 4 %.

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

- Consideration should be given to the response time and the accuracy of the analysers being utilised.
- As part of gas purity, analysing the minimum and maximum flow through the analysers, must be monitored and interlocked with the gas analysers to provide a true reading of the gas inside the generator.
- As part of gas purity, analysing the minimum and maximum flow through the analysers must be monitored and interlocked with the gas analysers to provide a true reading of the gas inside the generator.
- The contamination limits referred to in ISO 22734-1, Hydrogen generators using water electrolysis process —Part 1:Industrial and commercial applications is only applicable during a transient state, during steady state operation the contamination limits shall be below 1%.
- The delivery gas purity for bulk storage shall be > 99, 5%.The contamination of H₂ in O₂ and vice versa measured directly after the cell stack should less than 1, 6% during the transient state and less than 1% during the steady state.
- In the event of excess contamination, one of the following two actions is required:
 - Where there is no automated vent facility, the entire plant shall be tripped with an alarm to the control room.
 - Where there is an automated vent facility, the out of specification condition shall be alarmed and the hydrogen vented until the quality returns to specification.

3.3 GENERAL REQUIREMENTS

As hydrogen production plants incorporate elements of the Mechanical, Civil, Chemical, Electrical and Control & Instrumentation Engineering, sound engineering practices from these disciplines shall be applied.

At all times the original requirements of the manufacturer with respect to operating and maintenance of the plant shall be adhered to.

Local procedures shall be compiled, and approved by the Power Station Manager, addressing the following:

- a. General plant safety requirements.
- b. Plant start-ups.
- c. Plant shutdowns.
- d. Emergency conditions, including management of explosive mixtures.
- e. Preventative maintenance requirements.
- f. Corrective maintenance.
- g. Test and inspection requirements.
- h. Purging and safe isolation requirements.
- i. Alarm response procedures.

3.4 HYDROGEN PRODUCTION QUALITY

- a. Hydrogen purity shall be a minimum of 99,5 % by volume during the steady state measured after the electrolyser of production and the ISO 22734-1 referenced limits shall not be exceeded during transient states. These limits are applicable through the production range minimum to maximum.
- b. The dew point of produced gas must be measured before bulk storage (i.e. after compressing and drying) and shall be better than -50°C at NTP. The hydrogen generation plant shall be designed to produce hydrogen with this dew point and a deviation from this quality is due to a plant irregularity and must be addressed. The production plant can be kept in service until the dew point reaches -10°C when it is expected to stop production.
- c. Measurement points, and measurement requirements, are provided in Section 4.19 of this standard. All measurement lines that are vented to atmosphere shall be fitted with flash-back protection.

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

- d. The hydrogen production plant shall be designed to produce hydrogen that is free of ammonia, hydrazine and any other impurities, which could be harmful to the materials used in the construction of the electrical generators and their cooling systems. Specifications for raw materials required to achieve this requirement shall be included in the relevant maintenance instruction document.
- e. The moisture content of the hydrogen fed to the generator shall ensure that the dew point at the generator operating pressure shall be at least 20°C below the lowest temperature to which the generator can be exposed.

3.5 PRODUCTION CAPACITY AND HYDROGEN GAS STORAGE CAPACITY

Hydrogen Gas storage capacity shall be based on the greater of the design versus the actual consumption figures. Hydrogen Gas storage capacity shall be determined on the following basis:

- a. A quantity of two fills of hydrogen for the largest generator with the turning gear in operation; and
- b. A sufficient quantity for seven (7) days of normal consumption of all generators,
- c. Where there is insufficient surplus storage capacity to allow for statutory inspections of or maintenance on, storage vessel without contravening the requirements above, there shall be a sufficient alternative backup supply on site.
- d. To give added security against the consequences of a breakdown of the hydrogen production plant or the reticulated hydrogen system, a seven (7) days' supplementary supply of hydrogen, based on normal consumption for all generators, shall be safely stored on site in cylinders.
- e. Contingency plans shall be implemented with a gas supply company to ensure rapid delivery of replacement cylinders.
- f. Hydrogen production rate shall be sufficient to enable the minimum storage capacity to be achieved within 7 days, with all generators in service and allowing for a single generator fill within this 7 day period.
- g. The hydrogen generation plant shall be able to increase production to 100 % of design capacity within 8 hours.
- h. The operating philosophy of each plant shall ensure that operation at levels below the minimum level recommended by the manufacturer is not possible.
- i. The energy efficiency as the higher heating value of hydrogen of 142 MJ/kg divided by the total energy consumed for the entire plant (including dryers) per kilogram of hydrogen produced shall be better than 70 %, measured at the point of bulk storage taking into consideration all losses for the process to meet the specified quality and quantity.
- j. An explosion proof wall shall be built around each receiver and shall be designed to withstand the explosion pressure from the receivers.

3.6 HYDROGEN FACILITIES

The production of hydrogen in Eskom is currently by water electrolysis and the Hydrogen generators shall comply to ISO 22734-1 Hydrogen generators using water electrolysis process — Part 1: Industrial and commercial applications with the additional requirements stipulated in this standard superseding the ISO 22734-1 standard. However, hydrogen can be produced by any alternative means provided it meets the quality, quantity and operational safety requirement listed in this document. Use of alternative methods shall be subject to approval by the Generation Technology Department.

3.7 BUILDINGS

3.7.1 Building Design or Bulk Storage Walls or Weather Shelter

- a. A weatherproof shelter or canopy in an outdoor location shall be a structure enclosed by not more than two walls set at right angles and shall have vent space provided between the walls and vented roof or canopy. Such walls shall be constructed of non-combustible materials

CONTROLLED DISCLOSURE

- b. A weatherproof shelter or canopy shall be installed over any containerised plant. Buildings or special rooms in which hydrogen is stored and used (monopropellant) as allowed by the OSHACT shall be constructed according to the construction regulations. Buildings shall be constructed of non-combustible materials on a substantial frame. Window panes shall be shatterproof plastic or glass. To limit the generation and accumulation of static electricity the floors, walls and ceilings should be designed accordingly, a fire resistance rating of at least two hours is acceptable.
- c. The Seismic design of the building shall be in accordance with SANS 10160.
- d. Sun shields shall be installed as part of the bulk storage vessels with adequate ventilation and prevention of hydrogen entrapment.
- e. All hydrogen-containing vessels, piping, and other equipment should be protected from potential sources of shrapnel and explosion walls shall be installed around each bulk storage vessel.
- f. All hydrogen-containing vessels, piping, and other equipment being a source of hydrogen release should be protected from potential sources of shrapnel.
- g. Explosion venting shall be provided in exterior wall or the roof only. According to the OHSACT regarding room volume the venting area shall not be less than $0,11 \text{ m}^2 / \text{m}^3$. Vents may consist of one or a combination of the following:
 - Walls of light material, lightly fastened outward — opening swinging doors in exterior walls
 - Lightly fastened walls or roofs
 - Lightly fastened hatch cover

These must be designed to relieve at a maximum internal pressure of 1, 2 kPa. Doors must be hinged to swing outwards in an explosion and doors must be easily accessible to employees. Partitions shall be continuous from floor to ceiling and securely anchored. At least one wall shall be an exterior wall, and the room shall not be open to other parts of the building. Any heating in rooms containing hydrogen shall be limited to steam, hot water, or other indirect means.

3.7.2 Location and QD (Quantity Distance) Guidelines

- a. For new hydrogen generating plant a risk assessment shall be done that considers the location of the plant relative to the unit and generator transformers and routine traffic, limiting the impact of an explosion to power generating plant and personnel. The hazards analyses should identify the primary hazards involved with the installation, such as: 1) hydrogen release and burning of a hydrogen/air mixture, and 2) explosion and fragment projectiles.
- b. The AIA must handle the determination of the QD on an individual basis for quantities of hydrogen less than the minimum specified in the standard of guidelines. Each situation should be evaluated based on the hazard presented by the specific quantity of hydrogen being considered.
- c. The installation and location of hydrogen storage facilities shall conform to OHSACT 103 and NFPA 50A. Hydrogen systems of $84,9 \text{ m}^3$ or less, located inside building, shall be situated in the building so the following criteria are met:
 - Adequately ventilated area
 - 6,1 m from stored flammable materials
 - 7,6 m from open flames, electrical equipment, or other sources of ignition
 - 15,2m from ventilation intakes and air conditioning equipment
 - 15,2 m from other flammable gas storage
 - 7,6 m from concentrations of people
 - More than one system of $84,9 \text{ m}^3$ or less may be installed in the same room provided the system is separated by at least 15.2 m. Each shall meet all the above requirements.

CONTROLLED DISCLOSURE

3.7.3 Access

- a. Access to the hydrogen plant and bulk storage shall be controlled and the requirements of the Generation Division's Plant Safety Regulations 36-681 shall apply.
- b. Employee accessing a hydrogen system must be considered as a potentially hazardous event and such entrance shall be by authorised personnel only. Employee entering the hydrogen plant of control areas shall be provided necessary and sufficient clothing, equipment, detection devices, and respiratory devices as required (OHSACT):
 - Access shall be limited to authorised personnel (OHSACT; NFPA) on the hydrogen system.
 - Sufficient personnel must be available to perform a hazardous operation safely and in the event of accident, to obtain help and aid the injured.
 - Buildings in which combustible mixtures exist in the atmosphere shall not be entered under any conditions. Personnel shall be warned of the presence of combustible mixtures or low oxygen concentrations (OHSACT). Warning systems such as approved vapour detectors sensors, and continuous sampling devices shall be employed to ensure that the plant environments is safe. The warning and detection devices shall operate audible and visible alarms. These systems shall be designed and installed to allow for the operation of equipment needed to reduce possible hazards.

3.7.4 Signage, Posting and Labelling

- a. Each hydrogen system and control areas must have signage, placards, postings, and labels displayed, so employees shall be aware of the potential hazards in the area. The location of Hydrogen systems shall be permanently placarded as follows:
 - HYDROGEN-FLAMMABLE GAS-NO SMOKING- NO OPEN FLAMES
 - Each portable container shall be legibly marked with the name "HYDROGEN". Each manifold hydrogen supply unit shall be marked with the name "HYDROGEN" such as: "This unit contains hydrogen" (OHSACT; NFPA). Placards must be of sufficient size and colour that they are readily visible to employees entering the work area.
- b. All plant to be fitted with alpha-numeric labelling consistent with the power station plant codification standards for unique identification.
- c. Coding shall be used on all drawings, isometrics, schedules, documents and operating/maintenance manuals.
- d. The identification of contents of pipelines shall be in accordance with 240-114767031 and shall be submitted to Eskom for approval.
- e. Identification shall include colour banding, code by stencilling or labelling and flow direction arrows. Colour coding shall be in accordance with the requirements of SANS 10140 (parts 1 to 4).
- f. All pipework shall be provided with markings, labels or colour coding indicating the contents thereof.

3.7.5 Layout

- a. Separating the components into individual rooms may result in less stringent requirements (as per SANS 10108) being applied to certain areas. Therefore, new plant design shall adopt the principle of physically separating hydrogen generating areas from the control and switchgear i.e. rooms or individual panels or segregated compartments in a container. The hydrogen production areas shall be designed to prevent a confined explosion.
- b. Building design shall take into account of separate compartments suitably laid out for the safe clean storage and handling of potash. The design and layout shall take into account the safe mixing, pumping and loading operations of electrolyte. (Storage may be separate from the Hydrogen plant if preferred by individual stations.)
- c. Doors and other openings shall provide a good seal against the ingress of rain and dirt.

CONTROLLED DISCLOSURE

- d. All emergency exit doors shall open towards the outside and shall be lockable. Emergency exit door "handles" shall be fitted on the inside of the doors fitted to open towards the outside for exiting from the inside.

3.7.6 Safety Showers and Eye Washers

- a. Safety shower and an eye washer shall be provided in the vicinity of the caustic-handling equipment. An eye washer shall also be provided in the vicinity of the electrolyser. Further safety showers and eye washers may be installed if required by power station specific requirements or designer recommendations.
- b. The design of the safety shower or eye washer shall be subject to approval by Eskom.

3.7.7 Ventilation

- a. Ventilation shall be provided such that the requirements of SANS 10108 and SANS 10119 are met. The principles contained in SANS 10119 allows for area classification to be downgraded (from Zone 0 to Zone 2 for example) through the implementation of ventilation systems.
- b. For new generation containerised plant with protection based on the loss of vacuum in the container, the allowable pressure rise (vacuum loss) shall be calculated such that a maximum hydrogen concentration of 0,8 % is not exceeded. This is consistent with the principles contained in SANS 10119 and is 20 % of the explosive limit of oxygen in hydrogen.

3.7.8 Drains

Drain lines and pipes (e.g. condensate, oil and electrolyte) shall be provided. As these are likely to feed to the common station drains, this will require an Environmental Impact Assessment.

3.8 FIRE PROTECTION

Preventive measures against fire shall include automatic or manual process shutdown systems, sprinklers, deluge system, water spray system, dry -chemical and extinguishing systems. The fire safety policy shall be in accordance with the AIA. The unitised hydrogen plant must provide appropriate automatic fire detection and suppression systems for hydrogen systems containing significant hazards.

- a. Portable fire extinguishers (PFE) shall be provided subject to an assessment of the risks with due consideration to type, size, placarding, posting and labelling, physical positioning of PFE in relation to the general arrangement of the plant".
- b. The provision of fixed fire protection systems shall be determined by a suitably qualified / experienced person by a documented Risk Assessment with due consideration as to exposure risks, plant layout and general arrangement using both active and / or passive fire protection measures.
- c. Fire protection may be achieved by passive or active means. Passive being elements of layout and construction that affords a level of inherent protection against fire or exposure to fire (physical barriers, walls, spatial separation). Active protection defined as a fixed fire protection, engineered system usually water based to provide cooling to areas of exposed plant and equipment.
- d. Standard practice for fixed fire protection of receivers and cylinders is a deluge water spray system with medium velocity spray nozzles. The system should be designed to provide water flow rate of 10, 2 L/min/m² each square meter of surface area of the storage vessels as detailed in SANS 10087. All pipes and valves within 2m of the storage vessel should be protected.
- e. There shall be provision to purge pipework with nitrogen or carbon dioxide. Carbon dioxide purging on alkaline electrolyser hydrogen generating plant is not allowed.
- f. For the installation of deluge system along the top of storage areas, the deluge systems should be capable of being manually or automatically actuated. Fire extinguishing systems shall be used to protect manifold piping, relief vents. Deluge system shall be actuated by temperature raised detectors and remote, manual control. Enough hydrant outlets shall be located to enable use of charged hoses at each operation involving equipment in hydrogen service.

CONTROLLED DISCLOSURE

3.9 PURGING

All piping equipment that was filled with hydrogen must be purged with an inert gas before work can commence. The design of the plant must provide for a purging facility and the double block and bleed principle must be applied. Points for administering an inert gas and venting to atmosphere must be provided.

Depending on the application carbon dioxide is the most effective gas medium to reduce the flammability limit. Following carbon dioxide is nitrogen, and is recommended to be used in applications where moisture is present. Helium is a good alternative to nitrogen. The use of argon should be avoided due to being the least effective in reducing the flammable range.

All hydrogen production plants shall be fitted with automated nitrogen purging systems. Nitrogen purging shall be done following any safety trip. The availability of the nitrogen purging system to perform an emergency purge must be monitored and alarmed and a facility to replenish the nitrogen without interrupting the connected nitrogen supply must be provided.

3.9.1 Carbon dioxide purging and Cylinders

Carbon dioxide purging is required to degas the generator before maintenance activities or in the case of an emergency. Carbon dioxide is used for generator purging as 60% carbon dioxide diluent of the generator volume is required in order to dilute an equal concentration Hydrogen air mixture out of the flammability region.

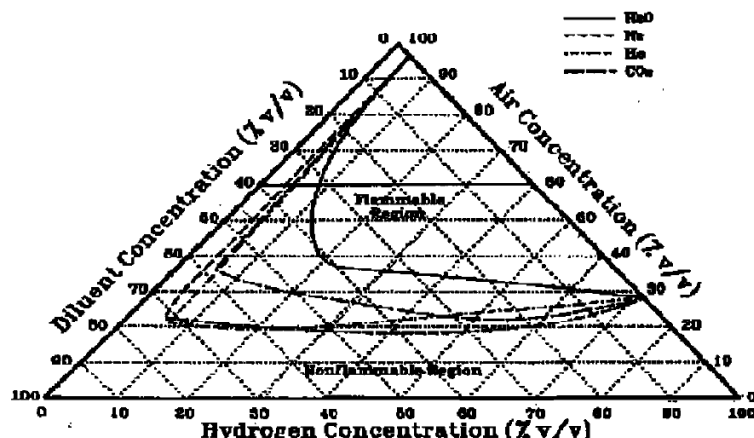


Figure A2.2 — Effects of N_2 , H_2 , and CO_2 diluents at 298 K (77 °F), and H_2O diluent at 422 K (300 °F) on flammability limits of hydrogen in air at 101.3 kPa (14.7 psia) (Coward and Jones 1952; Jones and Perrott 1927; Coley and Field 1973)

Figure 1: Hydrogen Concentration

The following are the purging requirements:

- Sufficient carbon dioxide cylinder supply must be connected to each generator to replace the entire volume of hydrogen inside the generator twice. Each carbon dioxide cylinder holds 22,6kg of gas in liquid form, equivalent to 11,4m³ at NTP, and is used for purging hydrogen and air from the generator.
- Carbon dioxide admission to the generator must be from the bottom of the generator and displacement of hydrogen and air from the generator casing at the highest point on the generator casing.
- During displacement of carbon dioxide in the generator the hydrogen admission must be from the highest point on the generator casing and venting of carbon dioxide from the lowest point on the generator casing.

CONTROLLED DISCLOSURE

- d. On-line gas analysing of hydrogen, carbon dioxide and oxygen.
- e. Purging of the entire generator within 30 minutes.
- f. Carbon dioxide purging station must be accessible and operable in the case of an emergency or fire. As an alternative remote operation of vent valves and initiation of the carbon dioxide purge via a control system.
- g. All pipework, valve and fittings must be rated 1,5 times the MAWP.
- h. Venting of all gasses through a water seal or flashback arrestor.
- i. Siphon tube fitted carbon dioxide cylinder must be used and an evaporator must be utilised to prevent freezing of the cylinder valves and piping, to ensure adequate purging rates with carbon dioxide in an emergency. The evaporator shall ensure a minimum of 30 minutes of purging without availability of power supply.

3.9.2 Nitrogen purging

- a. Nitrogen is an effective medium to purge pipe lines and systems and does not create carbonic acid in a moisture environment.
- b. A nitrogen purging facility must be provided as an integral part of the Hydrogen Generating plant and the control system must identify the requirement for a purge and monitored that such a critical safety activity was done before the plant can start hydrogen production. It is preferred that this be fully automated or require limited manual intervention. The nitrogen used for purging must have a purity better than 99,5% with the oxygen content less than 0,5%. The dew-point of the nitrogen gas must be better than -50 °C at NTP. This is essential for the start-up of the hydrogen generating plant from an inert gas purged state.
- c. Nitrogen may be used as an alternative purging medium, provided it is approved by the generator original manufacturer. The generator casing must be purged to 70 % dilution within 30 minutes and an analyser to monitor 70 % diluent must be provided.

3.9.3 Air purging

- a. Quality of air being used for purging the inert gas from the generator must be ensured and monitored at the point of admission to the generator.
- b. The quality of air that is introduced for purging of the generator must have a dew point of -20 °C at normal pressure (700 kPa).

3.10 HYDROGEN AND HYDROGEN FIRE DETECTION

3.10.1 Hydrogen Detection

The system design must ensure that detection occurs instantaneously and operating personnel are notified immediately, if hydrogen leaks into the atmosphere or a hydrogen fire occurs. A hydrogen detection system must be compatible with other systems such as those for fire detection and fire suppression. The detection units must be suitably rated, to prevent ignition of flammable mixtures. The detection signal must actuate warning alarms and automatically effect shutdown whenever practicable.

3.10.2 Hydrogen Detection Specifications

- a. Detection and alarm at 1 % by volume hydrogen concentrations in air, equivalent to 25 % of the low flammable limit (LFL), is required for enclosed areas in which Hydrogen build-up is possible.
- b. Detection and alarm at 0,4 % by volume hydrogen concentrations in air (equivalent to 10 % of the LFL) is required for permit-required confined spaces (OHSACT).
- c. A 1 % by volume hydrogen concentration at any point 1 m from the hydrogen equipment should generate an alarm in areas around hydrogen facilities.
- d. Specification for hydrogen sensors should include requirements for the following:

CONTROLLED DISCLOSURE

- Minimum gas concentration detection requirements
- Full-scale range of the detector system
- Level of concentration for which alarm detection is required
- Response time of the detector system
- Accuracy of sensors
- Drift of the analyser
- Reliability and recalibration frequency
- Interface to facility safety and shutdown systems
- Analyser principle of operation adequate for the application CGA G-5.3, Commodity Specification for Hydrogen

Use gas chromatography, which has parts-per-billion-by-volume capability, for the detection of hydrogen in purged lines and vessels through the use of samples collected in sample bottles.

3.10.3 Hydrogen fire detection systems

- a. A fire detection system must be capable of detecting, at a minimum distance of 4,6 m the flame from the combustion of 5,0 l/min of Hydrogen at NTP flowing through a 1,6 mm orifice to produce a 20 cm high flame. For a potential release of a large volume of hydrogen, sensors with the ability to detect flames at distances greater than 4,6m must be used to provide coverage over a large area.
- b. The fire detection should not be susceptible to false alarms from the sun, lightning, welding, lighting sources and background flare stacks.
- c. The fire detection systems response time should meet the requirements for the specific application for prevention of loss of facility, equipment and protection of personnel.
- d. Fixed systems are required for continuous monitoring of remote operations, and portable systems are required for field operations.
- e. Special imaging systems are required for determining the size and location of a flame for assessment of the hazard because hydrogen is not visible during daylight conditions. Use thermal protect-o-wire, temperature sensors, and UV-only optical fire detectors for transfer systems.

3.11 PROTECTIVE MEASURES FOR SLIPRINGS AND COUPLED EXCITERS

- a. If the exciter or slip rings are situated in a housing into which hydrogen may leak, the accumulation of an explosive hydrogen-air mixture must be prevented, e.g. by maintaining a flow of air through the enclosure.
- b. The flow can usually be produced while the shaft rotates at normal speed, but additional means may be needed when the machine contains hydrogen and the shaft is stationary or rotating slowly or if an exhaust duct is not provided to vent hydrogen leakage through natural convection and buoyancy. If local fans are used to ensure ventilation, their motors shall have a type of protection for flammable gas atmospheres in accordance with IEC Publication 79.
- c. Hydrogen leak and fire detection must be installed in the enclosure.

3.12 MECHANICAL PLANT

- a. Key design requirements for the hydrogen generating plants are:
 - Safe operation shall be assured at all times.
 - Simplicity and reliability.
 - Measuring equipment and analysers must be installed to identify the production of a potentially explosive mixture and prevent it from being stored.
 - Automatic, unattended operation, insensitive to power interruptions. In the event of a power interruption, the plant shall revert to a safe condition and hydrogen vented.
 - All components suitable for use with hydrogen, and classified accordingly.
- b. The production facility shall preclude the possibility of the oxygen and hydrogen forming an explosive mixture.

CONTROLLED DISCLOSURE

- c. For electrolyzers operating at atmospheric pressures, a water safety seal shall be provided and installed between hydrogen production (electrolyser) and reticulation gas holder storage.
- d. All vents shall be routed to the outside of the building and positioned such that free dispersion of hydrogen is ensured.
- e. All gas vent lines to atmosphere shall flow through a water seal or be fitted with a flashback arrestor normally low pressure rated to maximum 500 kPa hydrogen gas.
- f. All water seals shall be designed for the maximum flow possible, ensuring that a sudden release of gas does not break the seal.
- g. All water seals shall be installed with automatic level control (e.g. float valve) and monitoring. Where level control is not automated, there shall be a continuous overflow with monitoring carried out.
- h. Any equipment installed, that introduces a risk of air entrainment, must be fitted with on-line monitoring equipment that will automatically react if an unsafe condition occurs.
- i. If a gas holder is used:
 - The gas holder's water seal shall be designed to fulfil the requirements of the output of the plant.
 - Precautions shall be taken to prevent corrosion of the gasholder.
 - The gas holder shall be designed for unrestricted movement.
 - The gas holder shall be fitted with low pressure monitoring.
 - At least one low-level proximity switch shall be provided on the gasholder as a backup to the fixed limit switches. The preferred proximity switches are the type where a magnet is fitted to the gas holder bell and reed type switches for high-high, high, low and low-low are fitted to fixed positions adjacent to the bell.
 - The gas holder water safety seal shall be fitted with a low-level monitor that initiates a rectifier trip or ensures that a safe plant condition is reverted to.

3.13 HYDROGEN STORAGE

3.13.1 Bulk storage

3.13.1.1 Vessels

- a. Bulk storage vessels shall be provided for the specified capacity.
- b. Pressure reduction, downstream of the storage vessels, shall be provided to reduce the pressure to the required reticulation pressure.
- c. The vessels shall be arranged and inter-connected in such a way that they may be taken out of service individually for periodic statutory inspection and put back into service, with minimum loss of hydrogen from the rest of the system. For pressure tests, vessels shall be completely isolated (disconnected) from the rest of the system. The facility for purging the vessel prior to and following pressure tests shall be provided.
- d. Vessels shall be individually filled and individually used.
- e. Isolating valves and non-return valves shall be fitted to the inlet and outlet of each vessel to ensure individual vessel isolation and prevent pressure equalisation between vessels.
- f. Valves shall allow for isolation without interfering with adjacent equipment and to prevent the inadvertent cross contamination of hydrogen and air filled vessels by operators and maintenance personnel.
- g. Pressure regulators at the station main and at each generator shall be provided. Each pressure regulator shall be followed by dual independent pressure relief devices.
- h. Excess flow shut-off valves shall be provided at the bulk storage outlet that is required to protect against the consequences of any possible pipe fracture or major leak. The excess flow shut-off valves and system design as a whole shall be designed to allow the normal demand of gas flow without shutting off the supply, but shall shut off the gas flow when demand exceeds the normal flow

CONTROLLED DISCLOSURE

by 20%. Or the excess flow shut off valve must be set at the dumping rate of the generator safety valve.

- i. Facilities for nitrogen or carbon dioxide purging shall be incorporated. Use of drain and vent valves shall be acceptable for purging when no alternatives are in place.
- j. Provision for the purging of vessels shall be as follows:
 - Where there is a single inlet/outlet, purging shall be by means of evacuation and filling with an inert gas.
 - Where separate inlet and outlets are installed, purging shall be by means of positive displacement.
- k. The vessels shall be manufactured in accordance with BS EN 13445 and PD 5500. The design temperature range is -10 °C to 50 °C.
- l. All pipe connections to the pressure vessels shall be in accordance with ASME B16.5. Piping between vessels shall be provided with manifolds and non-return valves so arranged that cross-vessel transfer of hydrogen, including equalisation of receivers, cannot be achieved.
- m. All manually operated valves that can lead to air contamination of hydrogen or hydrogen venting directly into atmosphere shall have lockable handles and be fitted with locks under the control of the "permit to work" system.
- n. It is preferred that all new storage vessels shall be horizontally installed.
- o. Hydrogen shall not be supplied to the bottom of the bulk storage vessels and nor shall hydrogen be delivered to generators from the bottom of the bulk storage vessels. This is to prevent corrosion particles and other impurities such as moisture accumulated over a long period of time from being fed into the reticulation system.
- p. Filling of the storage vessels will be automated, based on a filling philosophy to optimise cell stack life and meeting the requirements of minimum hydrogen availability. The receiver filling and hydrogen production philosophy must be based on the volume of hydrogen calculated from the known volume of storage vessels and pressure measured.
- q. A metering station after bulk storage must be fitted to reduce pressure to reticulation pressure and measure pressure, dew point and mass flow into the reticulation system. The mass flow, pressure and dew-point must be trended and data stored as a minimum for a moving 30 day period at a sampling rate of at least once every minute.
- r. The ambient temperature for the design of the bulk storage vessels, valves and equipment is -20°C to +50°C.
- s. All bulk storage vessels shall be fitted with a sun-shield. The sun shield design must be such that a fire spray system can cool down the surface of the vessel.

3.13.2 Hydrogen cylinder supply

- a. A hydrogen bottle bank of eight cylinders with a weight of 12.78kg each will be installed inside the power plant for topping up the generator when the bulk supply system is unavailable. A maximum number of two cylinders can be opened simultaneously to limit the hydrogen that can leak into the vicinity. Connecting fittings shall be configured so that it is physically impossible to cross-connect incompatible systems without malicious intent to do so.
- b. The high pressure line from the cylinder feed must be protected with an automatic emergency isolating valve, which is required to protect against the consequences of any possible pipe fracture or major leak.
- c. An inert gas purging and venting facility (block-and-bleed valve arrangement) must be provided between two isolation points. This includes the connection between each cylinder to the reticulation system. An isolation facility between each cylinder and the reticulation system must be provided to ensure that each cylinder can be individually isolated and replaced.
- d. The high pressure reticulation line must be protected with a non-return valve as well as each cylinder connected to the reticulation system.
- e. Line pressure indication must be provided on all lines between two isolation points.

CONTROLLED DISCLOSURE

- f. The low pressure side, after pressure reduction, must be protected by a safety valve rated to dump the maximum amount of hydrogen from the source, without allowing the generator casing pressure to increase above the maximum allowable working pressure.
- g. As a minimum all hydrogen cylinders must comply with the relevant ISO standards.

3.13.3 Hydrogen cylinder pallets

- a. Unless fully compliant to the above for hydrogen cylinder supply, a hydrogen cylinder pallet cannot be utilised inside the power generating plant.
- b. The high pressure line from the hydrogen cylinder pallet feed must be protected with an automatic emergency shut-off valve, which is required to protect against the consequences of any possible pipe fracture or major leak.
- c. An inert gas purging and venting facility must be provided between two isolation points. This includes the connection between each hydrogen cylinder pallet to the reticulation system.
- d. The high pressure reticulation line must be protected with a non-return valve as well as each cylinder connected to the reticulation system.
- e. Line pressure indication must be provided on all lines between two isolation points.
- f. The low pressure side, after pressure reducing, must be protected by a safety valve rated to dump the maximum amount of hydrogen from the source, without allowing the generator casing pressure to increase above the maximum allowable working pressure.

3.13.4 Mobile hydrogen supply

- a. Mobile hydrogen supply units shall be electrically bonded to the system before discharging hydrogen.
- b. All off loading facilities shall provide easily accessible grounding connections and be located outside the immediate transfer area. Facility grounding connections should be less than 10 ohm resistance.
- c. Transfer subsystem components should be grounded before subsystems are connected.
- d. Electrical wiring and equipment located within 0,9 m of point at which connection are regularly made and disconnected shall be in accordance with Zone 2 classified location.

3.14 PIPING SYSTEMS

3.14.1 Piping systems

- a. Piping systems for hydrogen use shall be designed based on the most severe condition of coincident pressure, temperature and loading. Special consideration shall be given for the unique properties of hydrogen, such as hydrogen embrittlement. The most severe condition shall be the requirement that results in the greatest required pipe thickness and highest flange range rating. These include:
 - pressure relief valves
 - valves
 - filters
 - fittings
 - gaskets
 - Hydrogen pipe linesIt also includes hangers and supports and other equipment items necessary to prevent overstressing and vibration of pressure-containing components. Safety reviews of piping systems designs shall be in accordance with those detailed in Sections 4.1 and 4.2 in ANSI/AIAA G-095-2004. Materials used in the designs of piping should be in accordance with BS EN 13480. Piping and pressure-containing components shall be pressure tested.
- b. Facility and transfer piping systems shall include safeguards in according with ASME B31.3 for protection from accidental damage and for the protection of people and property against harmful consequences of vessel, piping and equipment failures. Within a process area, hydrogen transport

CONTROLLED DISCLOSURE

piping shall be treated similar to hydrogen storage in that all such piping shall be isolated by an exclusion zone in which access is restricted and certain types of operations are prohibited while hydrogen is present in the piping system.

- c. New piping for hydrogen shall not be buried. Piping shall be placed in open trenches with removable grating if placed below ground. All piping shall be periodically pressure tested and recertified. The piping and components shall be tagged and coded as described in ANSI/AIAA G-095-2004-Section 4.10.
- d. Hydrogen piping that is installed in cable tunnels etc. must be monitored for hydrogen leakage and fire detection. Alternatively they must be protected by an inert gas "blanket" at higher pressure than the hydrogen.
- e. Sufficient grounding connections should be provided to prevent any measurable static charge from accumulating on any component. Each flange should have bonding straps in addition to metal fasteners, which are primarily structural.
- f. Joints in piping should be made by welding. Mechanical joints such as flanges should only be used for ease of installation and maintenance. Provisions shall be made for the expansion and contraction of piping connected to limit forces by providing substantial anchorage at suitable points, so there shall be no undue strain to the piping.
- g. All pipework, valve and fittings must be rated 1,5 times the maximum operating pressure.
- h. Special consideration shall be given for the Joule-Thompson effect when the carbon dioxide expands to prevent freezing of valves and piping.

3.14.2 Supports

The design of piping support members shall account for all concurrently acting loads transmitted into such supports. All supports and restraints shall be fabricated from materials suitable for the service conditions. Any attachments welded to the piping shall be compatible with the piping material and service conditions.

3.14.3 Piping for hydrogen

- a. Materials for hydrogen piping systems and components must be suitable for the stress, temperature, pressure and exposure conditions. Conditions considered to characterise hydrogen embrittlement failures include temperature, pressure and hydrogen purity.
- b. High-pressure gas manifolds shall be constructed of suitable and of welded construction wherever possible. Expansion or contraction should be looked at and adequate supports shall be provided.

3.14.4 Bending and forming piping

- a. Pipe may be bent to any radius that will result in arc surfaces free of cracks and substantially free of buckles. Flattening of a bend, as measured by the difference between the maximum and minimum diameters at any cross section, shall not exceed 8% of the normal outside diameter for internal pressure and 3% for external pressure.
- b. Piping components may be formed by any suitable hot or cold working method, provided such processes result in formed surfaces that are uniformed and free of cracks or other defects. The various piping components should conform to the specified requirements of the engineering design.

3.14.5 Double block-and-bleed

A double block-and-bleed arrangement to isolate supplies from other parts of the system must be implemented, including on inert gas purging and venting facility. A doubleblock-and-bleed arrangement as shown in Figure 1 below is a positive way to ensure that hydrogen leaking through a shutoff valve does not enter other parts of a system where it is not desired.

CONTROLLED DISCLOSURE

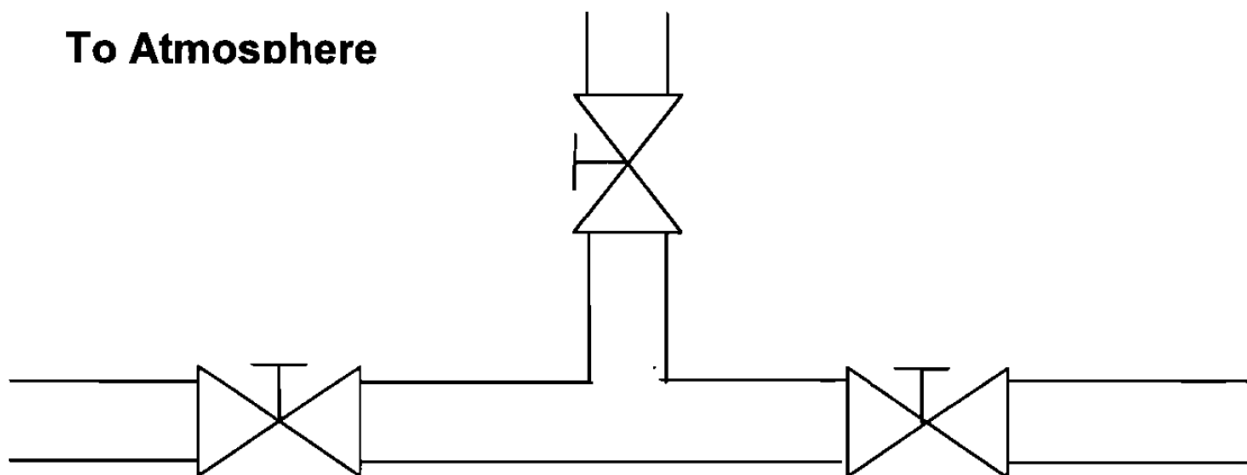


Figure 2: Double Block-and-Bleed Arrangement

3.15 COMPONENTS

3.15.1 Joints in piping and tubing

- Welding is the first preference for all hydrogen systems and it shall be as the Eskom Welding standard 240-56241933.
- Joints in piping and tubing may be made for H₂ by welding or brazing or using flanged, threaded, socket or compression fittings. Brazing materials shall have a melting point above 538 °C (NFPA). The fused joint is recommended in hydrogen systems because of its simplicity and high reliability. Hard soldering and welding often can meet the bonding requirements, but the welded joint takes preference for safety (OHSACT).
- For every Eskom weld construction Project, the Eskom approved inspection authority (AIA) is tasked to verify legislative compliance of the plant with regulations contained in the OHS-Act and PER. The Contractors are responsible for welding done by their personnel. The contractor having authorisation must also approve and accept a performance qualification made by a welder or welding operator for another employer. If approval is given, acceptance is limited to performance qualification on piping using the same or equivalent procedure wherein the essential variables are within the limits set forth in ASME BPVC Section IX and ASME B31.3.
- Tube fitting of flared or compression type may be used for tube sizes not exceeding 5.1 cm outside diameter within the limitations of applicable standards.

3.15.2 Threaded joints

National pipe thread (NPT) and similar threaded joints with a suitable thread seal are acceptable for use in hydrogen systems. Consideration should be given to back-welding threaded joints for hydrogen systems inside buildings.

3.15.3 Flanged joints

- In cases where welded joints are not desirable it can be replaced with flange connections. Flanged joints with radially compressed seals, such as Grayloc, Reflange R-Con or E-Con type flanges and seal rings are acceptable. Flanges with dual seals and inter-seal vent ports are recommended in applications where leakage may be induced by system thermal expansions.
- An earth loop connection of minimum 6mm² must be fitted across the flanged connection.

CONTROLLED DISCLOSURE

3.15.4 Silver braze joints

The choice of braze composition is determined by ease of application to the material to be joined; however, cadmium containing silver brazes shall not be used. Silver brazes are recommended for joining copper-base materials and dissimilar metals such as copper and stainless steel. The melting point must be greater than 538 °C.

3.15.5 Soft solder joints

Soft solder joints are not permissible in hydrogen systems.

3.15.6 Pipe connections

- a. The designer shall determine that the type and the material of the fitting selected is adequate and safe for the design conditions in the absence of standards, specifications or allowable values for the material used to manufacture the fitting.
- b. Greater flexibility should be provided in designs of small branches out of large and heavy runs, to accommodate thermal expansion and other movements of the larger line. Branch connections should be made in piping systems as followings:
 - Fittings (tees, laterals and crosses) should be made in accordance with standards procedures.
 - Outlet fittings should be welded.
 - The branch pipe may be welded directly to the run pipe or without reinforcement.
 - Extruded outlets in the run pipe, at the attachment of the branch pipe, should be butt-welded.

3.15.7 Flanges

Flanges should be designed and manufactured in accordance with ASME B16.5. Flanges using a soft gasket should use a raised-face flange with a concentrically serrated face.

3.15.8 Flexible hoses

- a. Flexible hoses pressurised to greater than 1,14 MPa should be restrained at intervals not to exceed 1,83 m and should have an approved restraint device such as the Kellems hose containment grips attached across each union or hose splice and at each end of the hose. The restraint devices should be secured to an object of adequate strength to restrain the hose if it breaks.
- b. Hose containment methods and devices that differ from standard devices should be approved by the AIA.
- c. Only crimped clamps may be used on any hoses.
- d. ISO standard gas cylinder connections must be fitted to the end of the flexible hose.
- e. Flexible hoses shall have electrical continuity to earth through the length of the hose from both end connections or shall have a bonding strap along the length of the hose.

3.15.9 Expansion joints

- a. Bellows expansion joints used in hydrogen piping systems may be convoluted or toroidal and may or may not be reinforced. Lap-welded tubing should not be used.
- b. A fatigue life able to withstand the full thermal motion cycles is a design requirement, but the life of the bellows should not be less than 1000 full thermal movement and pressure cycles in any case (ASME B31.3).
- c. Expansions joints shall be marked to show the direction of flow. Flow liners should be provided when flow velocities exceed the following values:
 - Expansion joint diameter less than or equal to 15,2 cm: gas flow velocity of 48 m/s per m of tube diameter
 - Expansion joint diameter greater than 15,2 cm: gas flow velocity of 300 m/s per m tube diameter

CONTROLLED DISCLOSURE

- d. An expansion joint must be installed in a location that is accessible for scheduled inspection and maintenance.
- e. Pressure test of piping systems shall be performed with the bellows expansion joint installed in the line with no additional restraints so the expansion joint cross connections or external main anchors carry the full pressure load. Test should not be performed until all anchors and guides are securely in place.

3.15.10 Valves

- a. Valves for gas service in a hydrogen environment shall comply with the requirements of the Compressed Gas Association (CGA) of America — CGAG-5.4 or equivalent such as
 - European Industrial Gas Association; and
 - British Company Gas Association.
 - South African National Standards
- b. Valves shall have factory certification of hydrostatic pressure tests and details of leak tests carried out using hydrogen or helium as the leak test medium.
- c. Test certificates stating compliance with the specification, for all valves, shall be available on site.
- d. All valve and fittings must be rated 1,5 times the maximum operating pressure.
- e. Valves identified by Eskom to form part of the permit to work system shall be lockable valves to accommodate a 8mm padlock.

3.15.10.1 Excess Flow Valves (EFVs)

- a. EFVs for gaseous hydrogen service must be self-actuated devices that shut-off flow when the built-in sensing mechanism detects that the flow exceeds the pre-set flow value.
- b. The normally actuated valve to open the hydrogen supply feed should not cause an operation of the EFV and must be designed or selected as a gradually opening valve. EFV installed to provide an immediate hydrogen supply shutoff in the event of gas line or component failure, must have a manual reset facility.
- c. EFV installed in-line with pressure gauges on hydrogen lines must have an automatic reset facility.
- d. This is normally achieved via a small leakage that equalise pressure across the EFV.

3.15.10.2 Emergency Isolation Valves (EIVs)

- a. Emergency isolation valves capable of full closure without leakage must be provided that are readily accessible to stop hydrogen flow.
- b. EIVs should be installed before branch or multiple distribution lines feed different facilities or to isolate all hydrogen feeds to the generator. EIVs must have a metal-to-metal seat or a metal to metal backup of a soft-seated valve for positive shut-off.
- c. A block-and-bleed valve arrangement is acceptable as an emergency isolation point.
- d. All EIVs shall have a fail-close operation and may be operated remotely or locally.

3.15.10.3 Isolating Valves

- a. To allow for maintenance activities and emergency response, isolation valves are required. An isolation valve shall be installed at an accessible location in the gas line so that flow can be shut off when necessary.
- b. The high pressure line from the cylinder feed must be protected with an automatic emergency isolating valve, which is required to protect against the consequences of any possible pipe fracture or major leak. A double-block-and-bleed arrangement is a positive way to ensure that hydrogen/carbon dioxide leaking through a shutoff valve does not enter other parts of a system where it is not desired.

CONTROLLED DISCLOSURE

3.15.10.4 Gas Cylinder Valves

- a) The valves fitted to the individual gas cylinders must be of a screw down complying with the relevant ISO standard.
- b) The valve material must also comply with the relevant ISO standard compatible with the gaseous medium.
- c) Carbon dioxide cylinder valves shall be fitted with siphon tubes to facilitate rapid gas discharge.

3.15.10.5 Non Return Valves (NRVs)

- a. The high pressure reticulation line must be protected with a non-return valve as well as each cylinder connected to the reticulation system.
- b. Each individual hydrogen cylinder connection to the manifold must be protected with a non-return valve.
- c. Swing-type and lift type NRVs are recommended for 2.54cm nominal and larger sizes. Poppet-type NRVs are recommended for 2.22cm and smaller.

3.15.11 Gauges

- a. The pressure gauges shall be the Bourdon type or intrinsically safe pressure transmitters for a hydrogen environment application.
- b. The gauge graduation shall be 50 kPa minimum for the storage vessels and 0,5 kPa minimum for the atmospheric electrolyser.
- c. The gauge pressure rating shall be 150 % to 200 % of the anticipated maximum allowable working pressure (MAWP).
- d. The gauge face shall be a minimum of 100 mm diameter for gauges not more than 2, 5 m above ground and 150 mm diameter for gauges more than 2,5 m above ground level.
- e. Each gauge shall be clearly marked on the face with a red line which indicates the relevant system section maximum allowable working pressure level.
- f. All gauges shall have blow-out protection and excess flow shut-off to minimise the release of hydrogen should there be a rupture of the gauge. Gauges shall have pulsation compensators where required.
- g. All gauges will be fitted with safety glass.

3.15.12 Hydrogen venting

- a. All vents shall be routed to the outside of the building at the highest point and positioned such that free dispersion of hydrogen is ensured away from any possible ignition sources. The hydrogen and the oxygen vent lines shall be at least 2m apart. All gas vent lines to atmosphere shall flow through a water seal or be fitted with a flashback arrestor, normally low pressure rated to maximum 500 kPa hydrogen gas.
- b. The vent line must have a minimum diameter equal to the critical tube diameter. Critical tube diameter (Dcrit): The maximum tube diameter, for a specific pressure, that will prevent hydrogen flame propagation within the tube. $D_{crit} = 13 A$, where A is the cell size and has a value of 1cm at atmospheric pressure (i.e. $D_{crit} = 13$ cm for atmospheric vent pipes).
- c. All water seals shall be designed for the maximum flow possible, ensuring that a sudden release of gas does not break the seal. Hydrogen venting from the generator casing down to 80kPa gauge, must be achieved within 10 minutes when inert gas purging is initiated. The generator seal oil minimum pressure requirements must be considered when this test is conducted.

3.15.13 Transfer connections

Interlocking between purging the generator with hydrogen or air must be incorporated in order to prevent air being introduced to the generator while filled with hydrogen or vice versa.

CONTROLLED DISCLOSURE

3.15.14 Compressor machines

Where high pressure compression is required for bulk storage of the produced hydrogen gas:

- a. Duplicate compressors shall be installed, with controls to select either one for operating or as standby. Each compressor shall be rated to continuously handle the full capacity of the plant and specifically designed to handle wet hydrogen containing traces of lye. (Note: when ordering spares for compressor plant, it is essential to specify that the components are for hydrogen plant compressors as they may be susceptible to degradation by wet hydrogen containing lye).
- b. Compressors shall be single or multistage with inter-stage cooling, and after-cooling provided after the final stage of compression.
- c. Compressors shall be fitted with condensate blow down mechanisms between each stage to prevent inter-stage build-up of condensate and damage to compressors. In all cases, this blow-down shall be vented through a water seal. It is preferred that a condensate trap be installed and draining of accumulated condensate will be done with level control, avoiding venting of hydrogen due to over-draining. For automated blow-down, the condensate trap must be fitted with low-low level monitoring which will disable compressor starting. For manual blow down, an appropriate works-instruction shall be in place to avoid release of hydrogen.
- d. Compressors shall be supplied with safety valves at each stage and on the final outlet which will be piped to the outside of the building and away from oxygen vents. Safety valve settings shall be in accordance with OHS Act requirements.
- e. A condensate/oil drain line shall be fitted to the compressors leading to a recovery sump in an accessible location in accordance with the power station's policy on effluent recovery and treatment.
- f. The suction lines to the compressors shall be designed to avoid the pressure on the suction side of the compressor to decrease below atmospheric pressure. It will be permitted for the design of the suction line to incorporate a condensate trap to prevent pressure swings. If the volume of the supply line is higher than the volume of gas that the compressor is able to take in during suction stroke this will not occur.
- g. An interlock must be installed to ensure that the selected compressor will not start if the appropriate suction valve is closed so as to prevent any oxygen ingress to the receivers or storage facility.

3.15.15 Hydrogen dryers

- a. A dryer system (a redundant dryer system applicable for atmospheric electrolyzers) shall be installed immediately after compression and before storage. These dryer systems should be common for any one of the compressors.
- b. Dryers shall be able to handle the quantity and quality of gas being produced and ensure safe plant operation.
- c. Desiccant dryers shall be acceptable subject to the requirements below.
 - Dryers shall be fitted with filters to remove particles and oil.
 - Oil and condensate off-loading will not be done directly to atmosphere. The block-and-bleed principle shall be applicable to these systems. The drain outlet shall be fitted with liquid level detectors.
 - The liquid level shall be monitored and alarmed.
 - The installed dryers are capable of continuous drying without the need to halt production for regeneration of the drying medium and are compatible with the operating philosophy of the compressors.
 - Automated condensate off-loading systems shall be closed off from the main supply before the condensate/oil is drained. Monitoring of a passing valve shall be provided.
 - The installed dryers are capable of continuous drying without the need to halt production for regeneration of the drying medium.
 - Hydrogen velocity through the desiccant bed does not cause fluidization of the bed.

CONTROLLED DISCLOSURE

- The contact time between hydrogen and desiccant is sufficient to dry 100 % saturated inlet hydrogen to the specified dew point.
- Sufficient desiccant is provided so as to negate the effects of desiccant ageing (normally a 30 % loss of effectiveness).
- The desiccant must be compatible with the elements in the process for example KOH and oil, or the process specifically designed to protect the desiccant from oil or KOH contamination.
- Dryer regen condensate must be drained into the drainage system and may not be recycled back into the cell stack.
- Chamber blow downs shall be through a water seal or flashback arrestor.
- Ceramic or metallic cartridge type filters are installed to filter out impurities down to 1ppm or better in the compressed hydrogen.
- All dryer chambers must be fitted with a heating element.
- In the case of regeneration, the heating cycle must be interlocked with minimum flow through the chamber. The temperature of the heating element must not exceed 300 °C.
- A de-oxidiser must be fitted to remove oxygen as part of the gas drying unit. The gas must be heated to a value which will ensure optimum operation of the catalyst. The catalyst must be protected from moisture contamination. Sufficient catalyst must be provided to absorb 0,5 % oxygen continuously for a minimum of one year at full production of the hydrogen generating plant. Gas cooling and liquid separation must be provided after deoxidizer before gas drying. Gas temperature at the inlet and outlet of the deoxidizer must be provided with alarming facility to unit control desk.
- The dryer vessel design must be such that the desiccant and catalyst can be changed without requiring replacement of the vessel or mechanical intervention that will require recertification thereof. A specific access must be provided to remove and replace the desiccant or catalyst.

3.15.16 Generator hydrogen dryers

- a. The gas dryer must be dimensioned for a test pressure of 1000 kPa gauge. Valves shall be interlocked, so that the gas dryer is associated either with the generator for drying operation, or with the blower and the blow-off line for regeneration purposes. Dryer status indication must be provided.
- b. All dryer chambers must be fitted with a heating element and a blower.
- c. In the case of regeneration, the heating cycle and blower must be interlocked that the heating cannot be operated without ventilation. The temperature of the heating element must not exceed 300 °C.
- d. The interlock between the heating cycle and the blower of the gas dryer, and the limitation of the heating element temperature, is to prevent the heating resistor from reaching the ignition temperature of a hydrogen-air flammable mixture that can occur if the heater element was not cooled by flow from the blower while switched on. The blower must be switched on before the heater element.
- e. Dryers shall be able to handle the quantity and quality of gas to ensure that the hydrogen dew point is improved with 5 °C at NTP over a 24 hour cycle, taking into consideration hydrogen contamination from the seal oil system to a value of -30 °C at NTP.
- f. Dryers shall be fitted with filters to remove particles and oil down to 1ppm or better.
- g. Block-and-bleed isolation arrangement must be supplied before and after hydrogen dryer, without isolating gas quality measurement while generator is on load.
- h. A de-oxidiser can be fitted to remove oxygen as part of the gas drying unit. The gas must be heated to a value which will ensure optimum operation of the catalyst. The catalyst must be protected from moisture contamination. Sufficient catalyst must be provided to absorb 0,5 % oxygen continuously for a minimum of one year at full production of the hydrogen generating plant. Gas cooling and liquid separation must be provided after deoxidizer before gas drying. Gas temperature at the inlet and outlet of the deoxidizer must be provided with alarming facility to unit control desk.

CONTROLLED DISCLOSURE

- i. Oil and liquid off-loading shall not be done directly to atmosphere. The block-and-bleed principle shall be applicable to these systems.
- j. The liquid level shall be monitored and alarmed.
- k. The dryer vessel design must be such that the desiccant and catalyst can be changed without requiring replacement of the vessel or mechanical intervention that will require recertification thereof. A specific access must be provided to remove and replace the desiccant or catalyst.

3.15.17 Condensate traps

- a. In addition to condensate off-loading on the compressors, condensate traps shall be installed on the suction line of compressor.
- b. Volume of condensate should not exceed the capacity of the trap. If necessary multiple traps should be installed. Needs to act as a buffer and remove condensate from gas.
- c. Discharging of condensate traps shall be as described in the section of condensate traps.
- d. All traps and bypasses shall be piped to the respective power station drainage sumps via the local pipeline.

3.15.18 Cooling water systems

- a. Materials making up the cooling water system shall be suitable for the power station water quality. Materials shall be corrosion-resistant and of low carbon content. The use of aluminium is not permitted.
- b. The cooling system on all electrolyzers shall be a closed loop system preferably demineralised system. A common sump accumulating electrolyte overflow, water-seal overflow and/or gasholder overflow is not permitted as potassium hydroxide is introduced.
- c. The cooling water piping to hydrogen generating plant will be part of a large closed loop system and shall be designed to avoid electrolyte contamination at all times.

3.16 OVERPRESSURE PROTECTION OF STORAGE VESSELS AND PIPING SYSTEMS

3.16.1 Safety Valves

- a. The relief or safety valves shall be set to limit the maximum pressure to not exceed the MAWP. The low pressure side, after pressure reducing, must be protected by a safety valve rated to dump the maximum amount of hydrogen from the source, without allowing the pressure to increase above the maximum allowable pressure.
- b. Safety and relief valves should be direct spring or deadweight loaded. Pilot valve control or other indirect operation of safety valves is allowed if the design is such that the main unloading valve automatically opens at the set pressure or less and is capable of discharge at its full rate capacity if the pilot or auxiliary device should fail.
- c. All safety valves must be fitted upright with the high pressure entry from the bottom.

3.17 PRESSURE REGULATOR

- Cylinders should have a regulator and pressure gauge. Regulators should be non-venting or have the vents piped to atmosphere through a flashback arrestor to a safe location. All regulators shall be fitted adequate in-line filters.
- Mechanical shielding should be provided for regulators to protect them from mechanical damage.
- The regulators shall be designed for the specific application.
- The regulator delivery gauge range should be approximately 2 times the operating pressure and at least 1.5 times the MAWP.
- Following the installation of a pressure regulator the downstream system shall be protected with a pressure safety valve as per CGA G-5.6, Hydrogen Pipeline Systems.

3.17.1 Supplemental pressure relief

Supplemental pressure-relief devices must be installed to protect against excessive pressure created by exposure to fire or other unexpected sources of external heat. Relief devices installed in any section of the vessel and piping systems limit the allowable working pressure. The supplemental relief device should be capable of limiting the pressure to 121 % of the MAWP.

3.17.2 Failure modes

Failure modes that must be considered in the design and operation of protective pressure-relief systems include the following:

- a. The minimum capacity of the primary protective device should be determined by the heat leak rate. The device should be located as near as possible to the highest point in the line section.
- b. The overpressure potential associated with connection to a high-pressure source of any type — pump, pressure-relief valve or direct connection through a flow-limiting orifice requires the existence of a pressure switch to cut off the source of high pressure but does not eliminate the need for the primary protective device. The primary protective device should be located as close as practical to the high-pressure source.
- c. Capacity consideration for the jacket should be based on a catastrophic failure.

3.18 ELECTRICAL CONSIDERATIONS

3.18.1 Electrical installation

- a. All electrical equipment within the risk envelope of normally operated hydrogen equipment shall be suitable for the approved classification in accordance with SANS 10108.
- b. Stuffing boxes shall be used for electrical wiring taken from one explosion-proof enclosure to another. All outdoor controls shall be weatherproof with at least an IP 65 rating.
- c. Where equipment is pressurised, the air for the equipment shall be taken from an outside source free of hydrogen contamination. Alternatively an inert gas may be used.

3.18.2 Bonding and grounding

- a. Exposed metal shall be earthed.
- b. All metallic services and structures around hydrogen containing plant shall be earthed and electrically unified to preclude the existence of discrete electrical bodies and potential differences between services and structures.
- c. All components in contact with hydrogen shall be bonded to electrically unify them with one another and the unified system shall be bonded to earth. Components requiring unification and bonding shall not be limited to the obvious items of equipment. Items for earthing and bonding include valve handles, rubber corrosion protected cooling elements in heat exchangers and internal parts of equipment such as the balls and gates of valves and other elements capable of forming distinct electrical entities.
- d. All grounding connections should be less than 10 ohm resistance.

3.18.3 Electric motors

- a. All main and ancillary drive motors shall conform to NWS 1551 or any applicable specification listed in NWS 1551 clause 2.
All motors shall be arranged so that they can be removed and maintained without disturbing the driven machine, piping or electrical items.

CONTROLLED DISCLOSURE

3.18.4 Transformer

- a. The transformer shall be designed for indoor operation and be rated for continuous operation at maximum rectifier output. Cable boxes shall be fitted with removable gland plates.
- b. Over-current protection shall be installed.
- c. Equipment shall be designed for the quality of supply provided by the power station.

3.18.5 Electrical controls

- a. The operation of the plant shall be fully automatic and preferably arranged with step-less voltage control to vary the hydrogen output between the manufacturers minimum recommended production capacity and 100 % of capacity.
- b. If liable to damage by short breaks in the electrical power supply, the plant shall be provided with an automatic protection facility and an alarm initiating contact.

3.18.6 Electrical connections and cabling

- a. All connections shall be rated to the full current rating of the associated equipment i.e. fused-switch, contactor, circuit-breaker, etc. and not to the design current or fuse-link rating.
- b. Neutral connections shall have the same rating as the phase connections.
- c. Insulated wire shall comply with SANS 1507 and SANS 1574. Stranded conductor only shall be used unless the solid type is approved by Eskom for the particular application.
- d. Wiring at 50 V and below shall withstand a 500 V test voltage to earth for 1 min and wiring above 50 V shall withstand 1000 V to earth, for 1 min when installed.
- e. Wiring shall be neatly fixed to avoid vibration and shall not obscure access to components. Wiring across door hinges shall be subjected to torsion rather than bending when opening the door.
- f. All leads shall be marked at both ends, using interlocking white ferrules with impressed black characters. Not more than two leads shall be connected to one terminal.
- g. An un-drilled, removable gland plate shall be provided at least 300 mm above floor level for each cable entering the equipment. For cables of 185 mm² and above, the gland plate shall be at least 6 mm thick and drilled to suit the gland. For gland plate to terminal distances greater than 400 mm for control cables, or 500 mm for power cables, a means of fixing or bracing cable tails shall be provided.
- h. Power supply and control cabling shall not share cable trays. Where control and instrument cables have to cross other cables only right angle crossing will be allowed. The minimum spacing between control and instrument cables and the nearest power cables shall be 1 m.
- i. The insulation of all the electrical equipment shall be in accordance with the specification IEC 60071
- j. Power conditioning equipment shall be designed for reliability and ease of maintenance, and shall incorporate adequate redundancy to allow for fault repairs and routine maintenance without reducing the plant availability
- k. Individual harmonic currents shall not exceed the following: (these are measured at the electrical supply boards):
 - rms amplitude of 100/n percent, where n is the harmonic number.
 - Sub-harmonic currents shall not exceed the RMS amplitude of 100n percent, where n is the Fraction given by the sub-harmonic frequency divided by the fundamental frequency
- l. All lighting and small power shall be designed and supplied in accordance with the Standard 200-11764. The Occupational Health and Safety Act (OHS Act) specifies minimum illumination levels for safety. At no time shall the illumination level fall below these recommendations, hence the lighting installation of the construction phase lighting must be regularly maintained to ensure conformance to the said act.
- m. Any termination cubicle, junction box or distribution box utilized outdoors shall be IP65 rated and IP55 for indoor in accordance with IEC 60529. Finishing colour of 230/400 V cubicles shall be light grey G29 to SANS 1091.

CONTROLLED DISCLOSURE

3.19 CONTROLS AND INSTRUMENTATION

3.19.1 Plant operation and instrumentation

- a. The operation of the plant shall be fully automatic, at the manually set hydrogen production rate, to maintain the rated pressure in the storage vessels.
- b. Indicating, recording and out-of-limits detecting instrumentation shall be provided as necessary for all parameters affecting safe operation of the plant (e.g. purities, temperatures and cell levels).
- c. Remote data monitoring for the plant is required so that the plant can be supported by the OEM.
- d. The control system for controlling the automated receiver filling and the control of the Hydrogen Generating Plant will be integrated to ensure safe plant operation. The control philosophy will revert to plant to the safest state when an unsafe condition is detected.
- e. The best operating philosophy for the integrated system i.e. hydrogen production and storage will be implemented to optimise cell stack life and needs to be approved by Generation Technology Department.
- f. All new installations for generator hydrogen cooling system, carbon dioxide purging will be fully automated supplied with a full human machine interface that can be operated from a local and remote station, with the remote station located in the control room.
- g. All manual operated display valves, monitoring and plant status indication will be mounted in a two dimensional plane at a minimum height of 1 m and a maximum height of 1,8 m.
- h. The source code for all programmable logic controllers must be supplied with no access limitation to Eskom. Version control must be implemented.
- i. A data recording, trending and data view facility shall be provided with the plant.
- j. All instrumentation and C&I equipment shall have an IP rating of IP66. The Junction Box location shall be outside the hazardous zone location.
- k. The terminal block for the marshalling cabinet and junction box terminations shall comply with the SANS 60947-7-1 and 60947-7-2.
- l. Eskom does not utilise binary transmitters and switches, but analogue transmitters with software levels. Binary transmitters and/or level switches will be accepted in areas where they are required for statutory requirements or for protection and hardwired interlocking.
- m. For level measurement and/or switch where differential pressure transducers are used, all low pressure instrument tapping points and isolation valve connections shall be ½ inch BSP tapered.
- n. For level measurement and/or switch where an ultrasonic or radar transmitter is used, all low pressure instrument tapping points and isolation valve connections shall be 2 inch BSP tapered.
- o. All temperature pockets/wells shall be fitted with a cap and chain. All pockets/wells shall have ½ inch BSP parallel female thread for the instrument connection and ¾ inch BSP tapered male process connection, if not welded. The tapping points for the process connection shall have ¾ inch BSP tapered female connection. All other low pressure instrument tapping points and isolation valve connections shall be ½ inch BSP tapered.
- p. All temperature pockets/wells shall be fitted with a cap and chain. All pockets/wells shall have ½ inch BSP parallel female thread for the instrument connection and ¾ inch BSP tapered male process connection, if not welded. The tapping points for the process connection shall have ¾ inch BSP tapered female connection. All other low pressure instrument tapping points and isolation valve connections shall be ½ inch BSP tapered.
- q. All transmitters shall be HART devices and shall provide measurements that are repeatable and have no drift for a minimum of 10 years with an accuracy of 0.1 % of full scale or better. Each transmitter shall have its own tapping point. Transmitters provided shall be mounted in suitable transmitter racks, equipment cabinets or field panels. They shall be supplied as complete
- r. Temperature transmitters shall either use 4 wire Pt 100 RTDs, or 6 mm type K thermocouples, with calibration characteristics that comply with IEC 60751 and IEC 60584 standards.
- s. All pipe work supplied by the Contractor shall be inclusive of supports, valves, fittings, condensing chambers for closed vessel level transmitters, transition pieces to primary isolating valves and drains

CONTROLLED DISCLOSURE

to provide complete impulse and blow-down lines for all instruments. All pipe work designs shall be submitted to the Engineer for approval prior to installation.

- t. All cable racking, cable trays and conduits required for the installation of the equipment. All cables provided must be secured with suitable cable glands, straps or clamps on racks, in cubicles and equipment rooms.
- u. Where transmitters cannot be mounted in transmitter racks, equipment cabinets or field panels, these shall be mounted firmly on stands or brackets as close as possible to tapping point. The location shall allow safe and easy access for maintenance and calibration.

3.19.2 Mass flow meter

- a. A flow/mass meter, with a minimum accuracy of 5 %, shall be installed after the storage vessels and at each generator supply point and must measure the volume of hydrogen gas into the generator from all sources of hydrogen.
- b. The meters shall be of the positive displacement type fitted with a suitable orifice plate to prevent damage to the meter in the event of a sudden in-rush of hydrogen during commissioning.
- c. A mass flow meter shall be installed at the hydrogen generating plant and arranged to meter the total quantity of hydrogen drawn off by the station. The measurement will provide a reading of volume in cubic meters NTP.

3.19.3 Analysing Apparatus (Indicating)

- a. Gas analysing equipment shall be provided for testing the purity of the hydrogen on-line. It shall be the continuously indicating and recording type, essential for the safe operation and control of the plant fitted with an alarm contact arranged to operate between adjustable pre-set limits in the event of a drop in hydrogen purity. The response time of the equipment shall be catered for in the operating philosophy with periods within the instrument's "dead band" assumed to be unsafe.
- b. Only gas analysing equipment that has a fail-safe failure mode shall be installed in the plant that is not indicating purity better than actual and is failing in a slow response time mode. The operating philosophy of the plant must cater for potential equipment failure modes.
- c. Metering equipment shall cope with the high flows when filling the generators and with the low make-up rate in normal operation.
- d. All gas analysing equipment must be fitted with a minimum gas flow interlock, gas readings can only be accepted when minimum gas flow through the analyser is ensured.
- e. Conductivity type sensing equipment shall be installed for gas purity monitoring at the outlet of the desiccant dryers as well as at the analogue dew point sensing equipment.
- f. Catalytic oxygen sensors shall be installed on the line supplying the gas holder on atmospheric electrolyzers to provide protection against oxygen entrainment and must be fail safe.
- g. Where instruments used make use of a "de-oxidiser", these must also be backed up with an additional purity measurement using an inert gas, such as nitrogen, as a reference. "De-oxidiser" instruments require oxygen and hydrogen in order to function and therefore will not provide a reliable reading in the absence of hydrogen. Plant operating philosophies must cater for this to avoid the possibility of plant safety being assumed on the basis of an erroneous reading.
- h. Hydrogen specific analysers capable of tolerating wet hydrogen shall be installed where this condition is possible.
- i. Critical instrumentation to ensure safe plant operation must be installed with broken wire monitoring or supply failure and the hydrogen production operation reverted to a safe state when such a condition is detected.
- j. Hydrogen purity, oxygen content and quality must be measured before being administered to the generator casing.
- k. All analysers shall have a local display and they shall have the following parameters for configuration
 - High and low measuring range

CONTROLLED DISCLOSURE

- High and low display range
 - Engineering units
 - Temperature at measurement cell (where applicable)
 - Offset adjustment on temperature measurement (where applicable)
 - Offset adjustment on measured value
 - Indication of measurement device health
- l. All analysers shall provide measurements that are repeatable and have no drift for a minimum of 10 years. The output signal of all the analysers shall be load independent direct current 4 to 20 mA signal or by bus interface. The output signal is also a rising linear and falling linear signal. All gas analysing equipment with a drift worse than specified must be accompanied with a risk assessment proving that no unacceptable safety risk will arise from utilising the specific analyser in the application.
- m. The size of the controller cubicles shall be minimum (0.9m x 1m x 2.2m), they shall conform to the following:
- Floor mounted with suitable dust and vermin proofing
 - Bottom cabling access
 - Earthing
 - Front and rear access
 - Temperature monitoring per cubicle
 - Powder coated RAL 7035
- n. All cabling shall be of blue-stripe type i.e. consist of flame-retardant, halogen-free PVC outer sheath

3.19.4 Alarms and tips

- a. Visual alarms shall be provided to indicate any abnormal or dangerous conditions which might develop on the plant.
- b. Each alarm channel shall be provided with potential free alarm repeat contacts wired to external terminals to initiate a remote alarm system. The number of alarms installed shall be determined in line with the requirements of the safe operating philosophy.
- c. Control Device monitoring and controlling of the critical processes. Where reliable controls already exist, the controller can be configured to monitor those controls with alarm and delayed over ride facilities to trip the plant for critical processes. For example, the controller would monitor the actions of the mechanical switches on the gas holder but override the plant if the compressors were not tripped on a low-low signal by existing controls or if the new proximity switches provided a signal not provided by the mechanical switches.
- d. Regular plant operator tests shall be carried out to test system monitoring and safety equipment by simulating failure modes. These test facilities shall be incorporated at design stage if possible.

3.20 PRODUCTIONS QUALITY AND QUANTITY MANAGEMENT

The principle of continuous hydrogen quality and quantity measurement shall be such that:

- a. Purity is measured as soon after the electrolytic cells as possible and before compression and drying. Removal of moisture (free water) may be done before this point.
- b. Hydrogen purity, oxygen content must be measured before bulk storage or reticulation to generators.
- c. Dew point after storage and before reticulation to the generators.
- d. Hydrogen contamination in the oxygen stream must be measured.
- e. Continuous on-line pressure measurement of pressure in hydrogen system.
- f. Hydrogen purity and oxygen content is measured before administered to the generators.
- g. Continuous on-line generator hydrogen purity and quality measurement.

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

3.20.1 Electrolytic cells

- a. Each cell shall be fitted with points for manual gas sampling. Proof shall be provided that adequate flow of gas, electrolyte and cooling medium is achieved through-out the cell stack. A maximum of 5°C between the minimum and maximum measured temperatures shall be accepted though the cell stack.
- b. Means to ensure adequate electrolyte and cooling water flow through the cell stack shall be provided.
- c. The life expectancy of the cell stack should be minimum 10 years at full production.

3.20.2 Before storage

- a. Continuous hydrogen purity, oxygen content and dew point measurement shall be in place on the downstream side of the dryers before delivery to the bulk storage vessels and shall be periodically confirmed by an independent measurement (not necessarily on-line) so as to ensure the integrity and accuracy of the measuring devices.
- b. A dew point not meeting requirements shall cause an alarm. Atmospheric dew point shall be better than -50 °C NTP.
- c. Measurement of hydrogen purity (minimum 99,5 %) and also oxygen contamination (maximum 0,5 %) shall be done. If oxygen is not measured, any impurity detected by the hydrogen analysers shall be assumed to be oxygen.
- d. The plant shall be tripped when the oxygen contamination reaches the limit of 1 %.
- e. When hydrogen purity is less than 99,5 % one of the following two actions is required:
 - Where there is not automated vent facility, the entire plant shall be tripped with an alarm to the control room. OR
 - Where there is an automated vent facility, the out of specification condition shall be alarmed the hydrogen vented through a water seal, and compressors disabled from starting, until the quality returns to specification.

A relaxation of hydrogen purity to 97,5 % is permitted only where thorough investigation into the underlying causes has been carried out and necessary corrective actions identified.

3.20.3 After storage

- a. After storage and pressure reduction, a maximum dew point of -30 °C below the minimum system temperature, and for the generator working pressure, shall be allowed.
- b. Instrument specific gas flow through the analyser must be ensured and monitored to ensure that the purity of the gas that is being produced is monitored.
- c. The mass flow, pressure and dew-point must be trended and data stored as a minimum for a moving 30 day period at a sampling rate of once every minute.

3.20.4 At the generator

- a. Continuous hydrogen purity, oxygen content and dew point measurement.
- b. Hydrogen purity is measured before being administered to the generators.
- c. Continuous on-line generator hydrogen purity measurement.
- d. Measurement of hydrogen purity (minimum 96 %) and preferably also oxygen contamination (maximum 1 %) shall be done.

Note: If oxygen is not measured, any impurity detected by the hydrogen analysers shall be assumed to be oxygen and the generator must be tripped if the hydrogen purity is than less than 96 %.

- e. The plant shall be tripped when the oxygen contamination reaches the limit of 1 %.

CONTROLLED DISCLOSURE

3.20.5 Additional plant monitoring requirements

Additional parameters shall be monitored for the purposes of verifying correct operation of plant and/or ensuring plant health.

- a. An on-line hydrogen leak detection system shall be installed in the production plant linked to a plant trip and alarm. These shall be fitted above equipment where leaks are most likely to occur (e.g. water seals, compressors, gas holder, dryers). OR Leak detection by monitoring the pressure rise within containerized hydrogen generating plant set to detect a pressure rise that indicates the presence of 0.8% hydrogen.
- b. Storage vessel pressure and reticulation monitoring, which shall be maintained at a minimum pressure of 500 kPa gauge or 100 kPa above Generator pressure, whichever is the greater, at all times.
- c. The supply lines between the hydrogen production plant and the generators shall be fitted with on-line monitoring and an alarm facility.
- d. Correct operation of the ventilation fans, where installed.
- e. Concentration of base electrolyte, routine manual measurement is acceptable.
- f. Individual cell voltages (anode/cathode, anode/tank, cathode/tank), routine manual measurement is acceptable.
- g. Individual cell temperatures. (On-line).
- h. Individual cell electrolyte levels. (On-line).
- i. Rectifier voltage and current. (On-line).
- j. AC Ripple, manual measurement is acceptable.
- k. Rectifier temperature. (On-line).
- l. Mass flow after storage. (On-line).
- m. Compressor running hours, indication.
- n. Compressor motor currents, indication.

3.21 CORROSION PROTECTION

- a. All piping and steelwork, manufactured from low-carbon or mild-steel, including the pressure vessels shall be coated to prevent corrosion and comply with the requirements of:
 - SANS 10140 (parts 1 to 4), Identification colour markings,
 - ESKSCABB8, Corrosion Protection for Mechanical items of Plant.
- b. As available coatings change with time, outdated specifications shall not be used.

3.22 MAINTAINABILITY

Access to all parts of the plant for normal operating and maintenance requirements without removing panels.

3.23 MATERIALS FOR HYDROGEN SERVICE

The appropriate data must be available for the selection of a material for particular use, see Annexure A for material selection. The following must be considered when selecting suitable material for hydrogen applications:

- a. Properties suitable for design and operating conditions
- b. Compatibility with the operating environment
- c. Availability of selected material and appropriate test data for it
- d. Corrosion resistance
- e. Ease of fabrication, assembly and inspection
- f. Consequences of a material failure
- g. Toxicity
- h. Hydrogen embrittlement

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

- i. Potential for exposure to high temperature from a hydrogen fire
- j. Thermal contraction

4. AUTHORISATION

This document has been seen and accepted by:

Name	Designation
Manie Van Staden	Senior Consultant PEIC
Mfundo Verby	Discipline Manager LPS CoE
Mary Maunye	Senior Technologist Engineer LPS CoE
Justin Varden	Senior Engineer Chemical CoE
Marlize Andre	Chief Engineer LPS CoE
Nemalen Chetty	Senior Engineer LPS CoE
Bruce Tyson	Chief Engineer LPS CoE
Nkosi Ndika	Senior Engineer LPS CoE
Anasen Pillay	Senior Engineer LPS CoE
Jan Strydom	Senior Engineer LPS CoE
Ndoda Mazibuko	Senior Engineer C&I CoE

5. REVISIONS

Date	Rev.	Compiler	Remarks
November 2012	0	HJ van Staden	Compiled the Document 36-803
August 2013	1	W.O. Erasmus	Reviewed and approved, final document for Authorisation and Publication
August 2016	1.1	M. Maunye	Reviewed the document from Revision 1 to 1.1
October 2016	1.2	M. Maunye	Final Draft Document for Comments Review
January 2017	1.3	M. Maunye	Updated comments after the presentation to the LPS study committee.
March 2017	2	M. Maunye	Final Document for Authorisation and Publication

6. DEVELOPMENT TEAM

The following people were involved in the development of this document:

Name & Surname	Designation
Dikeledi Zitha	Engineer, Arnot Power Station
Manie Van Staden	Senior Consultant PEIC
Thokozane Ntuli	Senior Advisor, Majuba Power Station
Neil Anderson	Engineer, Matla Power Station
Nkhumeleni Matakanya	Engineer, LPS CoE
Karlien du Plessis	Engineer, Lethabo Power Station
Nhlanhla Ngcobo	Engineer, Duvha Power Station
Nhlanhla Rikhotso	Engineer, Kendal Power Station
Aandil Silal	Engineer, Lethabo Power Station

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

7. ACKNOWLEDGEMENTS

Manie Van Staden and the Hydrogen Forum/Care group

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

APPENDIX A

8.1 ANNEXURE A.1 MATERIAL DATA SPECIFICATION

A.1 Material selection criteria

Hydrogen components and hydrogen systems commonly involve a wide variety of material, both metals and non-metals (such as polymers). Each material that is involved (for example, seats, seals, adhesives, lubricants, electrical insulation, springs, bolts and piping) should be carefully evaluated for its use in the design, operating, and emergency conditions to which it will be exposed.

The selection of a material that is suitable for use in a hydrogen system involves several factors. Some considerations involved in the choice of a material to be used in a hydrogen system include the following:

- a. Compatibility with hydrogen (with concerns such as hydrogen embrittlement, hydrogen attack, hydriding, porosity, permeation and diffusion);
- b. Compatibility with adjoining materials (matching properties under changes in temperature and pressure, for example, and the effect of such changes on the material's shape and dimensions);
- c. Compatibility with the conditions of use (effects of temperature and pressure, for example, on ductility, and expansion/contraction; property changes associated with changes in operating conditions);
- d. Compatibility with the surrounding environment or exposure (for example, a corrosive environment or high temperature from a hydrogen fire or fire from nearby materials);
- e. Toxicity (the use of a material that is toxic in any way, such as during fabrication, should be considered only when absolutely necessary);
- f. Failure mode (for example, brittle rapid rupture versus ductile slow separation);
- g. Ability to fabricate into the desired form (for example, machining, welding and bending);
- h. Economics;
- i. Availability

Most of these considerations are common for the selection of a material for any purpose. However, the first one is unique to hydrogen, and the next two are important for liquid hydrogen applications, because of the low temperature involved (20 K). A brief discussion of these first three considerations is given below.

8.2 ANNEXURE A.2 HYDROGEN EMBRITTLEMENT

Hydrogen embrittlement is a serious concern for metals exposed to hydrogen. Hydrogen embrittlement can cause a significant deterioration in the mechanical properties of metals. Hydrogen embrittlement involves a large number of variables such as the temperature and pressure of the environment; the purity, concentration and exposure time of the hydrogen; and the stress state, physical and mechanical properties, microstructure, surface conditions, and the nature of any crack front in the material. The susceptibility to hydrogen embrittlement of some commonly used metals is summarized in Table A.1.

Although a material may be subject to hydrogen embrittlement (even extremely embrittled), the material may still be used in hydrogen service. For example, compressed gas cylinders that have been used successfully for many years for the storage and transport of compressed hydrogen gas are commonly made of alloy steel 4130X.

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

Table 1: Hydrogen embrittlement susceptibility of some commonly used metals

Metal	Extremely embrittled	Severely embrittled	Slightly embrittled	Negligibly embrittled
Aluminum alloys				
1100				X
6061-T6				X
7075-T73				X
Be-Cu alloy 25			X	
Copper, OFHC				X
Nickel 270		X		
Steel				
Alloy steel, 4140	X			
Carbon steel				
1020		X		
1042 (normalized)		X		
1042 (quenched & tempered)	X			
Maraging steel, 18Ni-250	X			
Stainless steel				
A286				X
17-7PH	X			
304 ELC			X	
305			X	
310				X
316				X
410	X			
440C	X			
Inconel 718	X			
Titanium and titanium alloys				
Titanium			X	
Ti-5Al-2.5Sn (ELI)		X		
Ti-6Al-4V (annealed)		X		
Ti-6Al-4V (STA)		X		

8.2.1 Low Temperature Effects

8.2.1.1 General

The selection of a structural material for use in liquid hydrogen service is based primarily on the mechanical properties of the material, such as yield and tensile strengths, ductility, impact strength and notch insensitivity. The material should have certain minimum values for these properties over the entire temperature range of operation, with appropriate consideration for emergency conditions such as a hydrogen fire. The material should be metallurgically stable, so that phase changes in the crystalline

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

structure do not occur with time or repeated thermal cycling. The choice of a material for use at liquid hydrogen temperature of 20 K involves material behaviour considerations such as the following:

- a. Transition from ductile to brittle behaviour as a function of temperature;
- b. Modes of plastic deformation, particularly certain unconventional modes encountered at very low temperatures;
- c. Effects of metallurgical instability and phase transformations in the crystalline structure on mechanical and elastic properties.

Two of the primary considerations in the selection of a material for liquid hydrogen service are low temperature ductility (low-temperature embrittlement) and thermal contraction.

8.2.2 Low-Temperature Embrittlement

Many materials change from ductile to brittle behaviour as their temperature is lowered. This change in behaviour can occur at temperatures much higher than cryogenic temperatures.

The results of the Charpy impact test as a function of temperature can be used as an indication of the ductile-to-brittle transition behaviour of a material. Another indication of the ductile-to-brittle behaviour of a material can be obtained by the relationship of the yield and tensile strengths of a material as a function of temperature. If the yield strength of a material approaches the tensile strength of the material as the temperature decreases, then the material will become increasingly brittle.

Generally, a material that has a ductile-to-brittle transition temperature above 20 K should not be used with liquid hydrogen, unless its use is given careful consideration and thorough analysis. Most polymers become brittle at temperatures much higher than liquid hydrogen temperature, and consequently, their use in liquid hydrogen systems is generally avoided.

8.2.3 Thermal contraction

Materials generally have a positive expansion coefficient, that is, the material will expand as its temperature rises (however there are a few exceptions to this). The temperature span from ambient to liquid hydrogen temperature is about 280 K. Such a large temperature decrease can result in significant thermal contraction in most materials. It is necessary to account for this contraction in the use of a material at liquid hydrogen temperature. The thermal expansion coefficient itself is a function of temperature.

Typical values for thermal contraction for a temperature change from an ambient to a cryogenic temperature are as follows:

- a. About 0,3 % in iron-based alloys;
- b. Slightly over 0,4 % in aluminium;
- c. Well over 1 % in many plastics.

The use of a plastics material between two metal surfaces (for example, seals) would have to accommodate the approximately 0,6 % more contraction that the plastic would experience compared to the metal.

8.2.4 Material Suitability for Hydrogen Service

A material should be evaluated carefully before it is used for hydrogen service. A material should not be used for hydrogen service unless data are available to show that the material is suitable for the intended service conditions. Materials that have been used successfully with hydrogen should be preferred over materials with little or no history of use with hydrogen. The suitability of some commonly used materials for use with hydrogen is shown in Table A.2, which is provided as a guideline and for informative purposes only.

CONTROLLED DISCLOSURE

Table 2: Suitability of some selected materials for hydrogen service

Material	Gaseous hydrogen (GH ₂) service	Liquid hydrogen (LH ₂) service	Remarks
METALS			
Aluminium and its alloys	S	S	Negligibly susceptible to hydrogen embrittlement.
Copper and its alloys (such as brass, bronze and copper-nickel)	S	S	Negligibly susceptible to hydrogen embrittlement.
Iron, cast, grey, ductile	NS	NS	Not permitted by relevant codes and standards.
Nickel and its alloys (such as Inconel and Monel)	E	E	Evaluation needed. Susceptible to hydrogen embrittlement.
Steel, austenitic stainless with > 7 % nickel (such as 304, 3041_ 308, 316, 321, 347)	S	S stressed above yield	May make martensitic conversion if temperature.
Steel, carbon (such as 1020 and 1042)	E	NS	Evaluation needed. Susceptible to hydrogen embrittlement. Too brittle for cryogenic service.
Steel, low alloy (such as 4140)	E	NS	Evaluation needed. Susceptible to hydrogen embrittlement. Too brittle for cryogenic service.
Steel, martensitic stainless (such as 410 and 440C)	E	E	Evaluation needed. Susceptible to hydrogen embrittlement.
Steel, nickel (such as 2,25; 3,5: 5 and 9 % Ni)	E	NS	Ductility lost at liquid hydrogen temperature
Titanium and its alloys	E	E	Evaluation needed. Susceptible to hydrogen embrittlement.

Table 3: (Continued): Suitability of some selected materials for hydrogen service

NONMETALS			
Asbestos impregnated with Teflon a	S	S	Avoid use because of carcinogenic hazard.
Chloroprene rubber (Neoprene a)	S	NS	Too brittle for cryogenic service.
Polyester fibre (Dacron)	S	NS	Too brittle for cryogenic service.
Fluorocarbon rubber (Viton a)	E	NS	Too brittle for cryogenic service.
Polyester film (Mylar a)	S	NS	Too brittle for cryogenic service.
Nitrile (Buna-N a)	S	NS	Too brittle for cryogenic service.
Polyamides (nylon)	S	NS	Too brittle for cryogenic service.
Polychlorotrifluoroethylene (Kel-F a)	S	S	
Polytetrafluoroethylene (Teflon a)	S	S	
NOTE 1 S: Suitable for use.			
NOTE 2 NS: Not suitable for use.			
NOTE 3 E: Evaluation needed to determine if the material is suitable for the use conditions.			

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

A Teflon, Neoprene, Dacron, Mylar, Viton, Buna-N and Kel-F are examples of suitable products available commercially. This information is given for the convenience of users of this Technical Report and does not constitute an endorsement by ISO of these product(s).

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.

APPENDIX B

9.1 HYDROGEN GENERATING PLANT FACTORY ACCEPTANCE TESTING GUIDELINE

Factory acceptance testing must be done on all hydrogen plants unless it is a plant and design that was previously witnessed and approved by GTD.

As a minimum the following must be checked and verified during factory acceptance testing from an Eskom perspective:

- a. Factory acceptance testing must be done on all hydrogen plants unless it is a plant and design that was previously witnessed and approved by GTD.
- b. As a minimum the following must be checked and verified during factory acceptance testing from an Eskom perspective:
- c. The hydrogen plant must be in a basic operating state without external devices connected to the control system. If the control system is password protected the unit must be in the lowest level status.
- d. The hydrogen purity and oxygen content must be monitored on the hydrogen production stream. The hydrogen content of the oxygen gas stream must also be monitored. The analysers for conducting this test must be able to measure PPM.
- e. The unit must be cycled through varying the pressure and creating a maximum delta pressure across the hydrogen and the oxygen within the cell stack and the current through the cell stack must be taken from minimum to maximum and vice versa. At all times the gas contamination must be maintained below 4%. For the execution of this test the gas analysing tripping values must be altered.
- f. During operation the power supply from all the safety devices individually must be removed and the unit should revert to the safest state.
- g. The design must be approved and accepted by Eskom prior to FAT.
- h. All safety trips must be tested.
- i. All safety devices must be calibrated prior to FAT and witnessed by Eskom.
- j. The unit must be fully assembled and fully compliant to the requirements of 240-56227413.
- k. A leakage test must be conducted prior to FAT with the unit being pressurised to operating pressure all outlets isolated and zero percent leakage over a 24hour cycle. Temperature compensation must be done.
- l. The hydrogen generating plant must run continuously uninterrupted for 7 days at full capacity without tripping. The average production must be more than the specified output.
- m. All inputs and outputs to and from the control system must be checked and verified.
- n. All final drawings, set points and operating instruction documentation must be available.
- o. Detailed control and safe plant operating philosophy must be submitted prior to FAT.
- p. The source code of all programmable logic controllers will be made available to Eskom prior to FAT with no limitation on access.
- q. The source code will be reloaded from the copy supplied to Eskom prior to FAT.
- r. For the warrantee period no alterations to the source code will be done without the consent of the OEM.
- s. At minimum product rate maximum pressure after the hydrogen in oxygen and oxygen in hydrogen directly after the cell stack has stabilized, the hydrogen vent valve and alternately the oxygen vent valve will be forced open. The system needs to trip and maintain the contamination levels within the levels stipulated in ISO 22734-1, Hydrogen generators using water electrolysis process – Part 1: Industrial and commercial applications.

CONTROLLED DISCLOSURE

When downloaded from the EDMS, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorised version on the system.