

	Standard	Medupi Power Station Project
---	-----------------	-------------------------------------

Title: **KKS Coding and Labelling Standard**

Document Identifier: **348-630398**

Alternative Reference Number: **200-3340**

Area of Applicability: **Medupi Power Station Project**

Functional Area: **Configuration Management**

Revision: **6**

Total Pages: **39**

Review Period: **July 2025**

Disclosure Classification: **Controlled Disclosure**

Compiled by

QA, Interface & Governance Review

Functional Responsibility

Authorized by

.....

Date:

Date:

Date:

Date:

.....

Content

	Page
1. Introduction.....	6
2. Supporting Clauses	6
2.1 Scope.....	6
2.1.1 Purpose.....	6
2.1.2 Applicability	6
2.1.3 Effective date.....	6
2.2 Normative/Informative References	6
2.2.1 Normative.....	6
2.2.2 Informative.....	7
2.3 Definitions	7
2.4 Abbreviations	7
2.5 Related/Supporting Documents.....	8
3. Document Content.....	8
3.1 Plant Identification.....	8
3.1.1 Plant Labelling.....	8
3.1.2 Coding System.....	8
3.2 Plant Labelling.....	8
3.2.1 Labels.....	8
3.2.2 Label Material.....	9
3.2.3 Label Engraving	9
3.2.4 Ergonomic Requirements	9
3.2.5 Environmental Factors.....	10
3.3 Plant Labels	10
3.3.1 Label Type GA	10
3.3.2 Label Type GB	11
3.3.3 Label Type GC	11
3.3.4 Label Type GD	12
3.3.5 Label Type GE	13
3.3.6 Label Type GF.....	13
3.3.7 Label Type GG.....	13
3.3.8 Label Type GH	14
3.3.9 Label Type GI.....	15
3.3.10 Label Type EA.....	15
3.3.11 Label Type EB.....	16
3.3.12 Label Type EC.....	16
3.3.13 Label Type ED.....	17
3.3.14 Label Type EE.....	17
3.3.15 Label Type EF	18
3.3.16 Label Type EG	18

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.3.17 Label Type EH.....	19
3.3.18 Label Type EI	19
3.3.19 Label Type EJ	20
3.3.20 Label Type EK Label Type EL	20
3.3.21 Label Type EM	21
3.3.22 Label Type EM.1	21
3.3.23 Label Type EM.2	22
3.4 Back Plates	23
3.4.1 Back Plate Type BB.....	23
3.4.2 Back plate Type BC.....	23
3.5 Piping Labels.....	24
3.5.1 Non-lagged Piping Less than or Equal to 50mm	24
3.5.2 Non-lagged Piping Greater than 50mm	25
3.5.3 Lagged Piping Protected with Cladding	26
3.5.4 Multiple Pipeline Runs	26
3.5.5 Vessels.....	26
3.6 Cable Racking Labels.....	28
3.7 Cranes and Crawl Beam Labels	30
3.8 Stairwells, CAT Ladders and Pipe Supports Labels.....	30
3.8.1 Stairwells	30
3.8.2 Pipe Supports.....	31
3.9 Cable Labels	31
3.9.1 Internal Cables	31
3.9.2 External Cables	31
3.10 Cable Number Structure.....	32
3.10.1 Cable Information Capturing.....	32
3.11 Plant Descriptions	33
3.11.1 Plant Label Description.....	33
3.11.2 Format and Label Descriptions	33
4. Process for Monitoring.....	34
4.1.1 Revision Period	34
4.2 Training Requirements	34
5. Acceptance.....	34
6. Revisions	34
7. Development Team	35
Appendix A – MV, LV & DC Switchgear Label Positions	36
Appendix B - Process Self-Assessment Checklist.....	39

Figures

Figure 1: Mechanical Plant System Identification Label.....	10
Figure 2: Mechanical Plant Component Identification Label	11

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

Figure 3: Mechanical Plant Component Identification Label	11
Figure 4: Process Code Labels for Process Control Equipment on Local Control Panels, Mimics and Control Panels	12
Figure 5: Field Device Label for Process Control Equipment / Room Identification	13
Figure 6: Identification Label inside Process Control and Electrical Equipment	13
Figure 7: Point of Installation Code Labels	14
Figure 8: Point of Installation Code Labels	14
Figure 9: Point of Installation Code Label for Process Control Panels and Equipment	15
Figure 10: Board Main Label	15
Figure 11: Electrical Board Sub Section	16
Figure 12: Isolator Labels	16
Figure 13: Cubicle Identification Label	17
Figure 14: Terminal Label with Tier Co-ordinate	17
Figure 15: Lighting Distribution Board Label	18
Figure 16: Distribution Boards Information Labels	18
Figure 17: Junction Box Label	19
Figure 18: MCB Label	19
Figure 19: MCB Labels	20
Figure 20: Terminal Label Figure 21: Electrical Component Label	20
Figure 22: Transformer, Structure and Building Identification Label	21
Figure 23: Structure Related Label (Not Electrical Switchgear)	21
Figure 24: Label to be used Inside Buildings where a Description is required in a Room / Area....	22
Figure 25: Back Plate Type BB	23
Figure 26: Back Plate Type BB	23
Figure 27: Back Plate Type BC	23
Figure 28: Back Plate Type BC	24
Figure 29	24
Figure 30	24
Figure 31: Non-lagged Piping Greater than 50mm	25
Figure 32	26
Figure 33	27
Figure 34: Detail A	27
Figure 35	28
Figure 36	29

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

Figure 37	29
Figure 38	29
Figure 39	30
Figure 40	30
Figure 41	31
Figure 42	31

Tables

Table 2: Label material	9
Table 3: Dimensions of Legends for Pipelines and Vessels	25
Table 4: cable Rack/Tray Number Format.....	28
Table 5: Cable Database Fields	32
Table 6	34
Table 7	34

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

1. Introduction

To ensure the standardised application of plant coding, labelling and plant descriptions are allocated to equipment for effective use in all management and information systems. Existing plant coding and labelling will be used as far as practically possible.

2. Supporting Clauses

2.1 Scope

2.1.1 Purpose

The purpose of this standard is to specify the detailed requirements for the Medupi Power Station Project to ensure the plant get labelled with the correct codes and equipment descriptions.

2.1.2 Applicability

This procedure is applicable for all plant and equipment on the Medupi Power Station Project that will require plant coding and labelling.

2.1.3 Effective date

Date of authorisation of the procedure.

2.2 Normative/Informative References

Parties using this document shall apply the most recent edition and/or revision of the documents listed in the following paragraphs.

2.2.1 Normative

- [1] VGB-B 105 E KKS Guidelines 2010
- [2] VGB-B 106 E – KKS – Part A Application Commentaries 2004
- [3] VGB-B 106 B1 E – KKS – Part B1 Identification in Mechanical Engineering 2004
- [4] VGB-B 106 B2 E – KKS – Part B2 Identification in Civil Engineering 2004
- [5] VGB-B 106 B3 E – KKS – Part B3 Identification of Electrical and C&I Engineering 2004
- [6] VGB-B 106 B4 E – KKS – Part B4 Identification of C&I in Process Systems 2004
- [7] ESKSCAAC6 Specification for the Identification of the contents of pipelines and vessels
- [8] ISO 10007 Guidelines for Configuration Management
- [9] ISO 9001 Quality Management Systems
- [10] IEC 61355-1 Documentation and Record Management Standard

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

2.2.2 Informative

[11] 348-885912 Medupi Power Station Project Standard Abbreviations

[12] 348-882024 The Application of KKS Plant Coding

[13] 348-694071 KKS Key Part – Fossil Power Station

[14] 348-885912 Medupi Power Station Project Alpha Power Station Standard Abbreviations KKS 02

[15] Corrosion Protection Specification of Project Alpha

2.3 Definitions

The vocabulary of ISO 9000 and the following definitions apply in the application of this procedure.

Term	Explanation
Description	A description given to a process, structure, point of installation, component or equipment.
Label	Identification of process, structure, point of installation, component or equipment by means of approved fixing methods, materials and ergonomic requirements.
Basic colour	A colour that indicates the group of fluids to which the contents of a pipeline or vessel belongs.
Clad/cladding	The external protective metal sheath of the insulation of a pipeline or vessel.
Colour code indicator(s)	One or two colours that are applied in addition to the basic colour to indicate the specific contents.
Lagged	Indicates an insulated pipe or vessel that has no external protective sheath.
Stencil	A stencil is a thin sheet of material, such as paper, plastic, wood or metal, with letters or a design cut from it, used to produce the letters or design on an underlying surface by applying pigment through the cut-out holes in the material. The key advantage of a stencil is that it can be reused to repeatedly and rapidly produce the same letters or design.

2.4 Abbreviations

Abbreviation	Explanation
CM	Configuration Management
C&I	Control and Instrumentation
DC	Direct Current
IEC	International Electro-technical Commission
ISO	International Organization for Standardization
KPA's / KPI's	Key Performance Areas / Indicators
KKS	Kraftwerk Kennzeichen System – German abbreviation for (Power Plant Classification system)
MCB	Micro Circuit Breaker
MV	Medium Voltage
PLC	Programmable logic controller
PVC	Polyvinyl chloride
P&ID	Piping and Instrumentation Diagram

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

Abbreviation	Explanation
QMS	Quality Management System
TM	Eskom's Medupi Project Execution Team
VGB	Technische Vereinigung Der Grosskraftwerks Betreiber E.V (Major Power Plant Users Association)

2.5 Related/Supporting Documents

Documents superseded by this procedure

[1] 348-630398 KKS Coding and Labelling Standard 04

3. Document Content

3.1 Plant Identification

3.1.1 Plant Labelling

Plant coding is the cornerstone of Configuration Management and related information systems. It is of utmost importance that a standardised application thereof is used. The structure should include all equipment that will have a maintenance strategy and will assist in operating and maintenance activities.

3.1.2 Coding System

The KKS plant coding system has been adopted by Eskom and all Power Stations. The coding system has been developed by the VGB with a set of guidelines. Refer to the references for a detailed explanation on the application of KKS (C&I, Electrical, Mechanical & Civil).

3.2 Plant Labelling

Plant labelling is the physical label that is fixed to the plant. The purpose of plant label is to unambiguously distinguish between plant items and to ensure that a one-to-one correlation exist between the identification of the item on the plant and the identification of the item in the information systems and related documentation. The manufacturing of the label will be from an approved equipment / label list.

3.2.1 Labels

Because of the diversity of a plant that has to be labelled one cannot standardise on the material, size and type of label. This standard will therefore distinguish between the different plant areas and types of labels to be used. Spacing in the KKS number will be used when labels are manufactured.

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.2.2 Label Material

The following material will be used for the different plant areas. Refer to Table: 2 below.

PLANT AREA	LABEL MATERIAL TYPE	BACK PLATE MATERIAL TYPE
Boiler	Anodised Aluminium	Anodised Aluminium
Turbine	Anodised Aluminium	Anodised Aluminium
Ash Plant	Anodised Aluminium	Anodised Aluminium
Coal Plant	Anodised Aluminium	Anodised Aluminium
Water Treatment Plant	Stainless Steel	Stainless Steel
BOP and LP Services	Anodised Aluminium	Anodised Aluminium
Switchgear and Panels	White Graflux	N/A
Internal panels/cubicles	White Graflux	N/A
Transformers and structures	Cromadeck	Pre manufactured stand or wall mounted
Room Identification	Cromadeck (orange background with black text)	

Table 1: Label material

3.2.3 Label Engraving

- Engraving on the labels is Arial Monospaced MT font
- Standard vertical characters must be used. Narrow (condensed), broad (extended) characters are not acceptable.
- If the label description is too long to fit in one line and requires to go over multiple lines, it should be spread evenly across the height of the label.

3.2.4 Ergonomic Requirements

- Consistency will be maintained when fitting new labels regarding material, labels will be fitted in such a manner not to hamper routine operation and maintenance activities.
- Labels should be fitted in a position where they can be easily seen without compromising identity of exact equipment.
- Labels will be mounted so that the text runs in a horizontal plane reading from left to right to the nearest fixed point that is being described.
- For labels that have to be mounted vertically due to space constraints, the method of text reading will be from bottom to top. This excludes cable labels.
- Label fixing devices e.g. rivets, self-tappers, adhesives, ext. will not penetrate the equipment housing or constitute a potential source of corrosion. All labels must be securely fitted to the plant.
- Labels or back plates/brackets will not have sharp edges or protrude in such a way as to pose a safety risk.
- Valve labels will not be installed on hand wheels and labels will not cover equipment specification plates.

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.2.5 Environmental Factors

- a) All labels will be able to withstand the following for at least 30 years:
- b) Rain
- c) Hail
- d) Temperature variance as required by plant
- e) Wind and Dust erosion
- f) Ultra Violet rays (sun)
- g) Corrosion

3.3 Plant Labels

3.3.1 Label Type GA

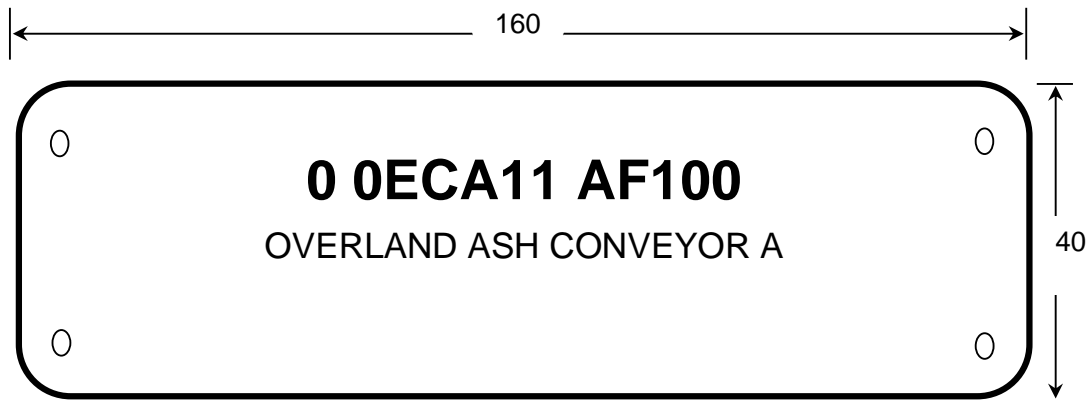


Figure 1: Mechanical Plant System Identification Label

- a) **Material:** Refer to Table: 2
1.5mm Thick
- b) **Fixing Holes:** 4x4mm Dia. (To be drilled only when fitted with a back plate)
7,5mm from Sides
- c) **Engraving:**
 - Characters Fill In Colour: Black
 - Alphanumeric Characters: 7mm High
 - Description Characters: 5mm High

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.3.2 Label Type GB

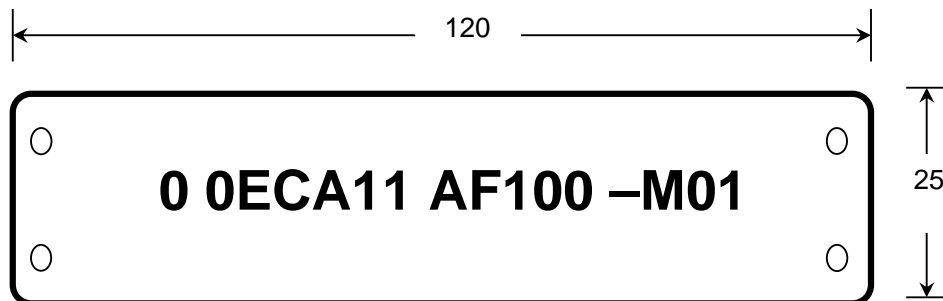


Figure 2: Mechanical Plant Component Identification Label

- a) **Material:** Refer to Table: 2 (1.5mm Thick Corner radius: 4mm)
- b) **Fixing Holes:** 2 x 4mm Dia. (To be drilled only when fitted with a back plate)
On centre line 7,5mm from Sides
- c) **Engraving:**
 - Characters Fill In Colour: Black
 - Alphanumeric Characters: 7mm High

3.3.3 Label Type GC

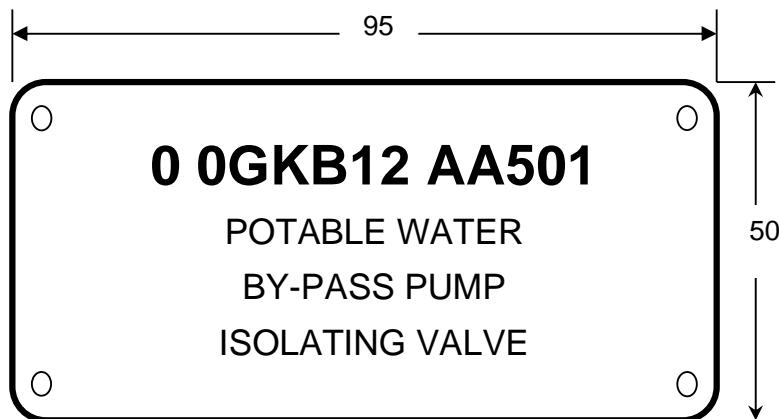


Figure 3: Mechanical Plant Component Identification Label

- a) **Material:** Refer to Table: 2 (1.5mm Thick Corner radius: 4mm)
- b) **Fixing Holes:** 4 X 4mm Dia. (To be drilled only when fitted with a back plate)
7,5mm from Sides

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

c) Engraving:

- Characters Fill In Colour : Black
- Alphanumeric Characters: 7mm High
- Description Characters: 5mm High

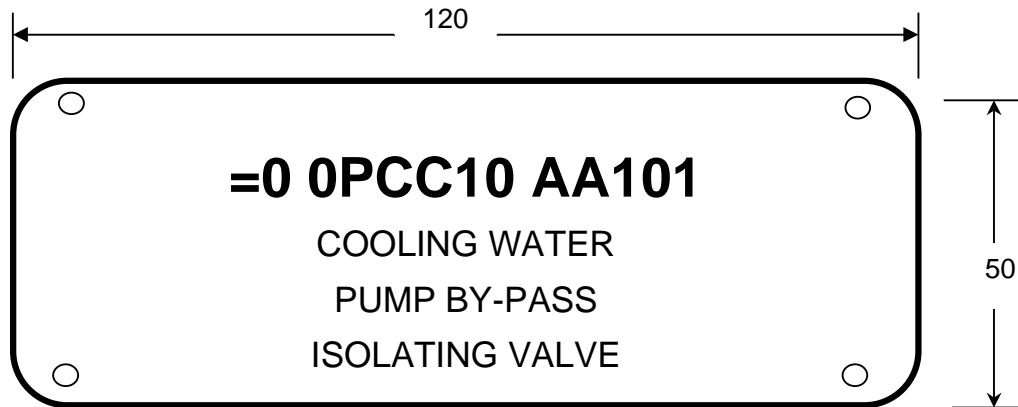
3.3.4 Label Type GD

Figure 4: Process Code Labels for Process Control Equipment on Local Control Panels, Mimics and Control Panels

- a) **Material:** Refer to Table: 2 (1.5mm Thick Corner radius: 4mm)
- b) **Fixing Holes:** 4 X 4mm Dia. (To be drilled only when fitted with a back plate)
7,5mm from Sides
- c) **Engraving:**
- Characters Fill In Colour : Black
 - Alphanumeric Characters: 7mm High
 - Description Characters: 5mm High

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.3.5 Label Type GE

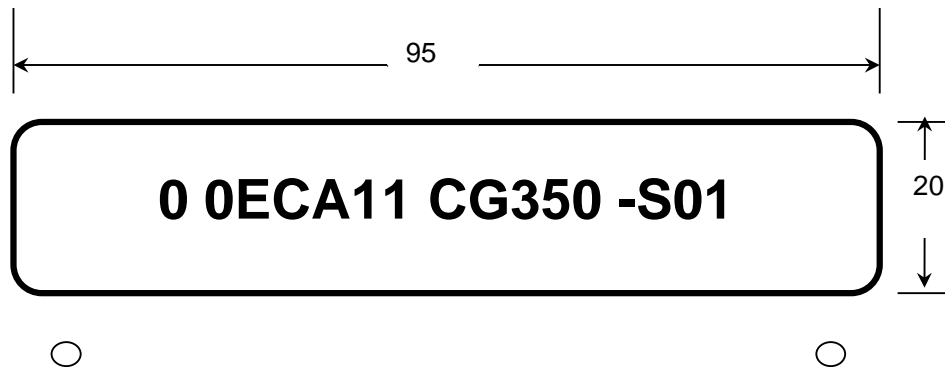


Figure 5: Field Device Label for Process Control Equipment / Room Identification

a) **Material:** Refer to Table: 2 (1.5mm)

b) **Engraving:**

- Alphanumeric Characters: 4mm High

3.3.6 Label Type GF




Figure 6: Identification Label inside Process Control and Electrical Equipment

a) **Material:** Refer to Table: 2 (1.5mm)

b) **Engraving:**

- Alphanumeric Characters: 3mm High, font – Arial, Colour: black

3.3.7 Label Type GG

Point of installation code labels for:

- Process control equipment
- Local Control Stations

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

- Marshalling Boxes, Junction Boxes, etc.

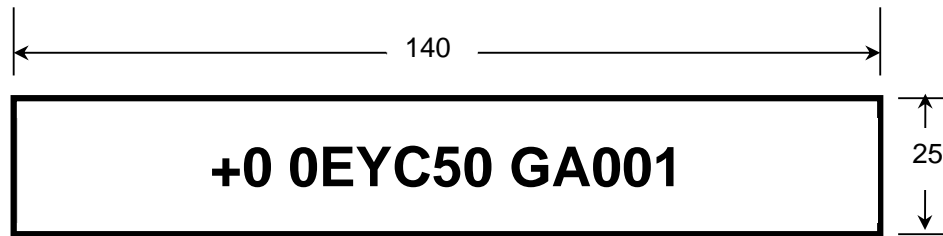


Figure 7: Point of Installation Code Labels

a) **Material:** Refer to Table: 2 (1.5mm)

b) **Engraving:**

- Characters Fill In Colour : Black
- Alphanumeric Characters: 10mm High, font - Arial

3.3.8 Label Type GH

Point of Installation Code Labels for Process Control and Electrical Equipment such as:

- PLC's Measurement Panels
- Protection Panels Measurement Racks
- Local Alarm Panels, etc.

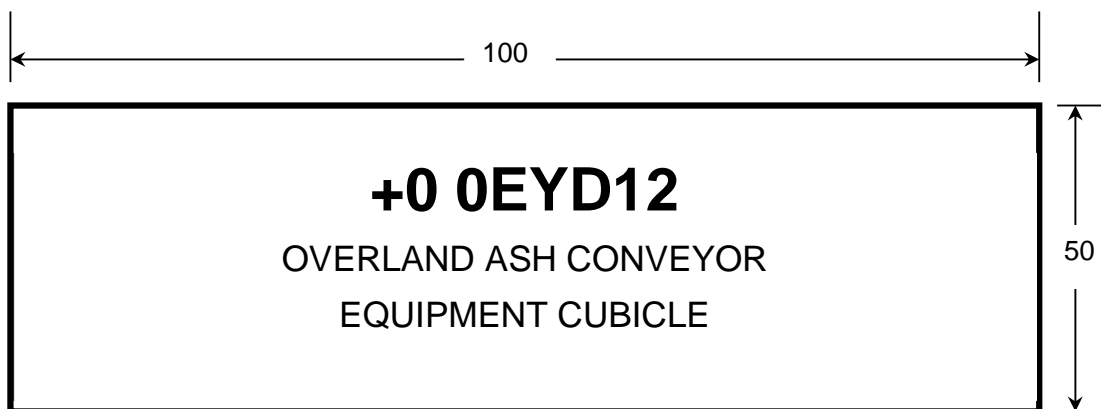


Figure 8: Point of Installation Code Labels

a) **Material:** Refer to Table: 2 (1.5mm)

b) **Engraving:**

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

- Characters Fill In Colour: Black
- Alphanumeric Characters: 10mm High, font - Arial
- Description Characters: 5mm High, font - Arial

3.3.9 Label Type GI

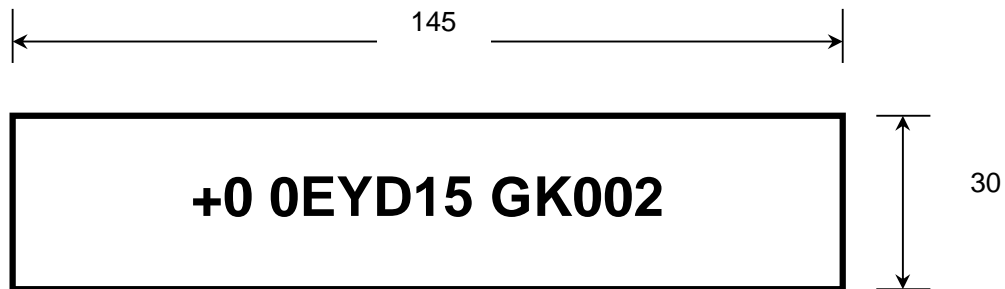


Figure 9: Point of Installation Code Label for Process Control Panels and Equipment

a) **Material:** Refer to Table: 1 (1,5mm Thick)

b) **Engraving:**

- Alphanumeric Characters: 10mm High

3.3.10 Label Type EA

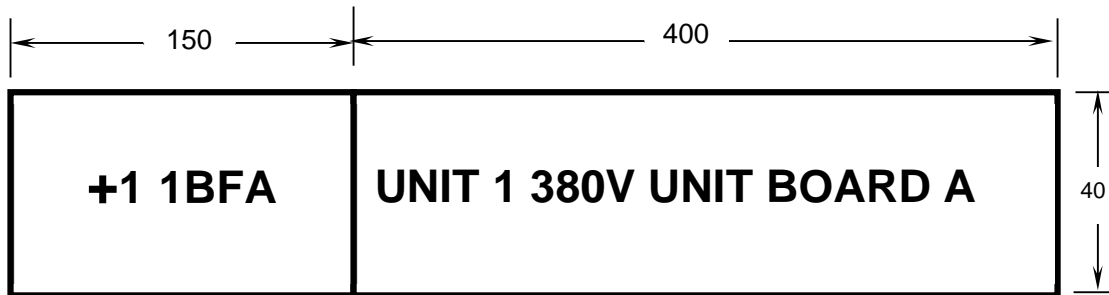


Figure 10: Board Main Label

a) **Material:** Refer to Table: 2 (1.5mm)

b) **Fixing Holes:** Aluminium sliding holder, no drilling into electrical or process control panels

c) **Engraving:**

- Characters Fill In Colour : Black
- Alphanumeric Characters: 20mm High
- Description Characters: 15mm High, font

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.3.11 Label Type EB

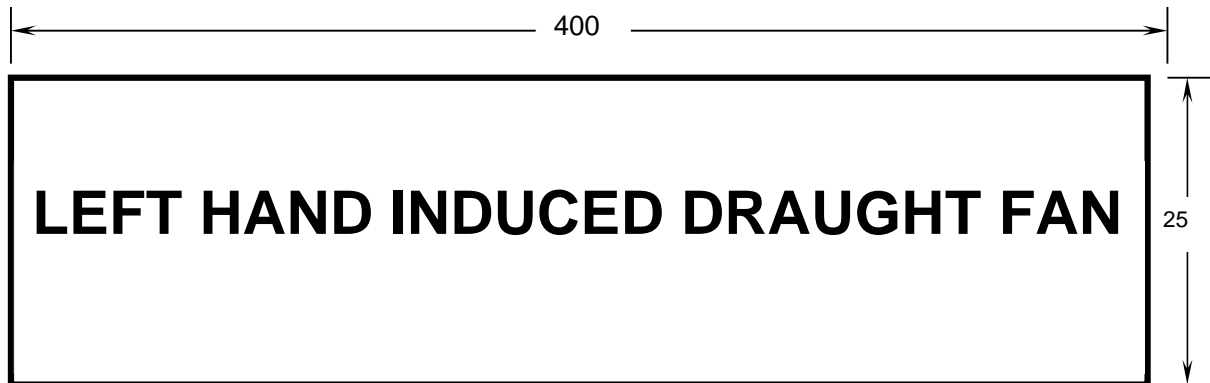


Figure 11: Electrical Board Sub Section

- a) **Material:** Refer to Table: 2 (1.5mm)
- b) **Fixing Holes:** Aluminium sliding holder, no drilling into electrical or process control panels
- c) **Engraving:**
 - Characters Fill In Colour : Black
 - Alphanumeric Characters: 20mm High

3.3.12 Label Type EC

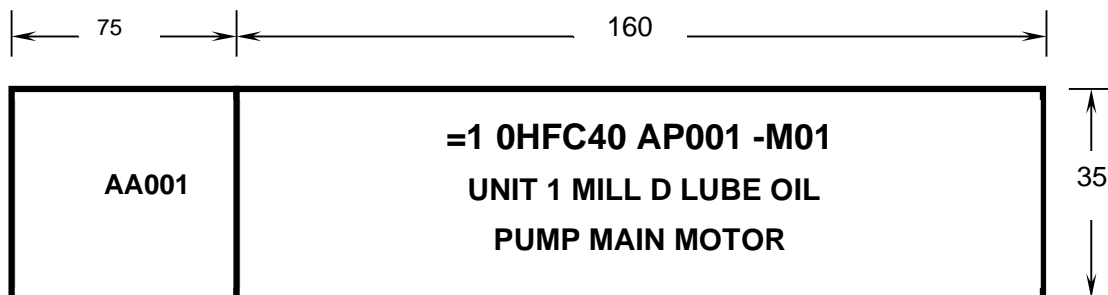


Figure 12: Isolator Labels

- a) **Material:** Refer to Table: 2 (1.5mm thick)
- b) **Fixing Holes:** Aluminium sliding holder, no drilling into electrical or process control panels
- c) **Engraving:**
 - Characters Fill In Colour : Black

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

- Alphanumeric Characters: 10mm High, font - Arial
- Description Characters: 10mm High, font - Arial

3.3.13 Label Type ED

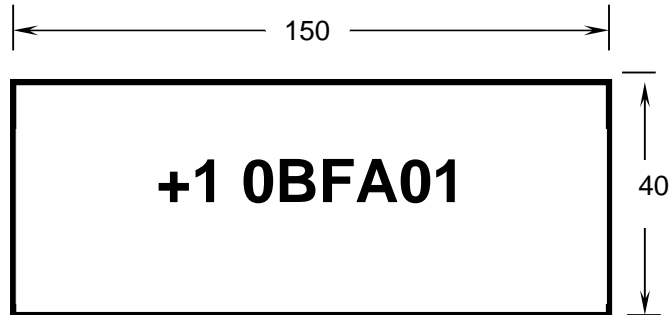


Figure 13: Cubicle Identification Label

- a) **Material:** Refer to Table: 2 (1.5mm Thick)
- b) **Fixing:** Aluminium sliding holder, no drilling into electrical or process control panels
- c) **Engraving:**
 - Characters Fill In Colour : Black
 - Alphanumeric Characters: 20mm High
 - Numeric Characters: 20mm High

3.3.14 Label Type EE

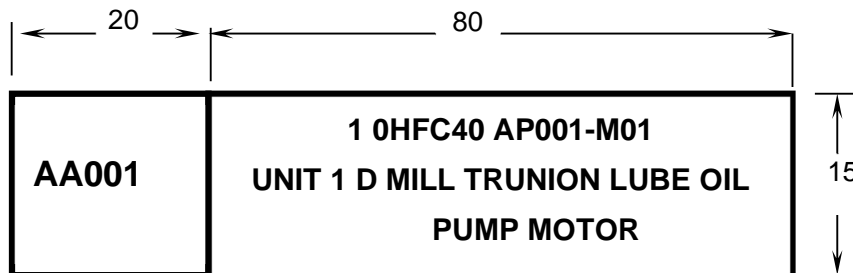


Figure 14: Terminal Label with Tier Co-ordinate

- a) **Material:** Refer to Table: 2 (1.5mm Thick)
- b) **Fixing Holes:** Aluminium sliding holder, no drilling into electrical or process control panels
- c) **Engraving:**
 - Characters Fill In Colour : Black

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

- Alphanumeric Characters: 3mm High
- Description Characters: 3mm High

3.3.15 Label Type EF

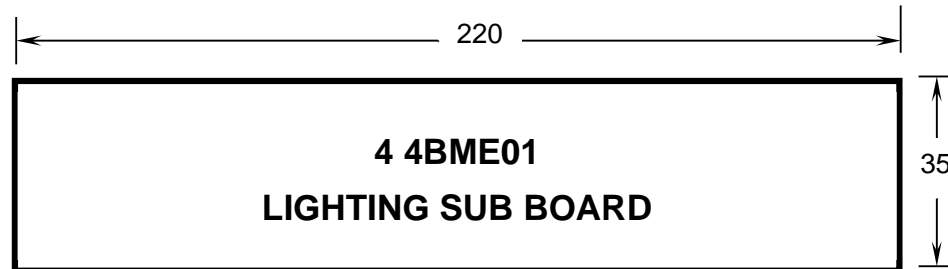


Figure 15: Lighting Distribution Board Label

- a) **Material:** Refer to Table: 1 (1.5mm Thick)
- b) **Fixing Holes:** Adhesive
- c) **Engraving:**
 - Characters Fill In Colour : Black
 - Alphanumeric Characters: 10mm High, font - Arial
 - Description Characters: 10mm High, font – Arial

3.3.16 Label Type EG

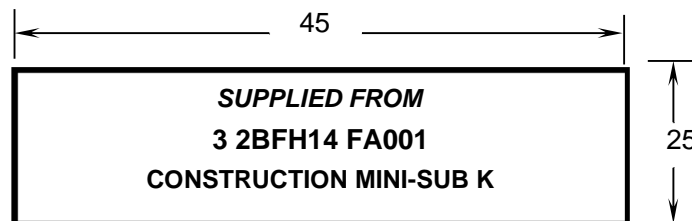


Figure 16: Distribution Boards Information Labels

- a) **Material:** Refer to Table: 2 (1.5mm Thick)
- b) **Fixing Holes:** Adhesive
- c) **Engraving:**
 - Characters Fill In Colour : Black

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

- Alphanumeric Characters: 4mm High
- Description Characters: 3mm High

3.3.17 Label Type EH

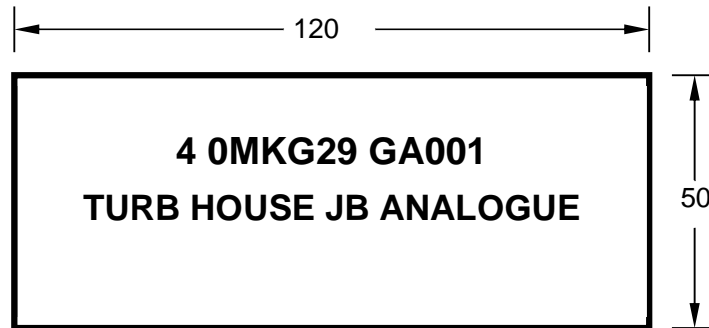


Figure 17: Junction Box Label

- a) **Material:** Refer to Table: 1 (1.5mm Thick)
- b) **Fixing Holes:** Adhesive
- c) **Engraving:**
 - Characters Fill In Colour : Black
 - Alphanumeric Characters: 10mm High
 - Description Characters: 10mm High

3.3.18 Label Type EI

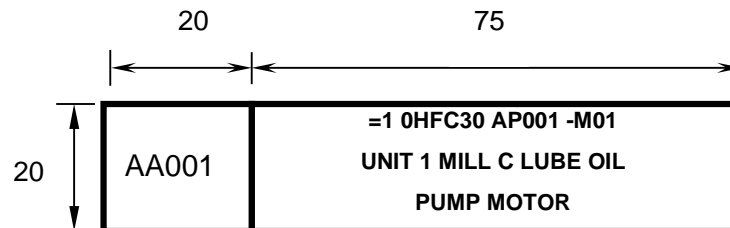


Figure 18: MCB Label

- a) **Material:** Refer to Table: 1 (1.5mm Thick)
- b) **Fixing Holes:** Adhesive / Sliding holder
- c) **Engraving:**
 - Characters Fill In Colour : Black
 - Alphanumeric Characters: 4mm High
 - Description Characters: 3mm High

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.3.19 Label Type EJ

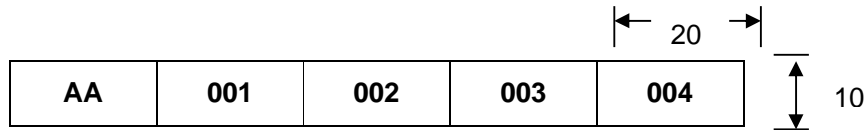


Figure 19: MCB Labels

- a) **Material:** Refer to Table: 1 (1.5mm Thick Corner radius: 4mm)
- b) **Fixing Holes:** Adhesive
- c) **Engraving:**
 - Characters Fill In Colour : Black
 - Alphanumeric Characters: 3mm High

3.3.20 Label Type EK




Figure 20: Terminal Label

Label Type EL




Figure 21: Electrical Component Label

- a) **Material:** Refer to Table: 2 (1.5mm Thick Corner radius: 4mm)
- b) **Fixing Holes:** Adhesive
- c) **Engraving:**
 - Characters Fill In Colour : Black
 - Alphanumeric Characters: 3mm High


CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.3.21 Label Type EM

Figure 22: Transformer, Structure and Building Identification Label

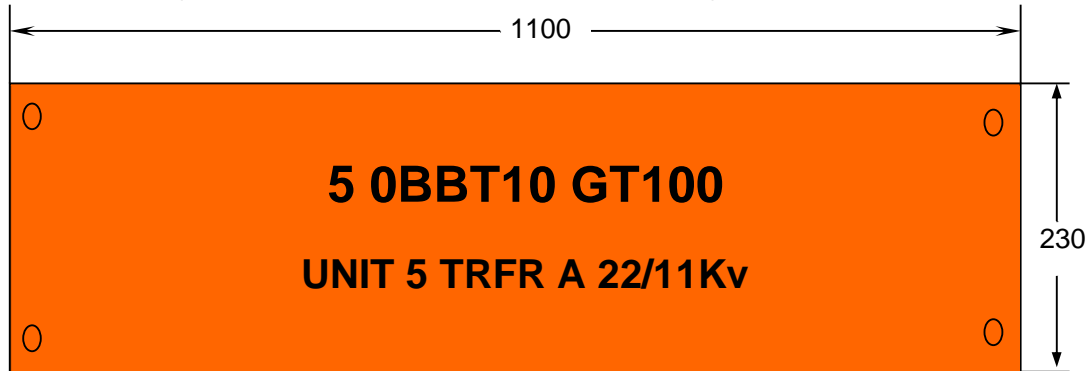

- a) **Material:** Refer to Table: 1 (1.5mm Thick)
- b) **Fixing Holes:** 4 X 10mm Dia. 7.5mm from sides
- c) **Text:**
 - Cut out characters
 - Characters in Black Engineering Grade 7 Years Vinyl.
 - Alphanumeric Characters: 60mm High
 - Description Characters: 40mm High

3.3.22 Label Type EM.1

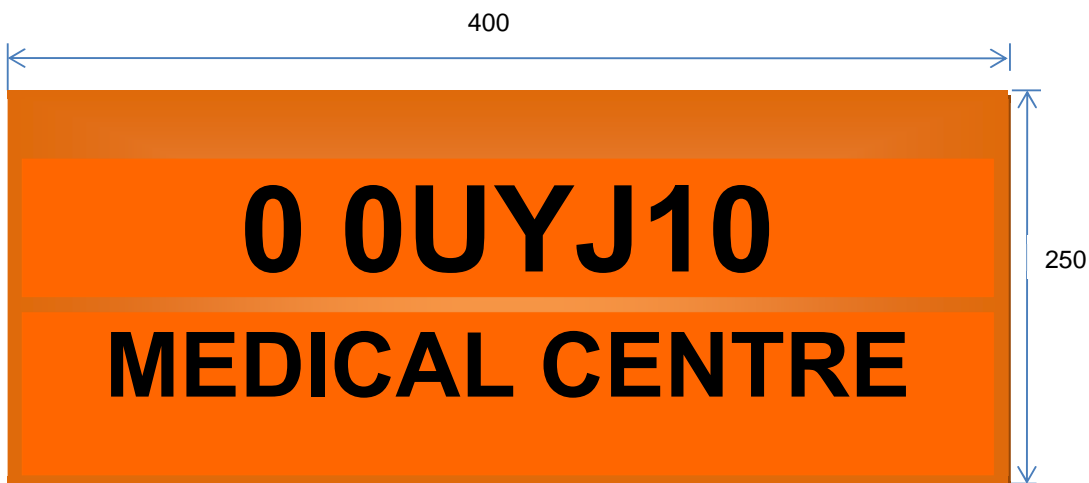


Figure 23: Structure Related Label (Not Electrical Switchgear)

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

- a) **Material:** Orange Chromadeck 1 mm Thick
- b) **Fixing holes:** 4 off 4 mm in diameter (to be drilled on request only); 7 mm from sides
- c) **Text:**
- Cut out characters
 - Characters in Black Engineering Grade 7 Years Vinyl.
 - KKS code characters: 60 mm High
 - Description text characters: 40 mm High

3.3.23 Label Type EM.2

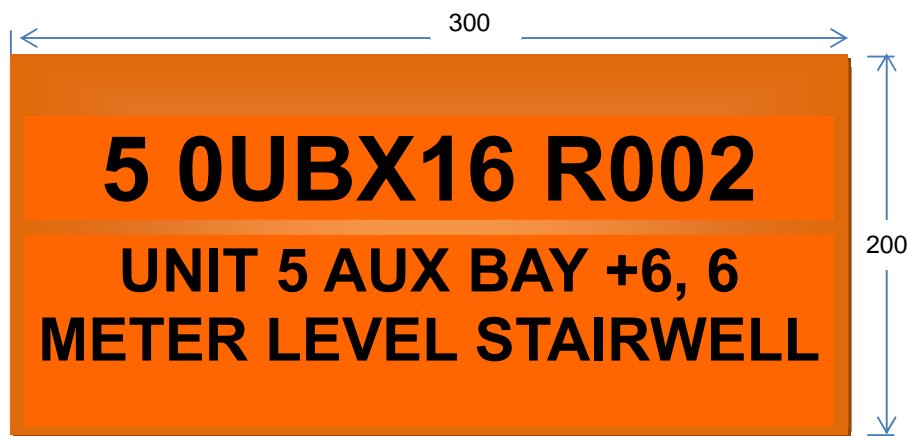


Figure 24: Label to be used Inside Buildings where a Description is required in a Room / Area

- a) **Material:** Orange Chroma deck 1mm Thick
- b) **Fixing holes:** 4 off 4 mm in diameter (to be drilled on request only); 7 mm from sides
- c) **Text:**
- Cut out characters
 - Characters in Black Engineering Grade 7 Years Vinyl.
 - Characters colour: Black
 - KKS code characters: 30 mm High
 - Description text characters: 20 mm High

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.4 Back Plates

Examples of back plates, this design will be used for labels requiring a back plate.

3.4.1 Back Plate Type BB

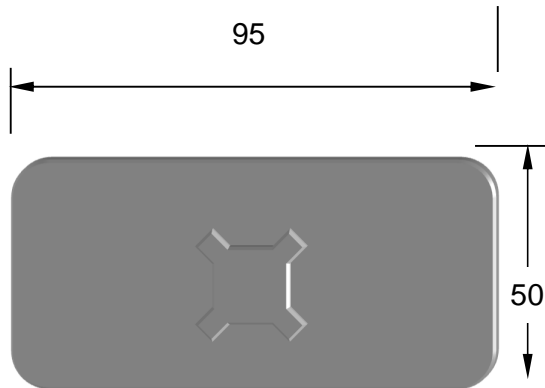


Figure 25: Back Plate Type BB

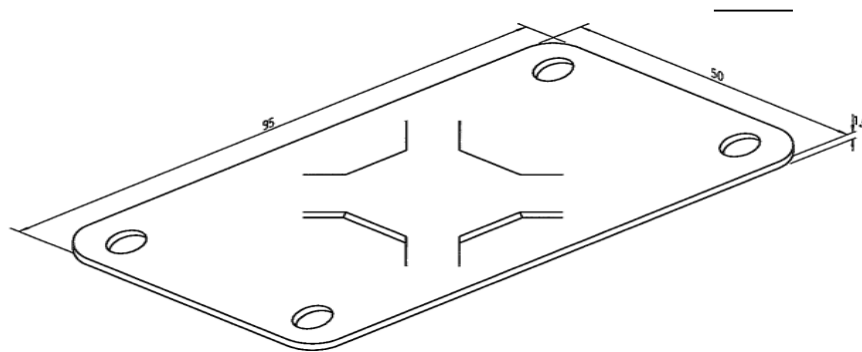


Figure 26: Back Plate Type BB

3.4.2 Back plate Type BC

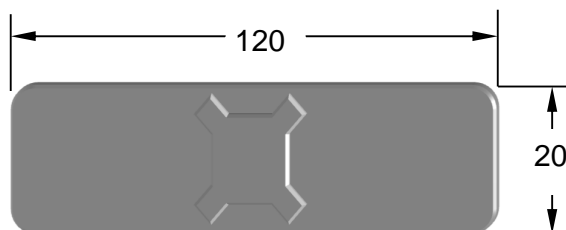


Figure 27: Back Plate Type BC

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

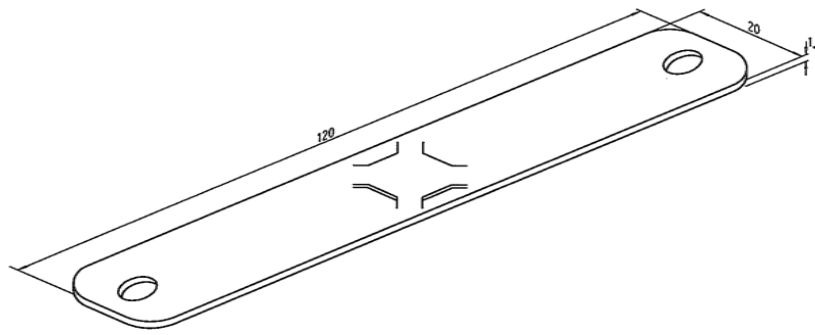


Figure 28: Back Plate Type BC

3.5 Piping Labels

3.5.1 Non-lagged Piping Less than or Equal to 50mm

Pipelines of diameter less than or equal to 50mm are to be painted in the basic colour over their full length. Colour code indicator bands are to be superimposed around the pipes, a suitable mechanical label is to be strapped around the pipes and a direction of flow to be painted as showed in Figure 29 below.

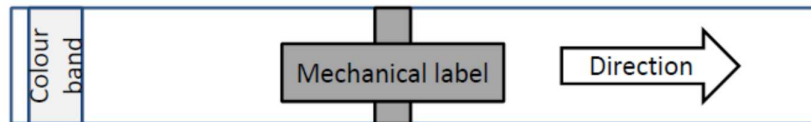


Figure 29

The indicators shown in Figure 29 above are to be placed at 10 m intervals nominally along the length of the pipe and adjacent to valves, wall and floor penetrations. The direction of flow arrows are of white colour with dimensions in accordance figure 30 below. For the length of the arrow please refer to Table 3 below.

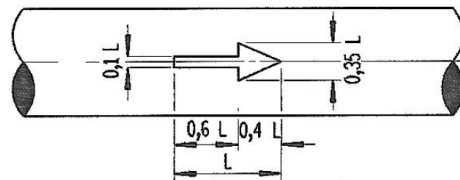


Figure 30

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

Dimensions and arrangement of descriptive identification legends for pipelines and vessels

Table C.1 — Dimensions of legends for pipelines and vessels

Outside diameter mm	Legend height mm	Chemical hazard legend height mm	Direction of flow arrow
			Length mm
Up to 50	20	20	75
51 to 100	25	25	100
101 to 150	38	50	150
151 to 225	50	100	200
226 to 300	75	150	300
301 to 600	100	150	300
Above 600	150	150	300

Table 2: Dimensions of Legends for Pipelines and Vessels

For basic colours, colour code indicator band colours to be used for various pipes carrying various medium please refer to Eskom document number ESKSCAAC6. For the basic colour and colour code indicator band paint specifications please refer to the Corrosion Protection Specification of Project Alpha.

3.5.2 Non-lagged Piping Greater than 50mm

Pipelines of diameter greater than 50mm are to be painted in the basic colour over their full length. In cases of long exposed sections of large diameter pipes, due consideration shall be given to the costs incurred with regard to the use of a basic colour over the full length. Colour code indicator bands are to be superimposed around the pipes, a KKS code label is to be stencilled along the pipe length, a medium description to be stencilled along the pipe length and a direction of flow to be stencilled as showed in Figure 31 below.



Figure 31: Non-lagged Piping Greater than 50mm

The height of the letters used on the KKS code and medium description stencilling is superimposed on a 'rectangular area' in accordance with table 3 above. The direction of flow arrows are of white colour with dimensions in accordance figure 30 above. For the length of the arrow please refer to Table 3 above. The indicators shown in Figure 31 above are to be placed at 10 m intervals nominally along the length of the pipe and adjacent to valves, wall and floor penetrations.

For basic colours, colour code indicator band colours to be used for various pipes carrying various medium please refer to Eskom document number ESKSCAAC6. For the basic colour and colour code indicator band paint specifications please refer to the Corrosion Protection Specification of Project Alpha.

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.


3.5.3 Lagged Piping Protected with Cladding

Pipelines lagged and protected with cladding do not require painting in basic colour over their full length, however colour code indicator bands are to be superimposed around the cladding, a KKS code label is to be stencilled along the cladding length, a medium description is to be stencilled along the cladding length as well as a direction of flow to be stencilled as showed in Figure 31 above. The height of the letters used on the KKS code and medium description stencilling is superimposed on a 'rectangular area' in accordance with table 3 above. The indicators shown in Figure 31 above are to be placed at 10 m intervals nominally along the length of the pipe and adjacent to valves, wall and floor penetrations.

For colour code indicator band colours to be used for various pipes carrying various medium please refer to Eskom document number ESKSCAAC6. For the colour code indicator band paint specifications please refer to the Corrosion Protection Specification of Project Alpha.

3.5.4 Multiple Pipeline Runs

Colour identification, descriptive identification and labels are positioned on multi-pipeline runs such that the identification of all pipes in the run is clearly visible from an observation position as shown in figure 32 below.

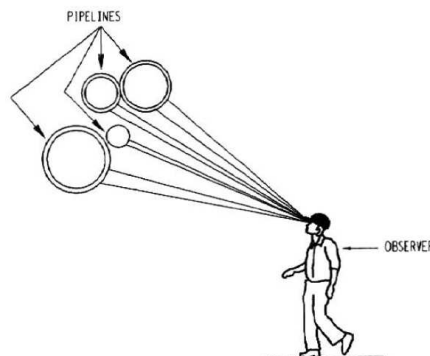

NOTE — Extract from SABS 0140-3:1992.

Figure 32

3.5.5 Vessels

3.5.5.1 Round Vessels

Round vessels are to be stencilled as showed in Figure 33 below. The height of the letters used on the KKS code and medium description stencilling is superimposed on a 'rectangular area' in accordance with table 3 above.

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

**Figure 33**

For the stenciling paint specifications for the vessels please refer to the Corrosion Protection Specification of Project Alpha.

3.5.5.2 Square Vessels

Square vessels are to be labelled using a manufacture's name plate as showed in Detail A below. The height of the letters used on the KKS code and description must be visible at eye level.

**Figure 34: Detail A**

Alternatively label Type EM used to label transformers, structures and buildings can be used to label the square vessels as shown in Detail B below. The label to be fixed on a flat surface of the vessel using adhesive or to be fixed on a bracket using rivets similarly to Detail A above. The KKS code and description on the EM label must be visible at eye level.

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

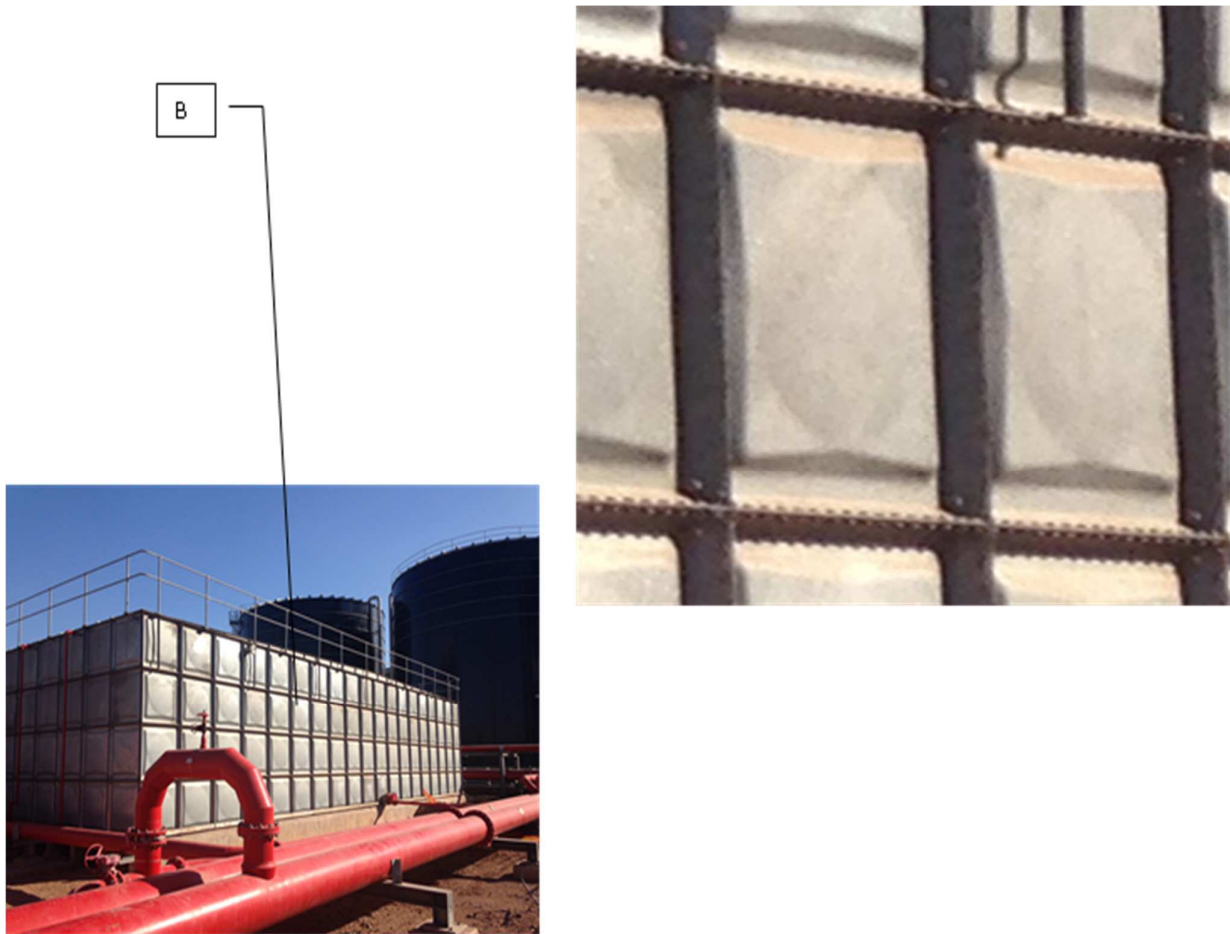


Figure 35

3.6 Cable Racking Labels

Cable rack/tray coding is the identification of cable racks/trays according to the location, voltage level and type of rack/tray. The cable rack/tray number format shall be as follows:

TOTAL PLANT	SYSTEM CODE	EQUIPMENT CODE	UNIT	TYPE OF RACK
0	0 UGB11	BQ101		C&I tray 1
0	0 UGB21	BQ101		LV tray 1
0	0 UGB31	BQ101		MV tray 1

Table 3: cable Rack/Tray Number Format

NOTE: Table 4 above to be used on racks/trays that have not been labelled yet on site, current labelling done already on racks/trays on site to remain as is.

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

The KKS code for the rack/tray to be stencilled and clearly visible from an observation position as shown in Figure 36 below.



Figure 36

The height of the letters used on the KKS code is to be '50mm high and black in colour as shown in Figure 37 below.

Height
50mm { **6 OULC11 BQ123**

Figure 37

The KKS codes are to be placed at 10 m intervals nominally along the length of the horizontal and vertical racks/ trays as well as adjacent to T-junctions as shown in Figure 38 below.

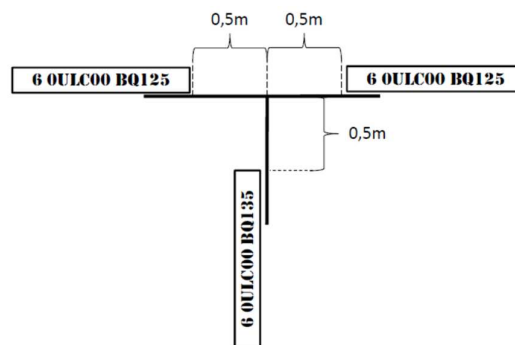


Figure 38

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

When the rack/tray is changing direction or penetrating a floor or wall opening the KKS code is to be placed as shown in Figure 39 below.

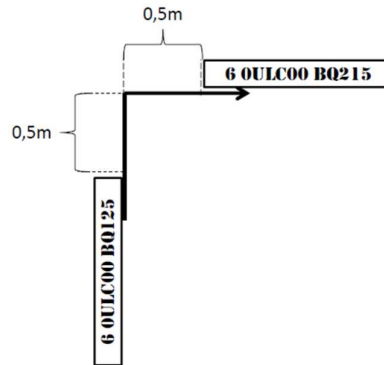


Figure 39

For the stencilling paint specifications for the rack/tray please refer to the Corrosion Protection Specification of Project Alpha.

3.7 Cranes and Crawl Beam Labels

The KKS code for the crane or crawl beam is to be stencilled in black and to be clearly visible from an observation position as shown in Figure 40 below with the height of the text being 50% of the beam height.



Figure 40

For the stencilling paint specifications to be used for the crane or crawl beam please refer to the Corrosion Protection Specification of Project Alpha.

3.8 Stairwells, CAT Ladders and Pipe Supports Labels

3.8.1 Stairwells

Stairwells to be labelled using label Type EM.2. The label is to be installed on stairwell points of entry.

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.8.2 Pipe Supports

Pipe supports to be labelled using any available mechanical label in this specification.

3.9 Cable Labels

3.9.1 Internal Cables

3.9.1.1 Label Type EN




Figure 41

All internal cables to be labeled with standard PVC K Type flexible cable marker carrier strips and attached on both ends with suitable cable ties (T18R or T30R, depending on cable thickness).

3.9.2 External Cables

3.9.2.1 Label Type EP




Figure 42

- a) Label size: 10x90mm
- b) Alphanumeric Characters: 5mm
- c) Material: Stainless Steel
- d) Thickness: 0.6mm
- e) Fixing Holes: 2 holes, size 4mm diameter
- f) All cables must be labeled on both sides of wall and cabinet penetrations.

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.10 Cable Number Structure

The VGB standard of numbering cables shall be used, where Level 1 is coded according to the source, followed by a four-digit counting number. For bidirectional cables, the KKS code of the source or destination which is the earlier in the alphabet of the two termination points shall be used.

CABLE NUMBERS COUNTING RULES

0001 - 0999 = Power cables > 1 kV

1001 - 1999 = Power cables < or = 1 kV

2001 - 3999 = Process cables > 60 V

4001 - 9999 = Process cables < or = 60 V

4001 - 7000 = Control Cables < or = 60V

8001 - 9999 = Control and Instrumentation Cables < or = 60V

Computer cables, i.e. optic fibre, will fall in the "8" series.

To ensure that cable numbers are not duplicated, an additional classification is required. This consists of four alpha characters, the first two (BB) identifying the F1 and F2 functions of the destination of the cable, and the second two (CC) identifying the contractor responsible for the design of the cable.

For example: N NAAANNNN BB CC

3.10.1 Cable Information Capturing

The following table represents the fields within the Cable Database and needs to be captured with each newly allocated or revised cable number.

REF	FIELD DESCRIPTION	WHERE TO FIND THE INFORMATION
1	Drawing Number	Cable detail schedule
2	Drawing Revision Number	
3	Cable Number	Refer to cable number section
4	Cable Type	
5	KKS Code From	Plant KKS
6	KKS Code to	Plant KKS
7	Contractor Identification	
8	Description	Plant description
9	Remarks	Any additional information

Table 4: Cable Database Fields

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

3.11 Plant Descriptions

Although the plant code is sufficient to uniquely identify the plant, the need still exists to describe the plant with a plant functional description. This is especially required when lists of KKS codes are reviewed. The KKS code does not clearly differentiate between e.g. left hand and right hand or between pump inlet and outlet. These problems could be overcome by forcing the users to always refer to the P&ID.

The allocation of item descriptions is useless if it does not clearly describe the function of the item.

On Project Medupi there are a number of applications where plant descriptions are used e.g. plant labels, information systems etc. and the need therefore exists to standardise on the application thereof. This procedure deals with the allocation of descriptions in the two main areas being plant labels and information systems.

3.11.1 Plant Label Description

The need exists to structure the description in such a way that the most meaningful description can be obtained from the minimum number of characters:

- a) Descriptions on plant labels shall be in English
- b) The description shall clearly describe the function of the item
- c) Descriptions shall be as short as possible without compromising on description accuracy
- d) All abbreviations used in descriptions shall be in accordance with the Medupi Power Station Project Standard Abbreviations (348-885912)
- e) All descriptions must adhere to all requirements stipulated in the KKS coding standard (NMP 45-7)
- f) All plant shall be coded as specified in NMP 45-7.
- g) Descriptions shall follow the format as in section 14.2 in conjunction with the equipment list template attached.
- h) Descriptions will only be used once reviewed and approved by Configuration Management on an equipment list.
- i) Descriptions must be in form of the template 348-671390
- j) All descriptions shall be in capital letters

3.11.2 Format and Label Descriptions

The format of the description shall follow the format of the KKS code. It is implicit that the descriptions must always be unique and is compiled as follows:

6 0HDW61 AP001 -M01			
UNIT	SYSTEM	EQUIPMENT FUNCTION	COMPONENT TYPE
THE DESCRIPTION AS FOLLOWS:			
UNIT 6	BOILER ASH REMOVAL	SLUICE PUMP AND HOPPER SEALING PUMP 1	MOTOR

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

Table 5

Example for common plant:

00GKB18 GK001 –H01			
UNIT	SYSTEM	EQUIPMENT FUNCTION	COMPONENT TYPE
THE DESCRIPTION AS FOLLOWS:			
–	POTABLE HEADER TANK	LOCAL CONTROL PANAL	ALARM UNIT

Table 6

4. Process for Monitoring

4.1.1 Revision Period

All QMS documents shall undergo a 3-yearly compulsory revision.

4.2 Training Requirements

No project specific training required to implement the process documented in this document beyond normal job function.

5. Acceptance

This document has been seen and accepted by:

Name	Designation
Mandla Nkosi	CM Line Manager
Mduduzi Dhlamini	CM Snr Technician

6. Revisions

Date	Rev.	Compiler	Remarks
July 2022	6	M Dhlamini	<ul style="list-style-type: none"> Document is due for the 3 yearly review.
October 2017	5	X Gubuza	<ul style="list-style-type: none"> Document is due for the 3 yearly review.
December 2015	4	R Smal	<ul style="list-style-type: none"> Changed the document from a procedure to a standard to conform to the Medupi QA requirements. Remove RACI, KPA/KPI's and self-assessment. Some typographical improvements made. Duplicate information removed. Label material grades added. Engraving font added.

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

7. Development Team

The following people were involved in the development of this document:


- Mandla Nkosi
- Mduduzi Dhlamini

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

Appendix A – MV, LV & DC Switchgear Label Positions

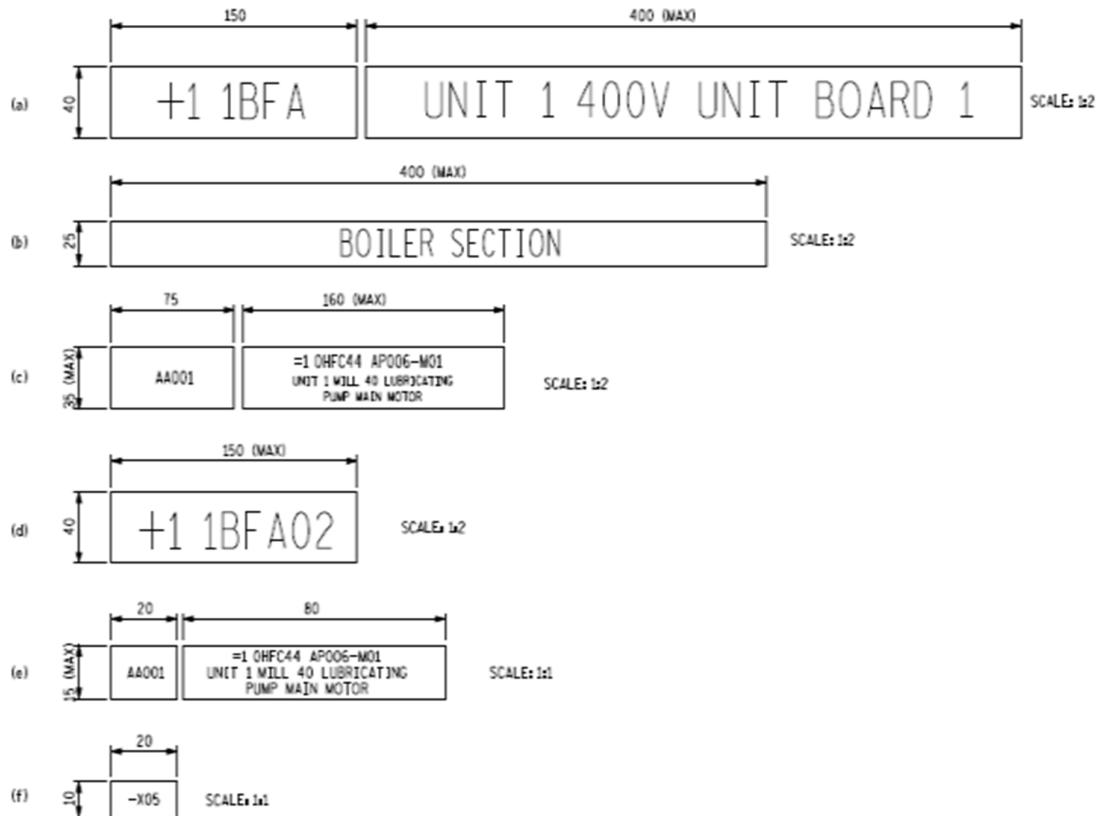


CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

Note: Label panels as per example:

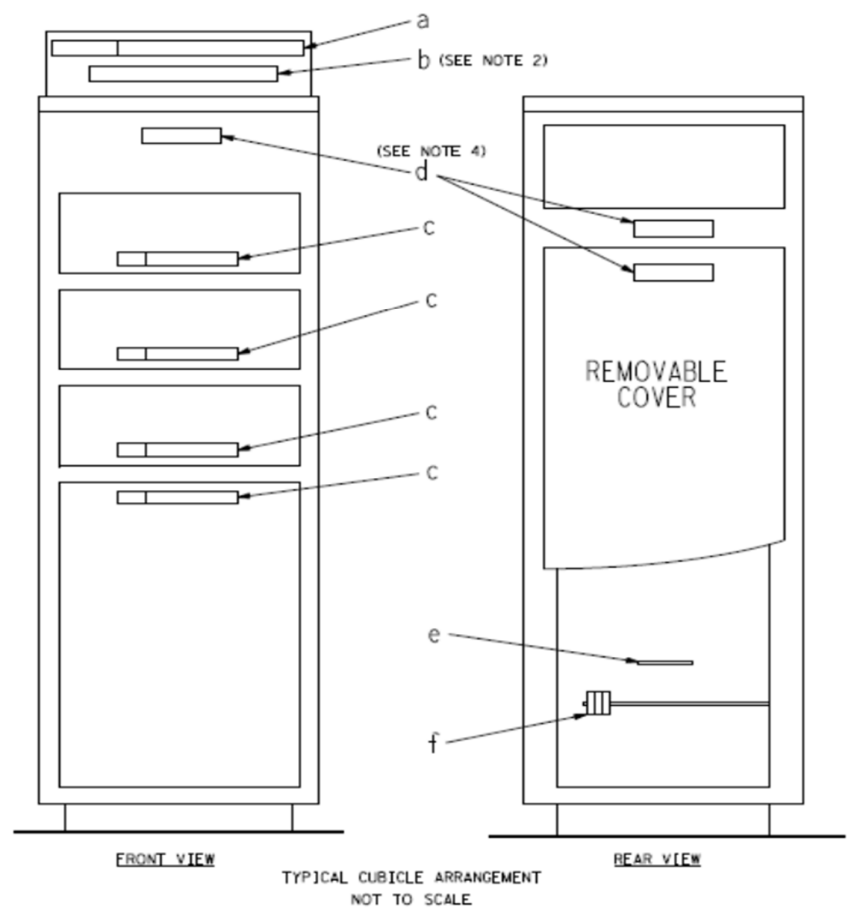

Label type EJ (To be used with label type EE)

BA	001	002	003	004	005	006	007	008	009	010	011	012	013	014	015


CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

MINIATURE CIRCUIT BREAKERS

Use label type EE for MCB process identification, applied with label type EJ

BA001	=1 0EYG11 GA106 FIELD MARSHALLING PANEL
BA002	=1 0EYG11 GA115 FIELD MARSHALLING PANEL
BA003	=1 0EYG11 GA107 FIELD MARSHALLING PANEL
BA004	=1 0EYG11 GA114 FIELD MARSHALLING PANEL
BA005	=1 0EYG11 GA130 FIELD MARSHALLING PANEL
BA006	
BA007	
BA008	
BA009	
BA010	
BA011	
BA012	
BA013	
BA014	
BA015	

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd, Reg. No 2002/015527/30.

Appendix B - Process Self-Assessment Checklist

See Labelling List Template (348-671390) below:

[illegible]

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system.

No part of this document may be reproduced without the expressed consent of the copyright holder, Eskom Holdings SOC Ltd,
Reg. No 2002/015527/30.