

DOOR SCHEDULE.

DOOR NO.	QUANTITY	HAND AND WALL THICKNESS	FRAME/DOOR TYPE	DRG NO. SHEET NO.
D1	1	115 230/280 115 230 230 115 230/280	DF19	19
D2	1		DF39	39
D3	1		DF 25	25

ALL DOORS MARKED * TO HAVE 'RYOBIG' DOOR CLOSERS

MASTERKEYS (ALL CYLINDER LOCKS TO BE MASTERKEYED)
CONSTRUCTION - REF. - C.A.F.F.
PERMANENT - REF. - T.N.E.A. SUB. - S.L. T.2 A

FACTORY INSPECTORS SCHEDULE

ROOM NO.	DESIGNATION	FLOOR AREA M ²	WINDOW AREA M ²	AIR OPENING COND.	ILLUMIN. LUX.	GLAZE INDEX	NUMBER PERSONS	% NAT. LIGHT
19	BATTERY ROOM	184.80	-	YES	160	26	2	2
20	D.C. EQUIPMENT ROOM	144.50	-	YES	200	22	2	2

NOTE


AIR CONDITIONING OPENINGS
AIR CONDITIONING OPENINGS TO BE CHECKED ON SITE WITH AIR CONDITIONING CONTRACTOR FOR POSITION AND SIZES.

CONCRETE FINISH
ALL EXPOSED CONCRETE WORK TO BE SMOOTH OFF SHUTTER FINISH.

ALL DIMENSIONS, LEVELS ETC. TO BE CHECKED ON SITE BEFORE ANY WORK IS COMMENCED.

SAFETY SHOWER
SAFETY SHOWER TO BE SUPPLIED BY BUILDING CONTRACTOR AND INSTALLED BY BUILDING CONTRACTOR.

NOTE
Safety shower as supplied by mine safety equipment co. or equal.

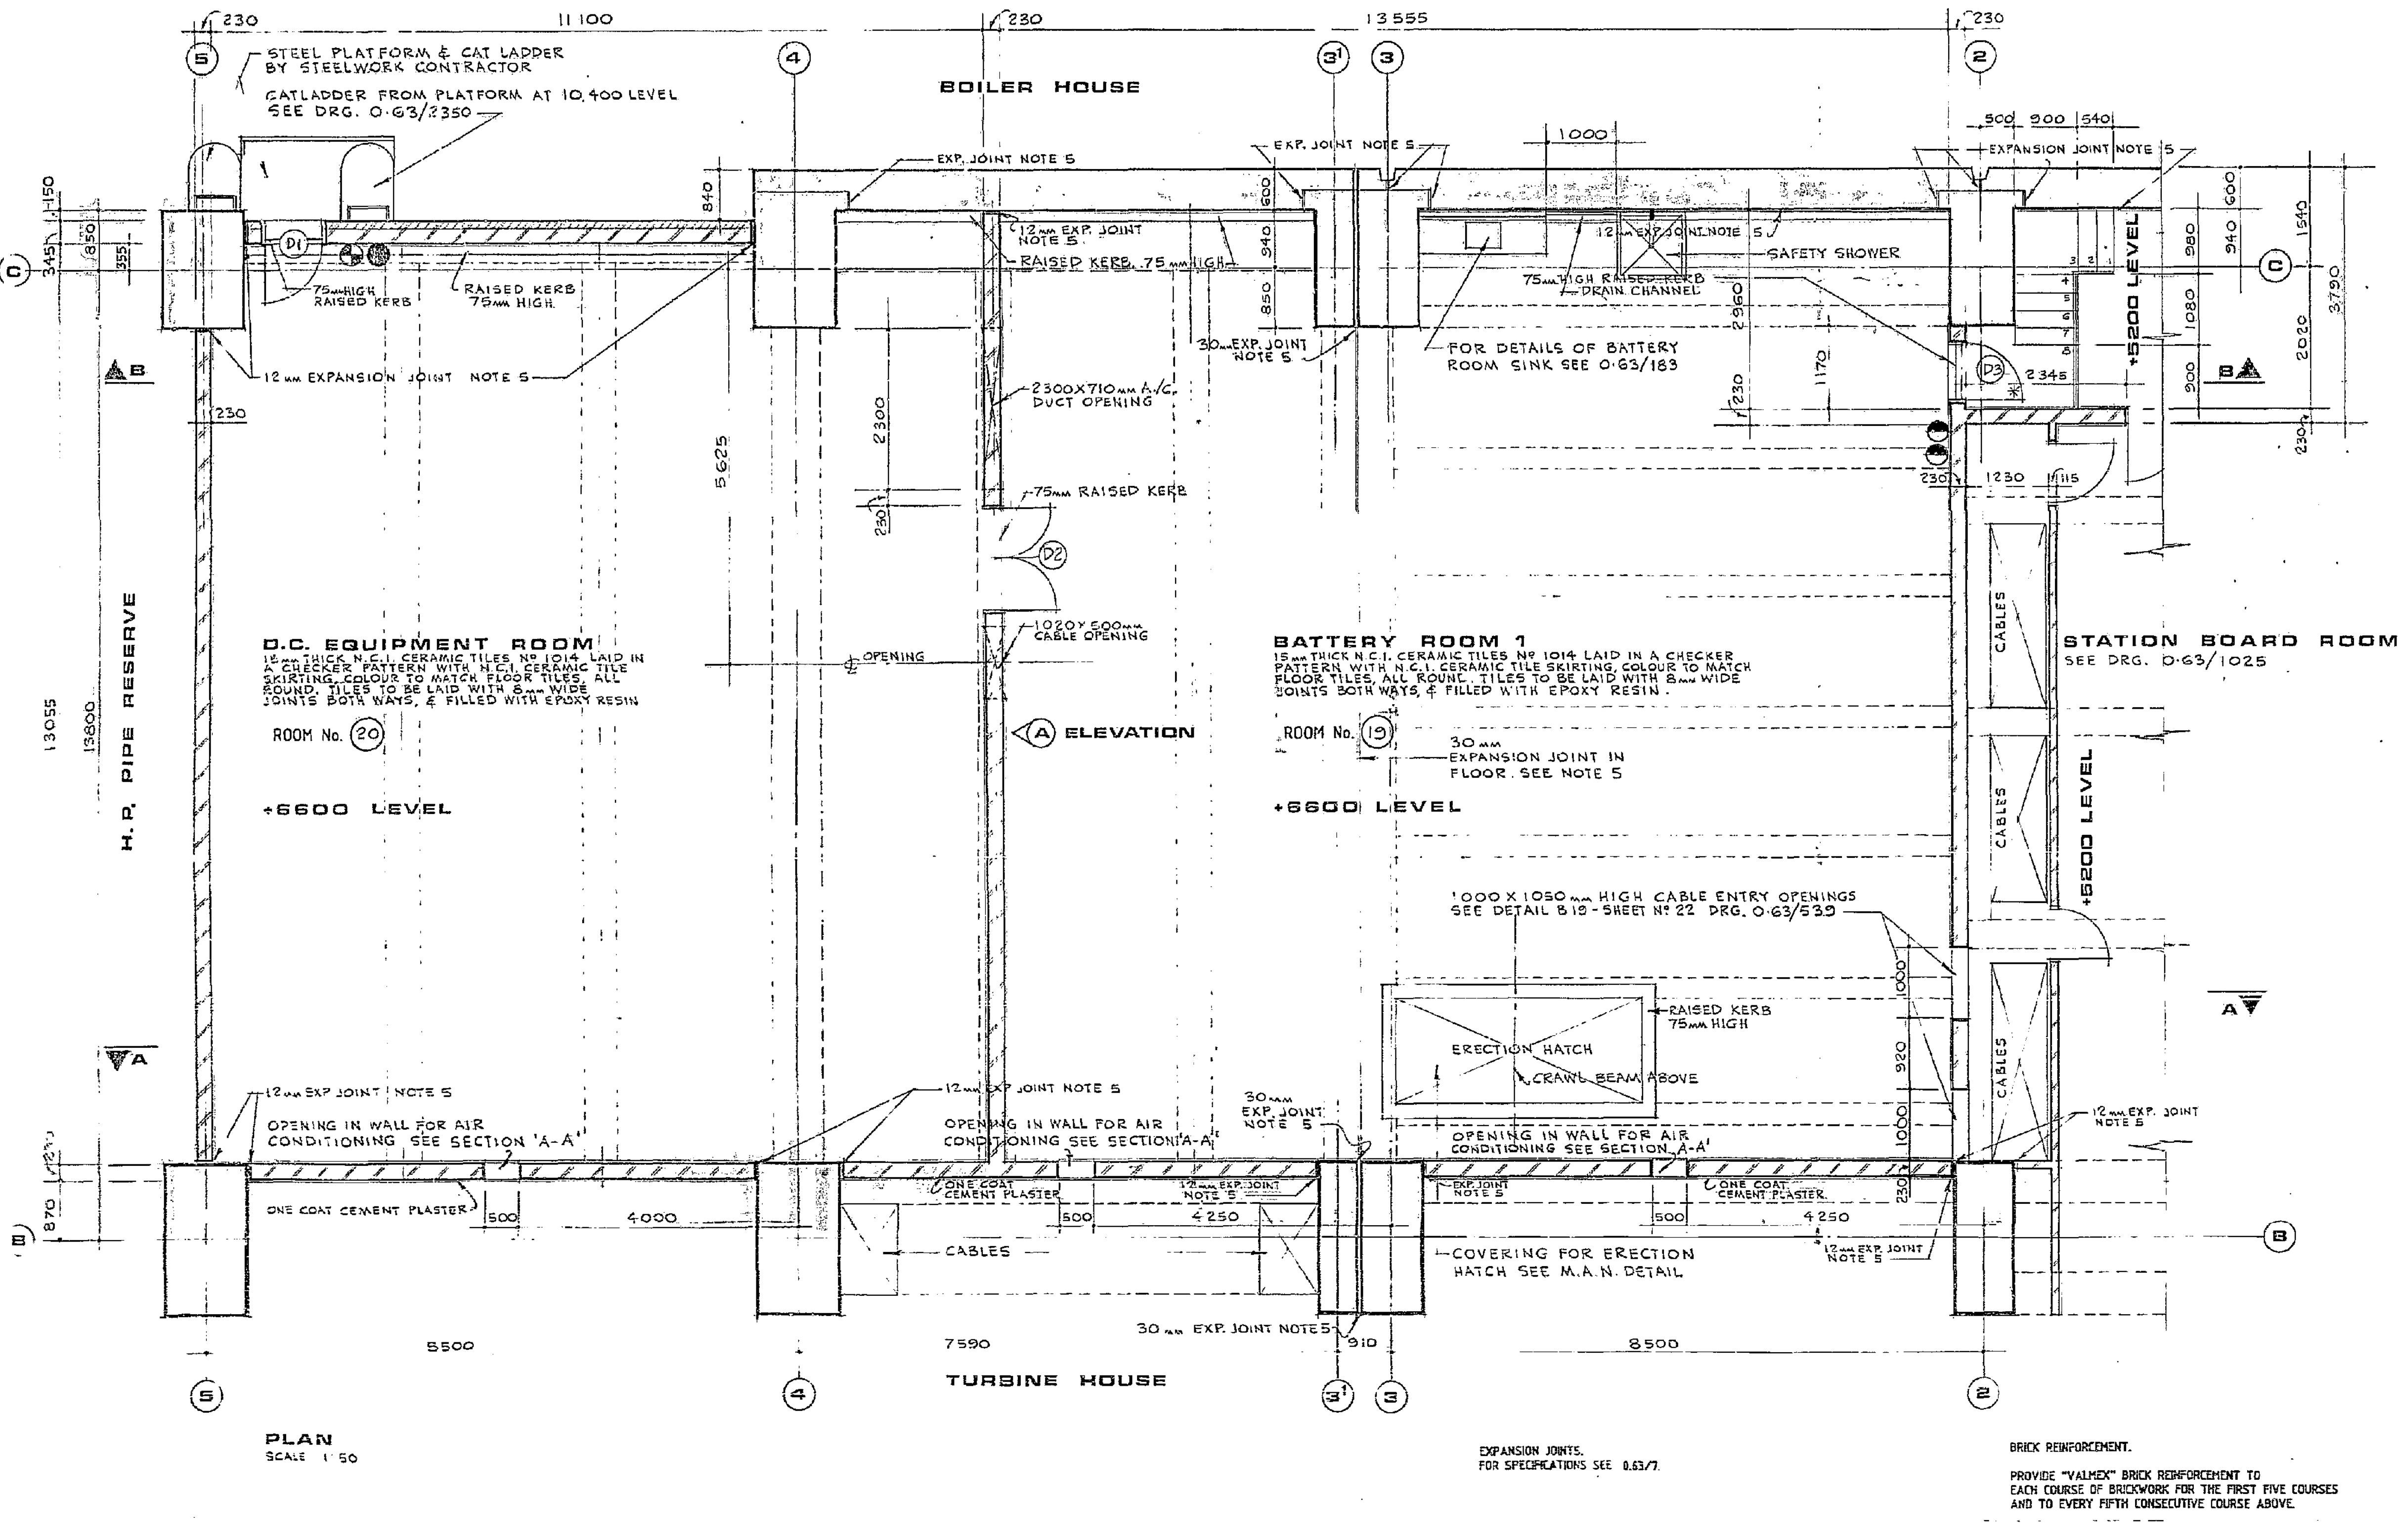

LOOSE FIRE CONTROL EQUIPMENT

5 kg DRY POWDER
4.5 kg CO₂
HOSE REEL
9 kg CO₂

ALL TYPES OF EXTINGUISHERS SHALL BE CO₂ OR GENERAL PURPOSE DRY POWDER. ALL EXTINGUISHERS SHALL BE COMPLETE WITH A CARRYING HANDLE, WALL MOUNTING BRACKET, TUBE AND NOZZLE AND SHALL BE EASILY RE-CHARGEABLE.

EXTERNALLY LOCATED EXTINGUISHERS SHALL BE MOUNTED IN A WEATHERPROOF WALL MOUNTED CABINET WITH A LOCKED DOOR HAVING A KEY IN THE DOOR BEING A BREAK-GLASS COMPARTMENT.

KEY SECTION

REVISIONS

NO.	DATE	REVISIONS	BY	CHKD.	DATE	REVISIONS	BY	CHKD.
1	1974	CRANK BEAM ADDED	E.H.					
2	1974	ISOLATED TILES ADDED	E.H.					
3	1974	NOTES ADDED	E.H.					
4	1974	NOTES ADDED	E.H.					
5	1974	NOTES ADDED	E.H.					
6	1974	NOTES ADDED	E.H.					
7	1974	NOTES ADDED	E.H.					

ESKOM • EYKOM
LETHABO POWER STATION
AUXILIARY BAY UNIT 1
BATTERY ROOM DETAILS.

0-63/2349