



1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16

A  
B  
C  
D  
E  
F  
G  
H  
I  
J

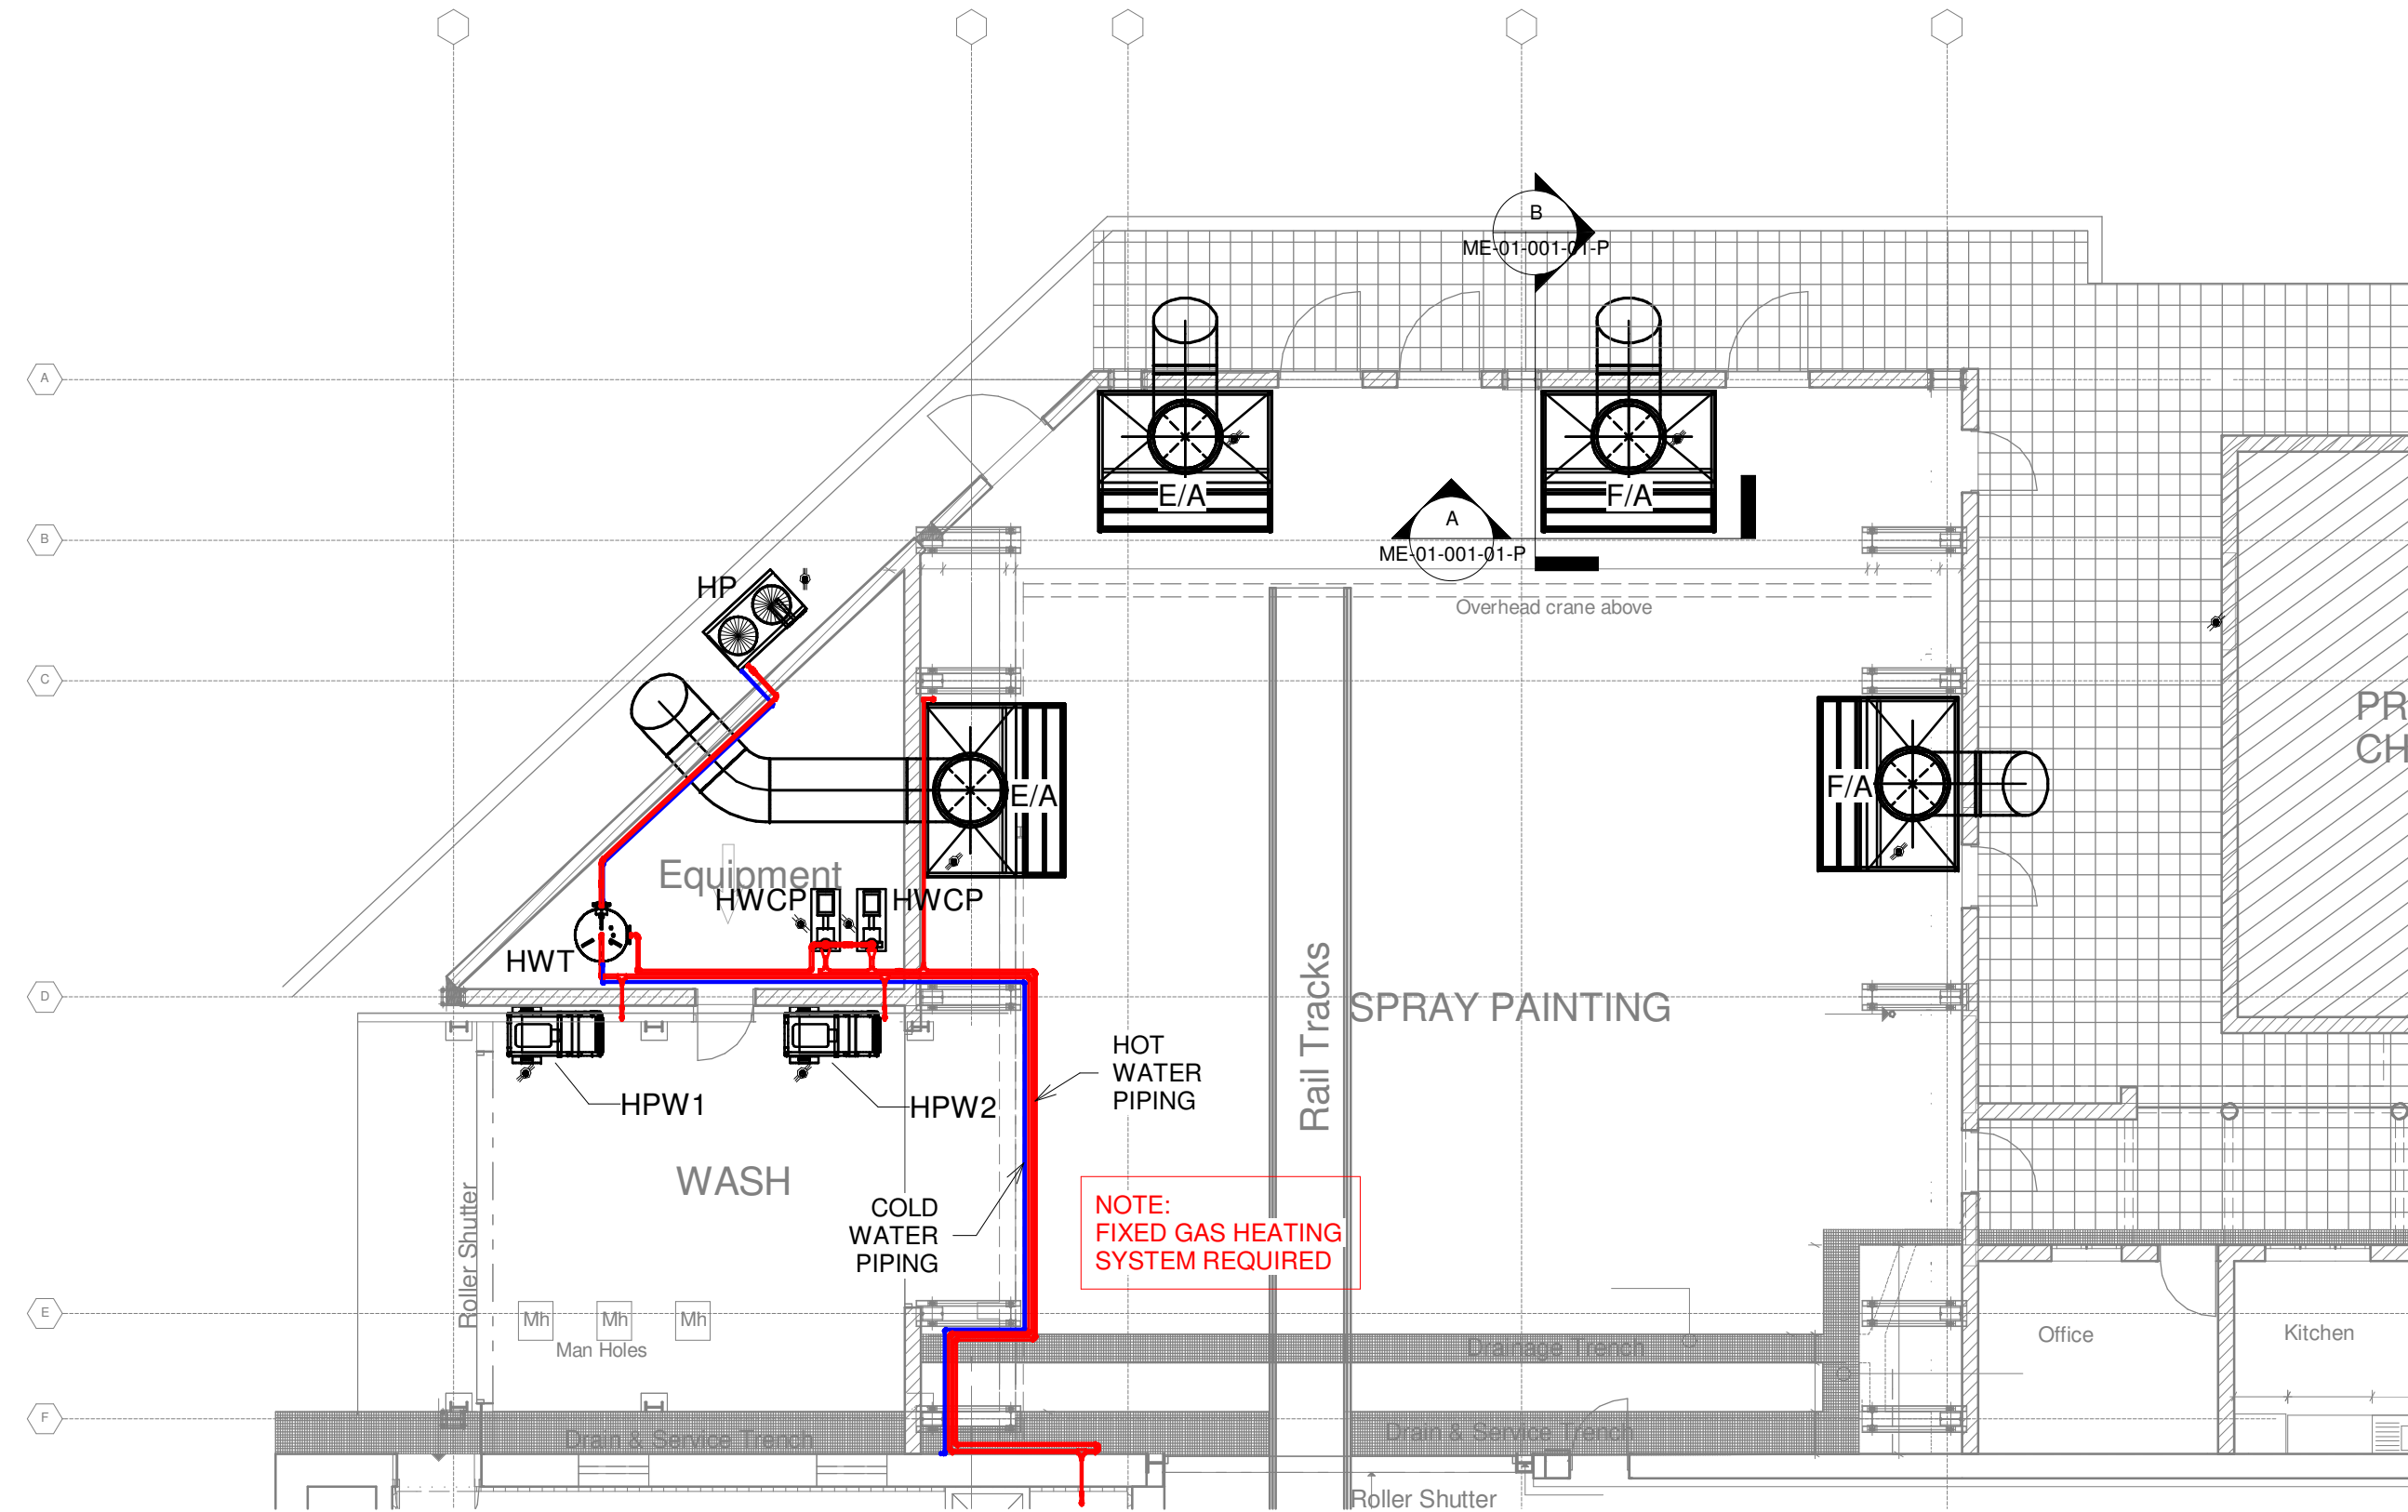



1 SPRAY PAINTING MECHANICAL EQUIPMENT LAYOUT  
1 : 100

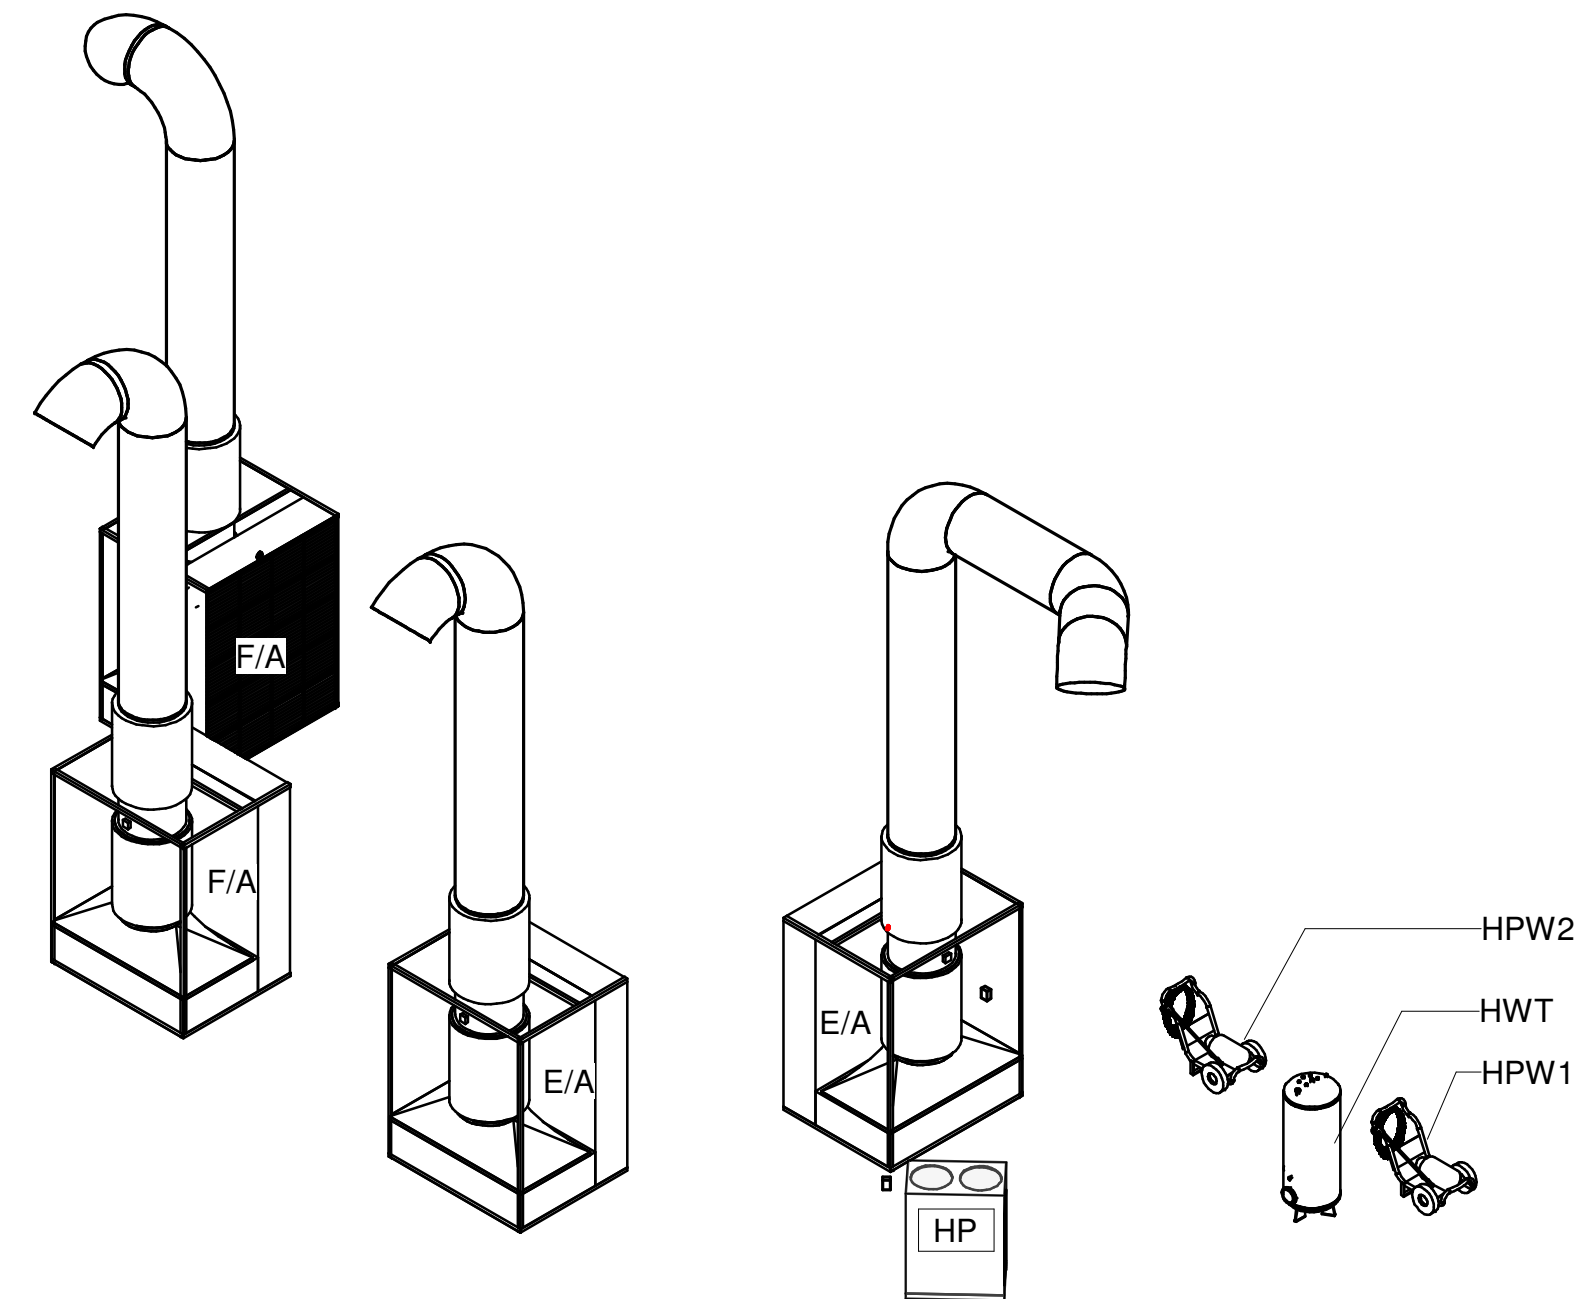

2 SPRAY PAINTING - 3D VIEW

LEGEND

TAG	DESCRIPTION	INPUT POWER (kW)	SUPPLY VOLTAGE	QTY
SPB	SPRAY PAINTING BOOTH	N/A	N/A	2
F/A	FRESH AIR FAN c/w PLENUM & FILTER BOX	30	400V/3PH/50Hz	2
E/A	EXTRACT AIR FAN c/w PLENUM & FILTER BOX	30	400V/3PH/50Hz	2
HP	HEAT PUMP	48	400V/3PH/50Hz	1
HWCP	HOT WATER CIRCULATION PUMP	0.165	230V/1PH/50Hz	2
HWT	HOT WATER TANK	16	400V/3PH/50Hz	1
HPW	HIGH PRESSURE WASHER	6	400V/3PH/50Hz	2
1	1 PHASE POWER SUPPLY	-	-	-
3	3 PHASE POWER SUPPLY	-	-	-

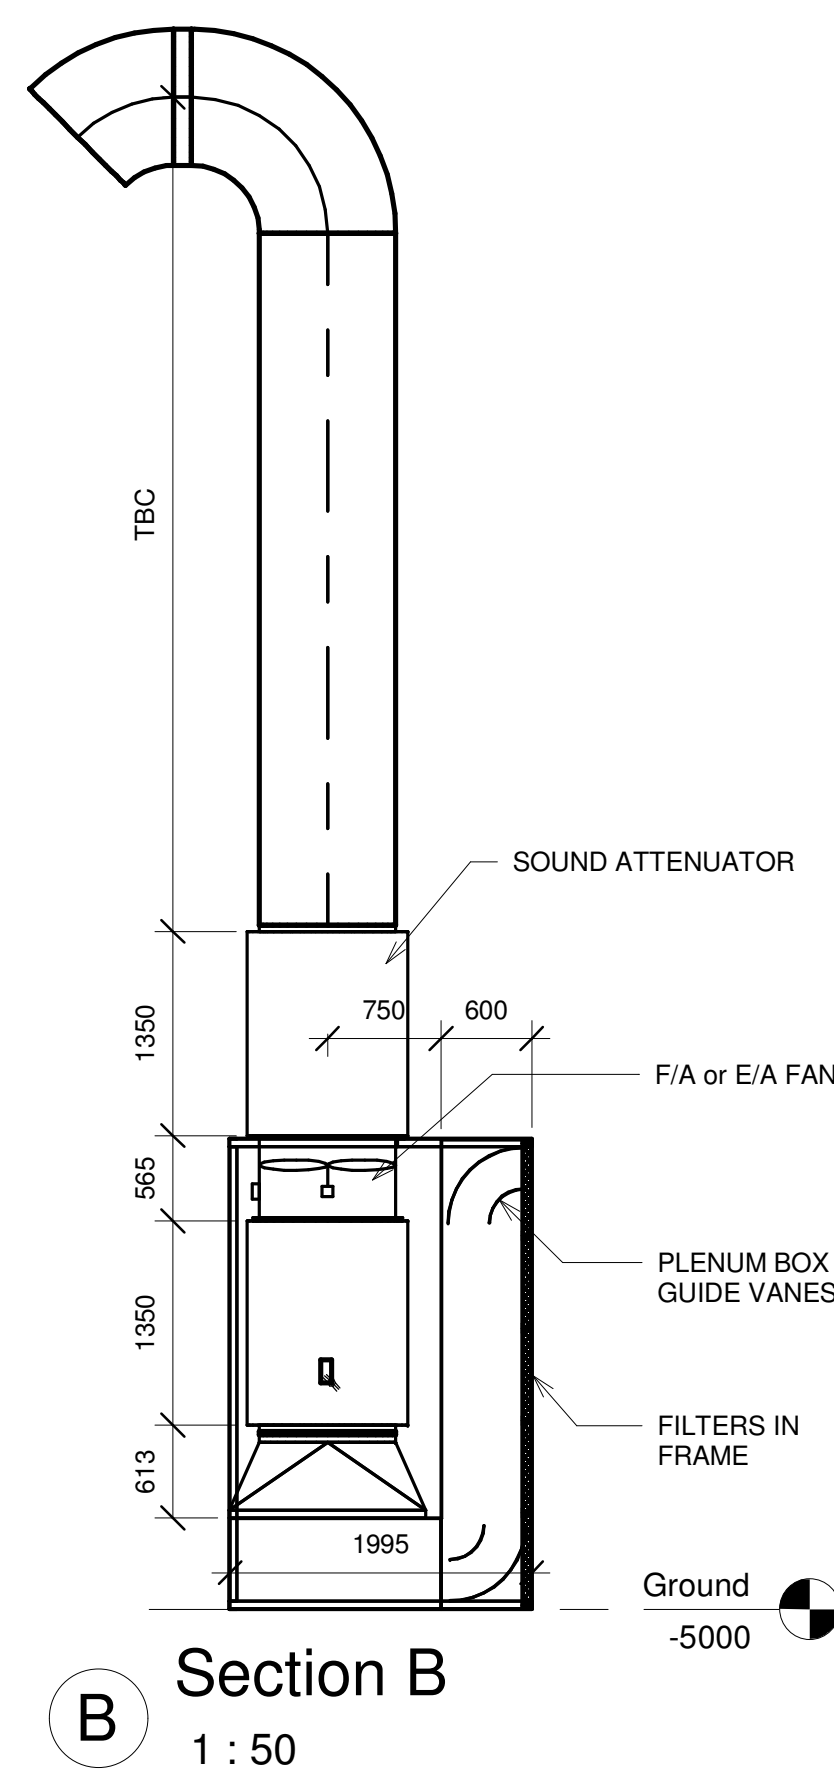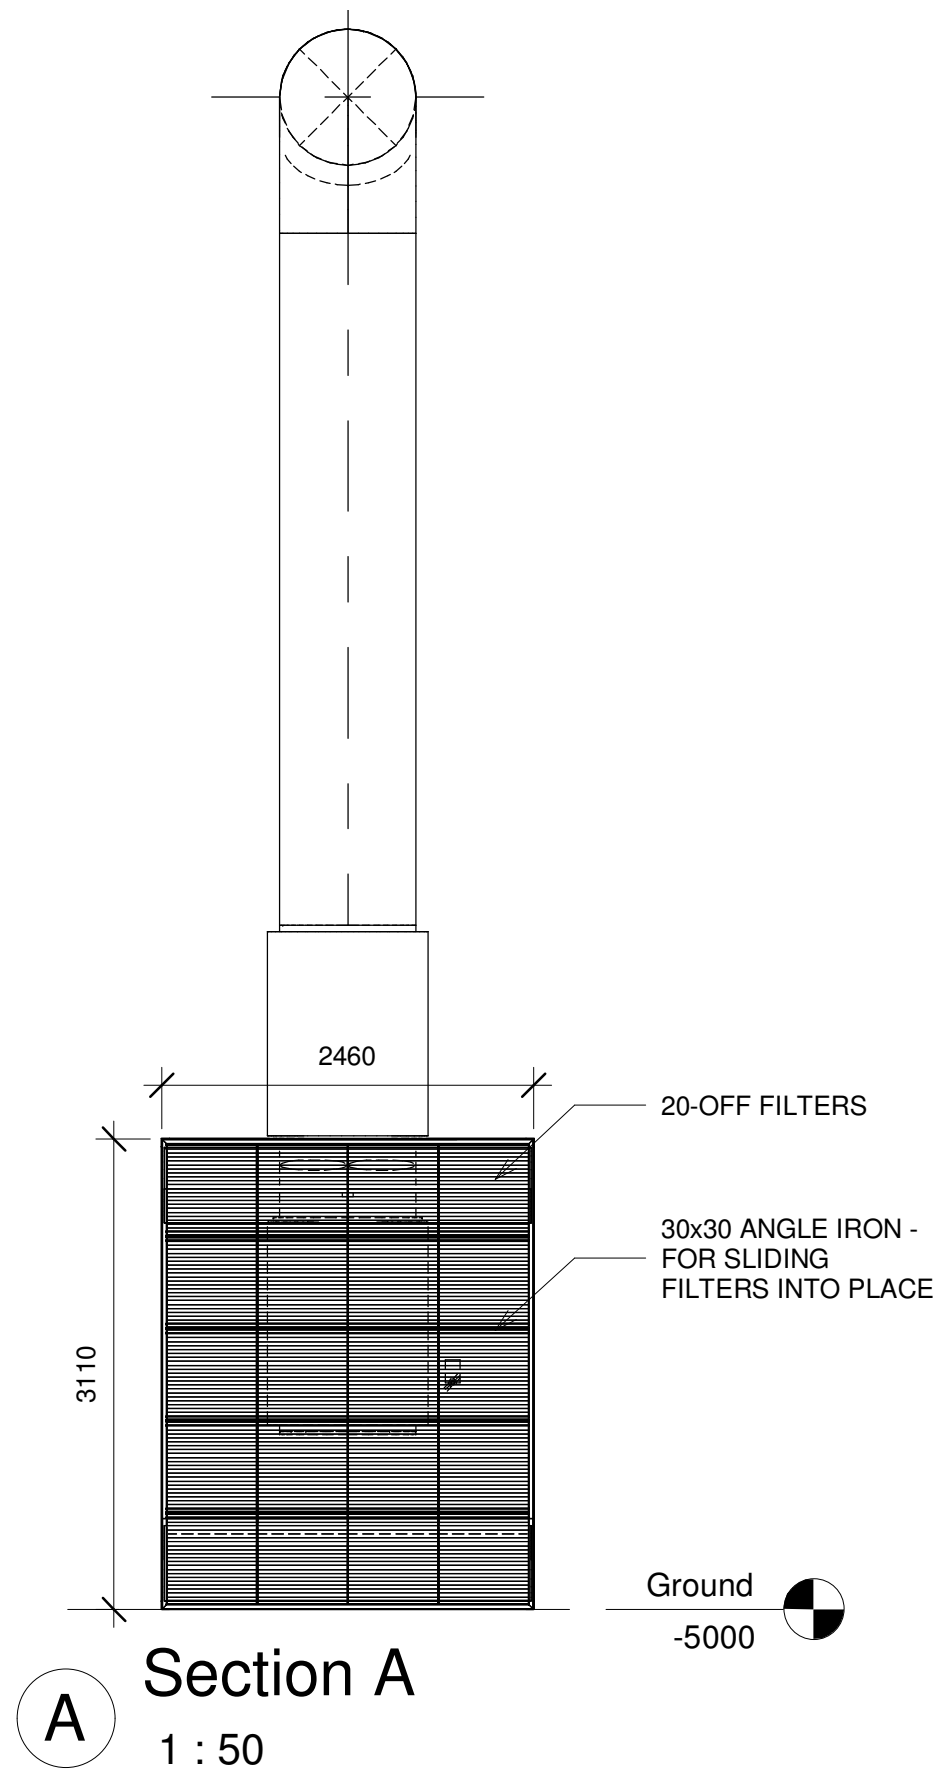

B	ISSUED FOR INFORMATION	MH	NM	NM	05-12-2024
A	ISSUED FOR INFORMATION	MH	NM	NM	13-11-2024
REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE
DRAWN BY	SIGN	DATE	PROJECT NAME:	Rosherville Rotek Industries	
ENGINEER	NM	05-12-2024	JOB NAME:	CHEMICAL STORE RENOVATION	
CHECKED	NM	05-12-2024	Drawing Description:	SPRAY BOOTHS MECHANICAL EQUIPMENT	
APPROVED	NM	05-12-2024	ROLWA DRAWING No:	ME-01-001-01-P	
CLIENT DRAWING No:					SHEET:
CONTACT INFORMATION:					OF:
ADDRESS: 10 FORT STREET 4300VLS SANDTON 2193 TEL: 01102390381 CELL: 0712431113 FAX: 0875673038 EMAIL: info@rolwa.co.za					
CLIENT:					
ROLWA ENGINEERING CONSULTANTS CC					
Eskom					

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16