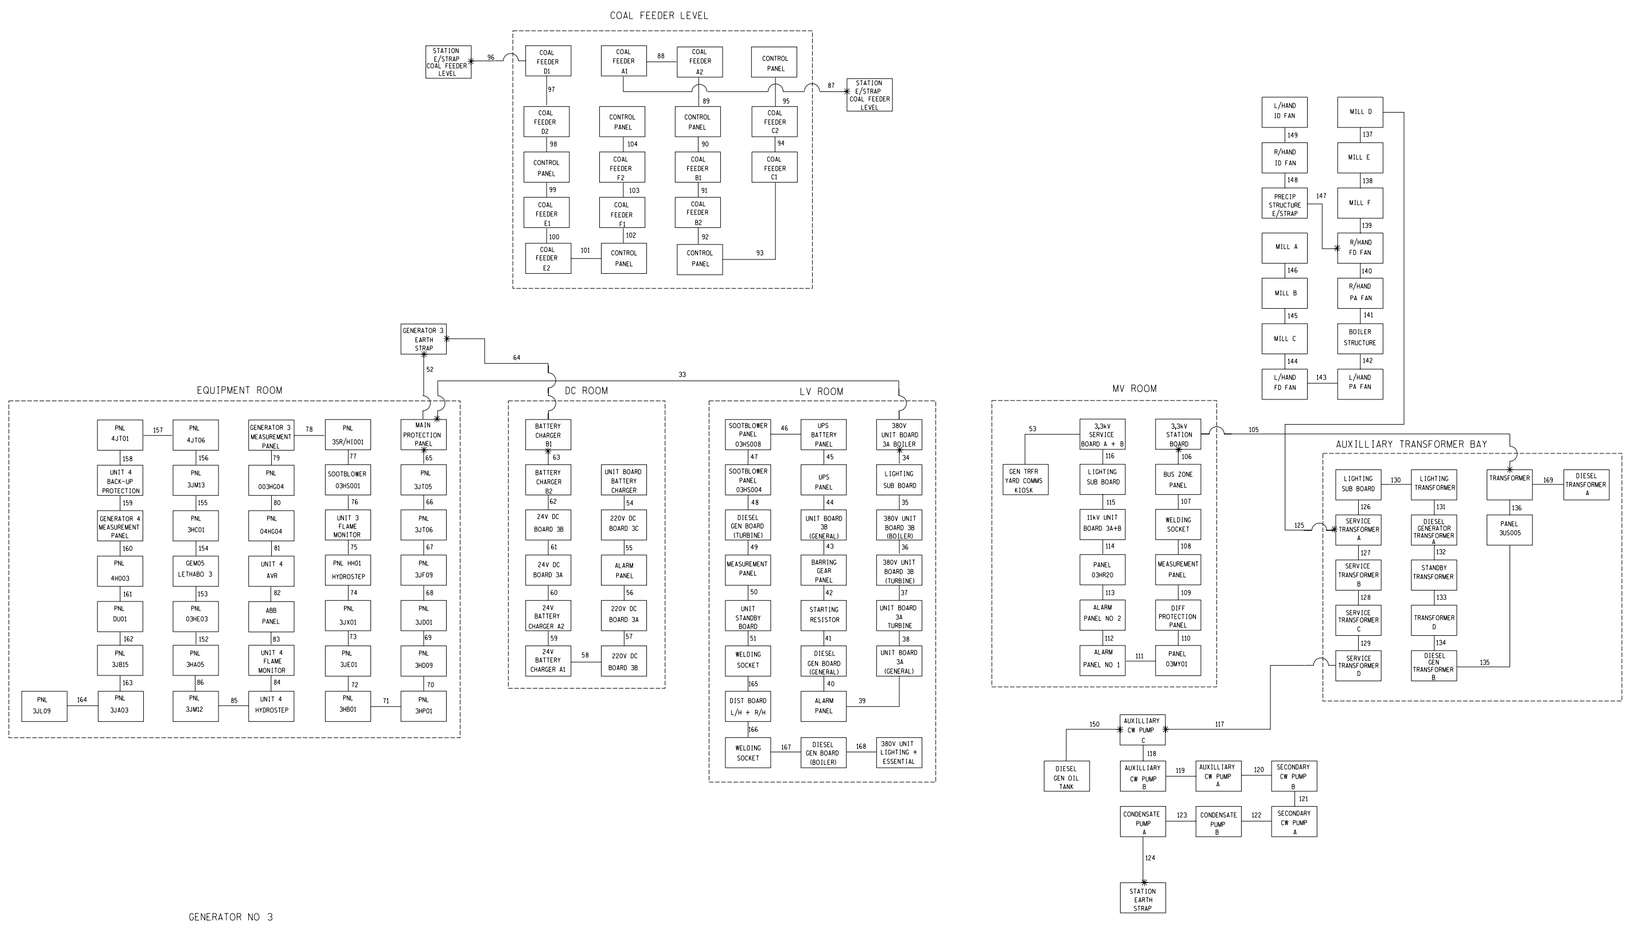

* LETHABO POWER STATION EARTH MAT CONTINUITY TEST REPORT IS AVAILABLE ON THE DOCUMENT CONTROL SYSTEM:-
ENGINEERING ⟶ DESIGN_SPEC ⟶ EARTHING

DATE TESTED	TESTED BY	SIGNATURE	REMARKS
2003.10.30	D FOURIE		REPORT PS/R/03/11/02
2005.11.21	JG STEYN		REPORT TSK 78565

D.O.	REV	DATE	** REVISION **	REV BY	CHKD BY	AUTH BY	KKS APP	REFERENCE DRAWINGS
CR 6798	1	04.01.2006	UPDATED - TESTED ON 21.11.2005	HM	ZJ	HJvS		
DR 696	0	12.02.2002	FIRST ISSUE	HM	MH	HJvS		23.63/54110-54118
							23.63	

INDEX REFERENCE :

DRG REGISTR	17 10 2001	DR696
DEF NO		
KKS APP		
AUTH BY	12 02 2002	HJvS
CHKD BY	12 02 2002	MH
DRAWN BY	12 02 2002	HM
SCALE	N.T.S.	

APPROVED BY : HJ v STADEN 12.02.2002
AUTHORISED BY :

ESKOM HOLDINGS LTD. REG.No. 2002/015527/06

LETHABO POWER STATION

EARTHING CONTINUITY DIAGRAM UNIT 3

Eskom

23.63/54915

REV 01

THIS DRAWING HAS BEEN CREATED ON A C.A.D. SYSTEM. ANY AMENDMENT MUST BE EFFECTED ON THE SAME SYSTEM.

SIZE A0 LANDSCAPE