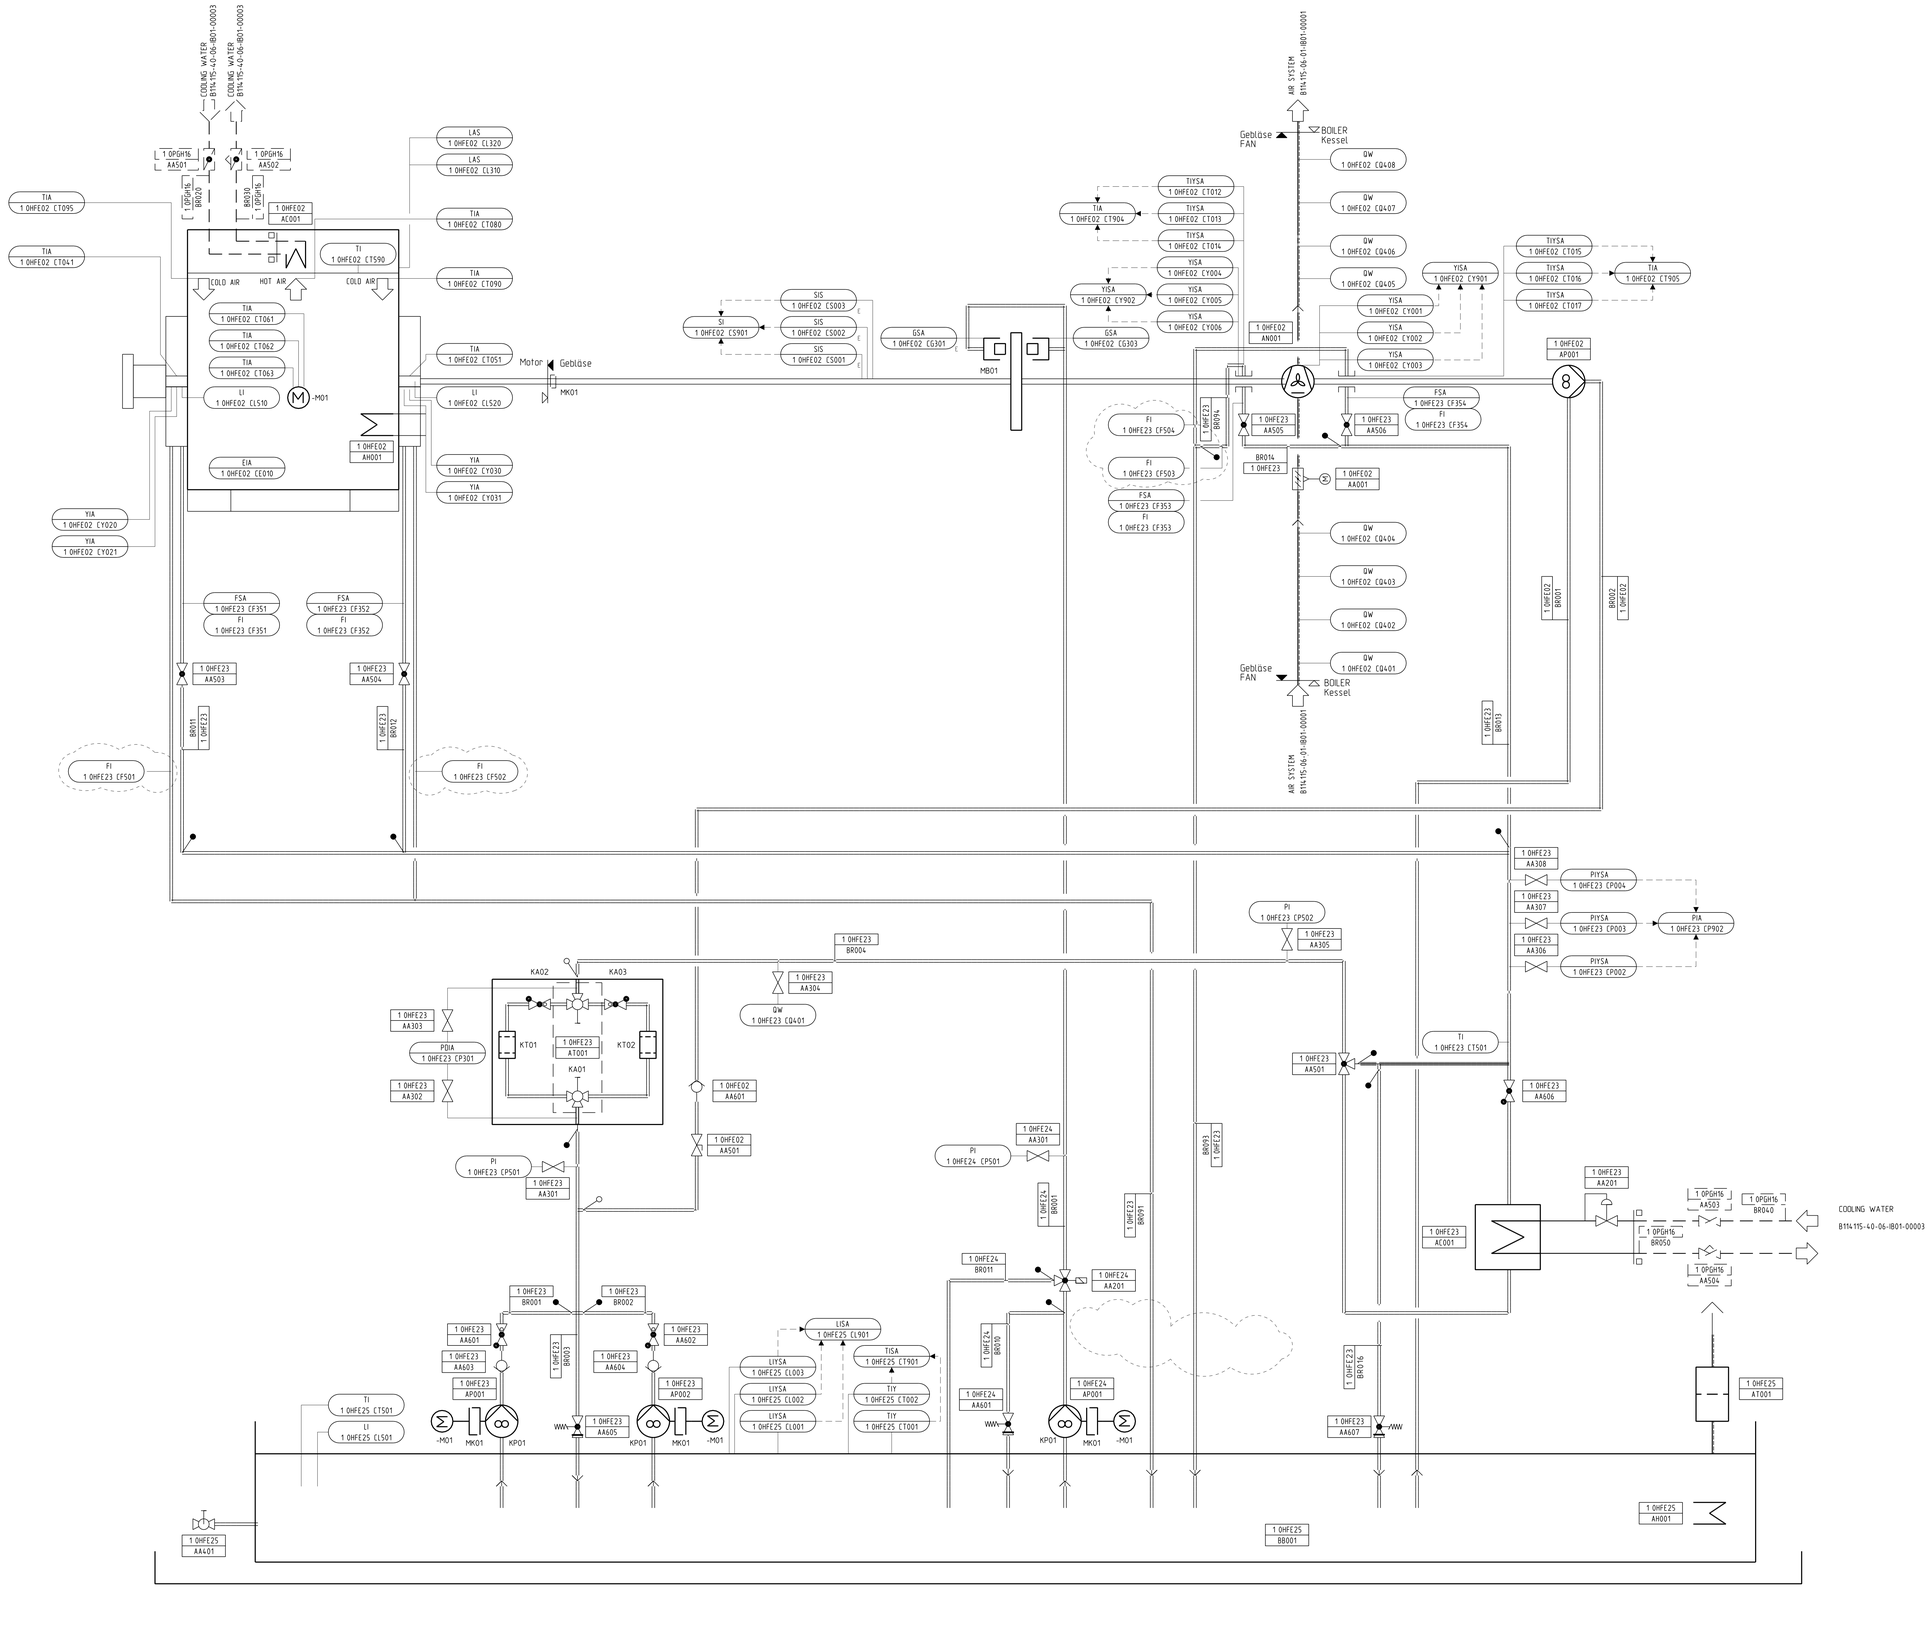

DRAWN BY	HOWDEN — Howden Power PO Box 9581 Johannesburg 2000 South Africa. Tele +27 11 248 4000 Fax +27 11 493 3580 web www.howden.com
DATE	
CHK'D BY	
APPROVED	HITACHI POWER EUROPE KUSILE POWER STATION
PROC.ENG.	PA FAN P & I DRAWING
	DRAWING NUMBER C1-732-007463 — SHEET 1/1 — REV. 0

Limits of Supply

ESKOM — Boiler Contractor

Internal Limits of Supply of Boiler Contractor

- Balance of Plant
- Boiler
- Boiler Components

C&I SCOPE IN ACCORDANCE WITH THE C&I LOSS DIAGRAM

Reference Drawings

ID HPE	Eskom ID	Drawing Description
B114-115-40-06-IB01-00003	0.90/1131	CLOSED COOLING WATER SYSTEM
B114-115-06-01-IB01-00001	0.90/1346	AIR SYSTEM

AG	09/01/12	MEASUREMENTS ADDED	P.S	Schu	Rad
AF	03/11/10	KKS NUMBERS, PRESSURE MEASUREMENT CHANGED	P.S	Schi	Rad
AE	03/11/10	TEMPERATURE MEASUREMENTS MOTOR DELETED	P.S	Schi	Rad
00	06/08/08	FIRST ISSUE	Moll	Schi	Rad
D.O. REV.	DATE	** REVISION **	REV. BY	CHKD BY	AUTH BY	KKS APP.

INDEX REFERENCE : ----------

ORG. REGISTR.	..	ENGINEER	DATE
DESIGN APPROVED	..	Rad	.. .. ..
KKS APP.	..		
ISO AUTH.	..		
CHKD BY	06/08/08	Schi	
DRAWN BY	06/08/08	Moll	
SCALE	----------		

HITACHI Inspire the Next — Hitachi Power Africa (Pty) Ltd
HITACHI Inspire the Next — Hitachi Power Europe GmbH
Eskom Enterprises

Kusile Power Station
P&I-Diagram
BOILER HOUSE UNIT 1-6
PA-FAN LANE 2

B114115-06-12-IB01-00004-AG

0.90/1345 — TYPE — SHEET 7 — REV. –

VIEW

THIS DRAWING HAS BEEN CREATED ON A CAD SYSTEM. ANY AMENDMENT MUST BE EFFECTED ON THE SAME SYSTEM

This drawing shall neither be duplicated, transferred nor revised without our prior written approval. It shall not be made available to third parties. Any and all rights in accordance with the German Law on Copyright (UrhG) and German Act against unfair practices (UWG) shall remain unaffected.

SIZE GROOTTE A0