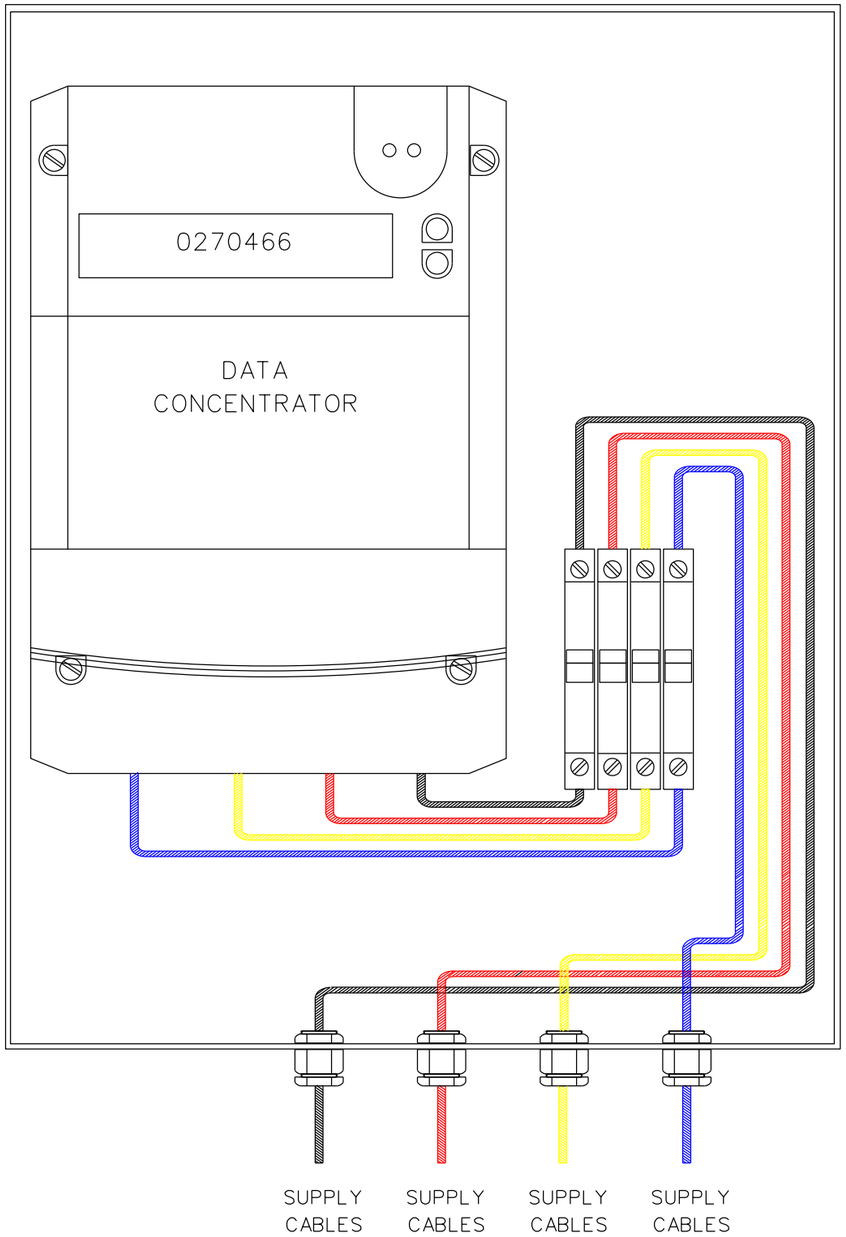

LEGEND	DESCRIPTION	EQUIPMENT
	CIRCUIT BREAKER HYDRAULIC MAGNETIC SINGLE PHASE	CBI: HY-MAG 10A TYPE QF1-13D, QF1-18D or SIMILAR, DIN RAIL MOUNTED
——	WIRING	1.5 SQUARE COLOUR CODED UV STABILISED PVC INSULATED CABLE, RATED VOLTAGE 600/1000V, SABS 1507
	COMPRESSION GLAND NO 1	SAP 0168367, D-DT-3070

NOTES:

1. THE SUPPLY CABLE SHALL BE 16mm2, BLACK, INSULATED CU WIRES AND 1.5m LONG.
2. A HGH STREGTHPALSTIC COMPRESSION CABLE GLANDS SHALL BE PROVIDED.
3. THE MCBS SHALL BE FITTED ONTO A DIN-RAIL.
4. THE DC SHALL BE FITTED TO THE KIOSK USING A DIN RAIL.

3rd ANGLE

REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	PROJECT NO.

Eskom

AUTH:
DATE:
CHKD:
DATE:
DRAWN: J.SHINTA
DATE: 21/07/2025

DATA CONCENTRATOR KIOSK
SECURE POLE TOP
MANUFACTURING DETAIL:
EQUIPMENT LAYOUT

D-DT-1049

SET	SHEET	REVISION
3	3	A

SIZE
GROOTTE A3L