



NEUTRALS OF EQUIPMENT MOUNTED ON EARTHED STEELWORK

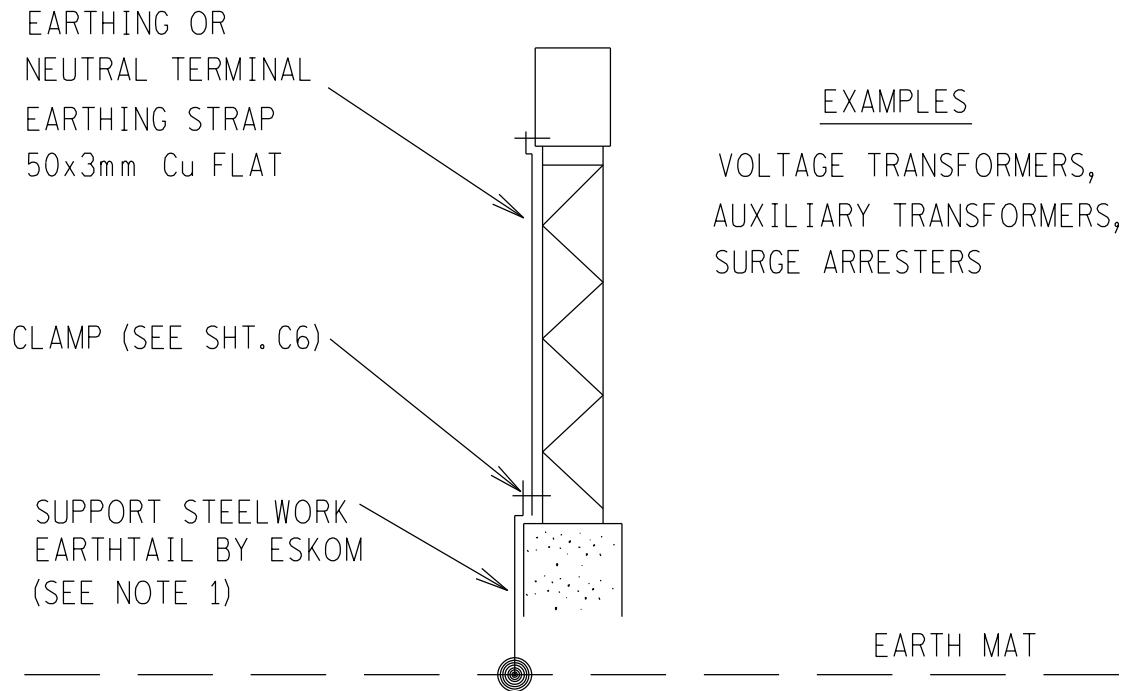

NOTE:

1. SUPPORT STEEL EARTHING. NUMBER OF EARTHING CONNECTIONS TO EARTH MAT AS PER CABLING AND EARTHING SPECIFICATION FOR STATION.
2. FOR SURGE ARRESTERS FITTED WITH DISCHARGE COUNTERS SEE SHEETS T8 & T9.
3. FOR SURGE ARRESTERS EARTH STRAP TO BE RUN AS STRAIGHT AS POSSIBLE.
4. SEE SHEET 14, 14A, 14B FOR EARTHING OF SURGE ARRESTERS WITH PROVISION FOR CONDITION MONITORING DEVICE.

2	NOTE 4 ADDED.	E.G.	P.C.B.	I.HILL	25.05.07	
1					17.3.1989	
REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	REFERENCE DRAWINGS
APPROVED BY L.RYAN		<div></div>			ESKOM HOLDINGS LIMITED REG NO. 2002/015527/06	
DATE FEB 1988						
CHECKED BY		<div>EARTHING STANDARDS</div> <div>©</div>				
DATE						
DRAWN BY						
DATE						
SCALE: N.T.S.		0.54/393			SHEET NUMBER T5	REVISION 2