


NOTE:

1. ALL PIPES TO BE HDPE TYPE IV CLASS AS SPECIFIED
2. ALL FITTINGS TO BE PLASSON COMPRESSION FITTINGS
3. PIPE TO BE LAID 1,0m DEEP BUT 0,5m AT FITTINGS
4. PIPE ROUTE TO BE MARKED AT ALL CORNERS AND EVERY 500m WITH A CONCRETE POLE (PRECAST) 1,0m HIGH PAINTED YELLOW

375x300 VALVE BOX No B 0941
 TYPE 5, TO SANS 558, INTERNAL
 DIM. OF CHAMBER 600x600

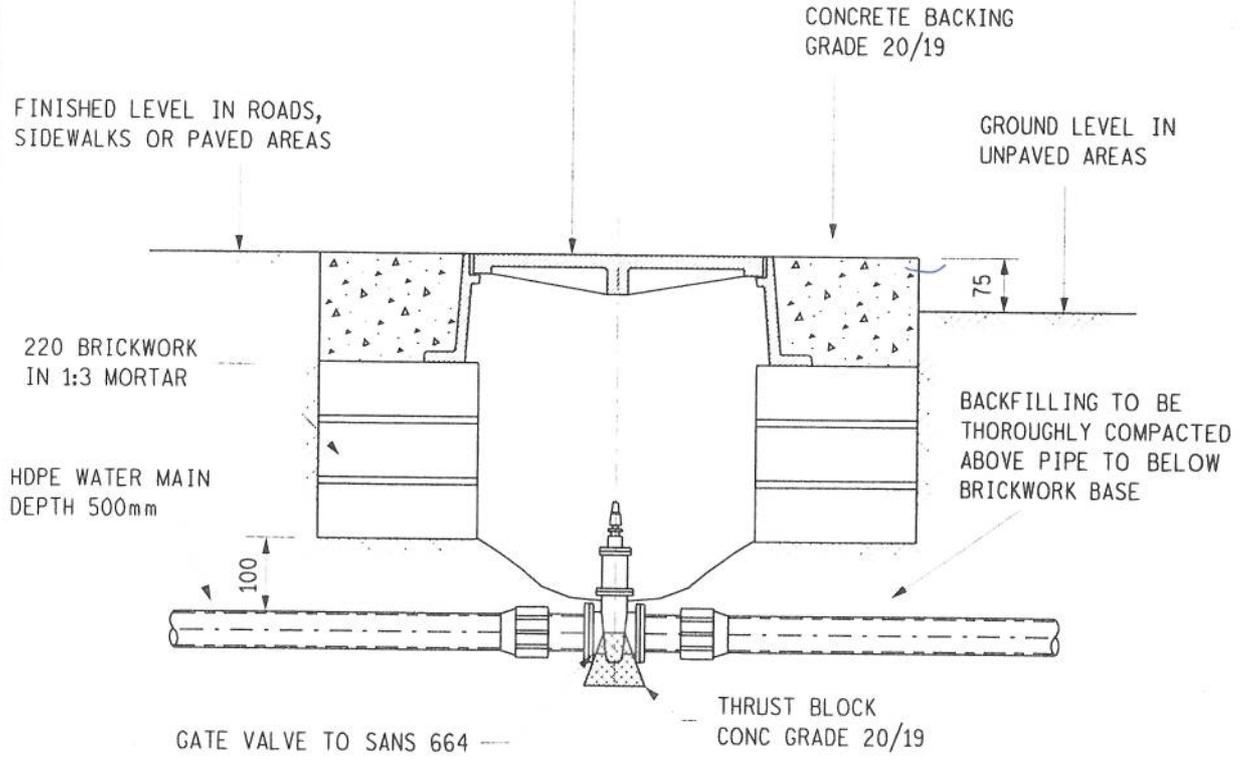

ISOLATING VALVE
WATER RETICULATION

	DRAWN: DJ.C.S. CHECKED: DB.N. DATE: 9/11/04	REL: 0 DATE: 04/01/04
	H V YARD CIVIL WORK STANDARD DETAILS	
	0.54/390 SHEET 79a	