


**TYPICAL SECTION**

## NOTES

1. ALL EARTHING IN ACCORDANCE WITH 0.54/393 SERIES
2. EARTHING MUST BE DONE ON EACH SIDE OF THE BUILDING AT OPPOSITE CORNERS.

50 x 3mm FLAT COPPER STRAP FROM MAIN EARTHMAT TO BE FASTENED TO HOLDING DOWN BOLT OF COLUMN WITH THE H.D BOLT NUT.

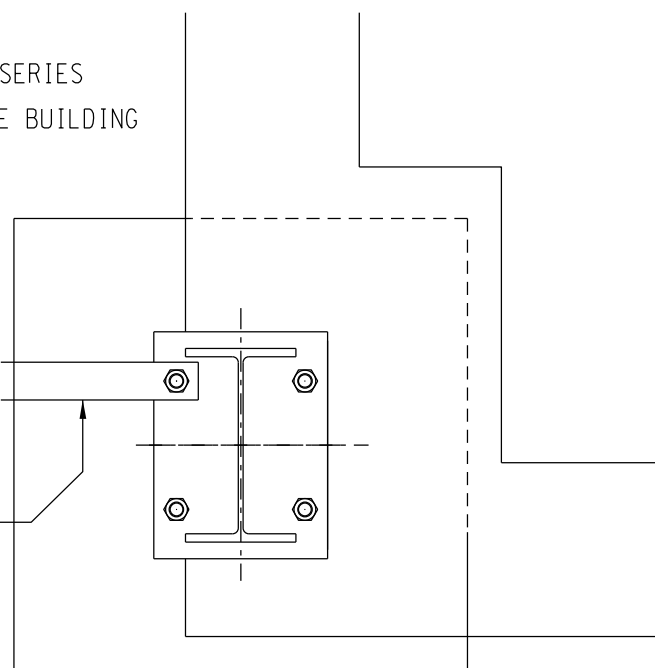

**PLAN**

EARTHING TO CLADDED STORE BUILDING COLUMN

	DRAWN GETEKEN	DBN	JAN 2020	CHKD NAGES	 23/7/20	AUTH MAS	 23-7-20	REV	0	DATE DATUM	
	H V YARD CIVIL WORK STANDARD DETAILS								0.54/393		
									SHEET T18		