


TYPICAL LAYOUT OF SUBSTATION SHOWING REQUIRED EARTHING CONNECTIONS

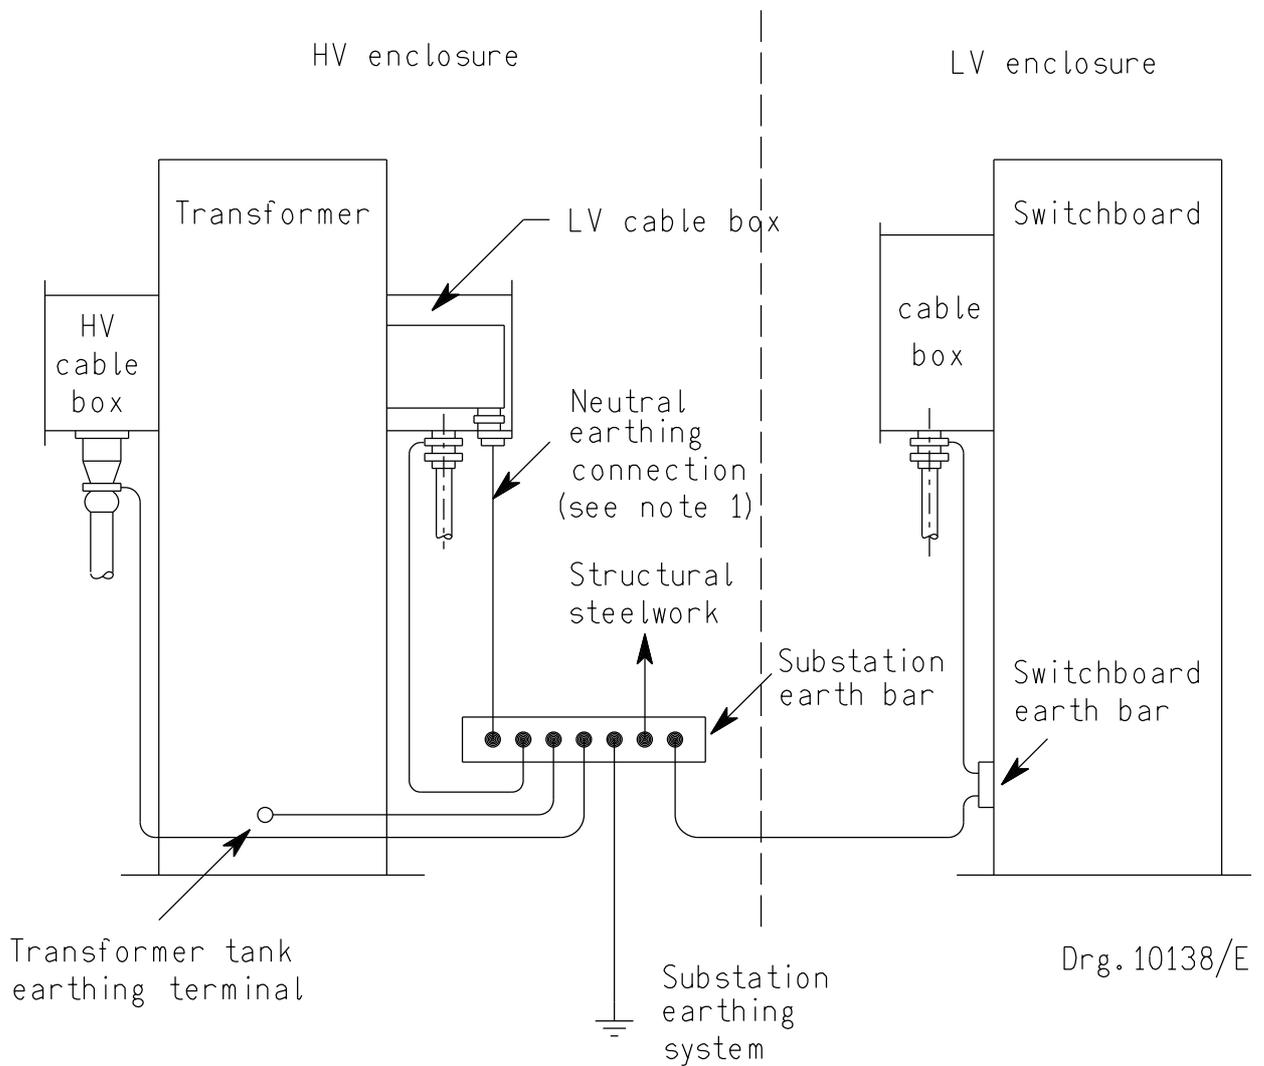

NOTES :

GENERAL: make earth connections to structures and equipment at points specifically provided for this purpose. Do not make earth connections to bolts or clamps designed for mechanical support because these may be removed temporarily or permanently (e.g. during maintenance work or alterations to the structure).

NOTE 1: Normal Eskom practice is to earth the neutral at the incomer in the switchboard.

THE C.A.D. REFERENCE NUMBER IS:
[100,164]00393EC27.R00



DRAWN GETEKEN	H.G.	04/04 89	CHKD NAGES		AUTH MAS	DvB AUG 89	BS AUG 89	REV 0	DATE DATUM
EARTHING STANDARDS								0.54/393	
								SHEET C27	

DRG. TEK
REGISTR