



CVT (GALVANISED & PAINTED TANKS) MOUNTED ON EARTHED STEELWORK WITHOUT CARRIER COUPLING EQUIPMENT (LME)

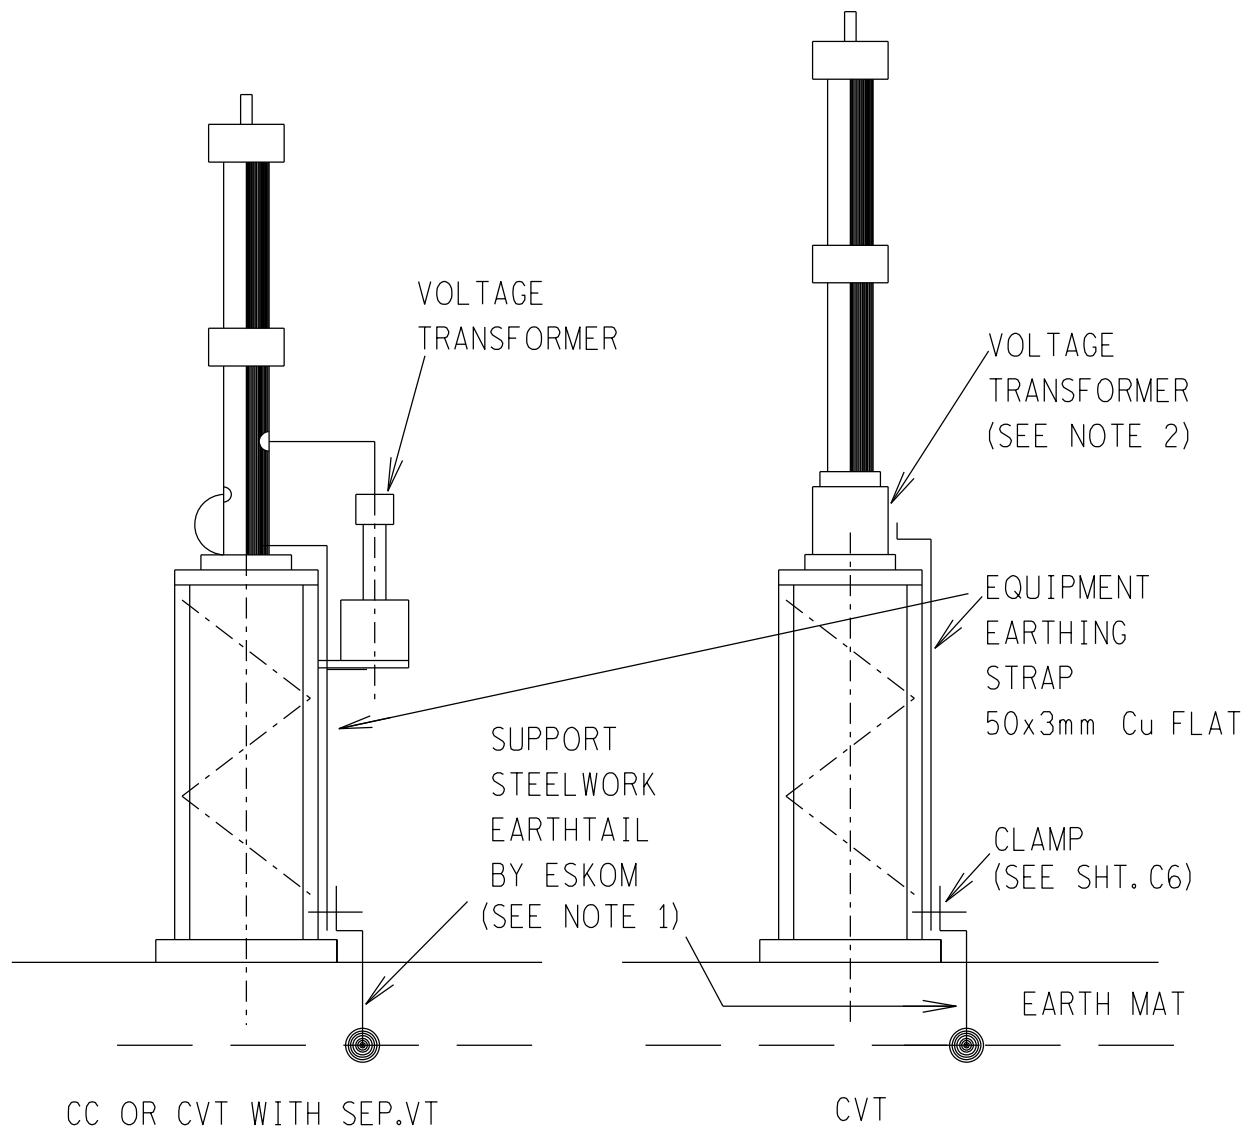

NOTE:

1. SUPPORT STEEL EARTHING. NUMBER OF EARTHING CONNECTIONS TO EARTH MAT AS PER CABLING AND EARTHING SPECIFICATION FOR STATION.
2. LOW VOLTAGE (LME) TERMINAL TO BE EARTHED IN VOLTAGE TRANSFORMER CONNECTION BOX

THE C.A.D. REFERENCE NUMBER IS:
[100,164]00393ET06.R01



ESKOM

DRAWN
GETEKEN

CHKD
NAGES

AUTH
MAS

LER
FEB 88

REV

1

DATE
DATUM

17.3.
1989

EARTHING STANDARDS

0.54/393

SHEET T6

DRG.TEK
REGISTR

393T06.DGN