



EARTHING OF SURGE ARRESTER  
MOUNTED ON INSULATED BASE  
WITH PROVISION FOR CONDITION  
MONITORING DEVICE.


(SEE ALSO SHT T14 & 14A)

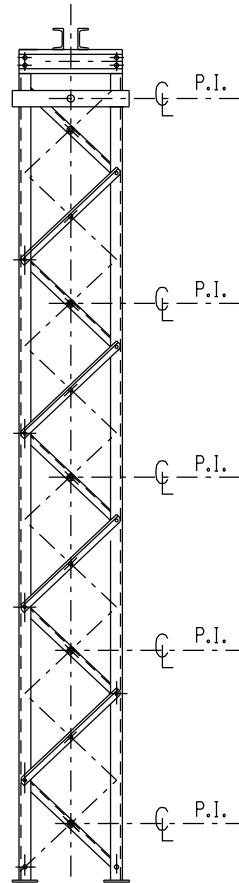


0.54/1596  
5000 HIGH  
MED. SUPPORT  
(5 INSULATORS)

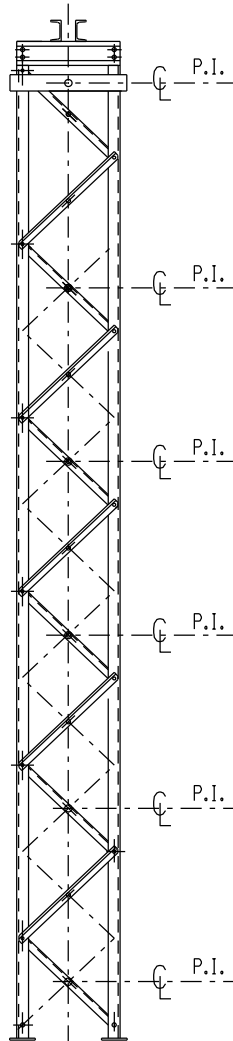


0.54/4160  
6000 HIGH SUPPORT  
(SA MTD ON FIRE  
BARRIER SUPPORT)  
(6 INSULATORS)

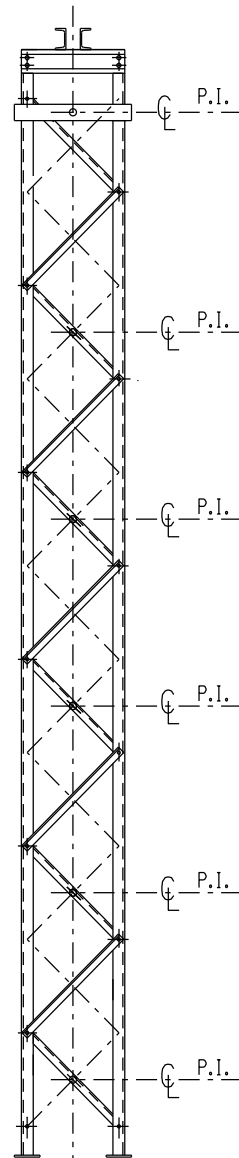

0.54/4586  
6500 HIGH SUPPORT  
(6 INSULATORS)

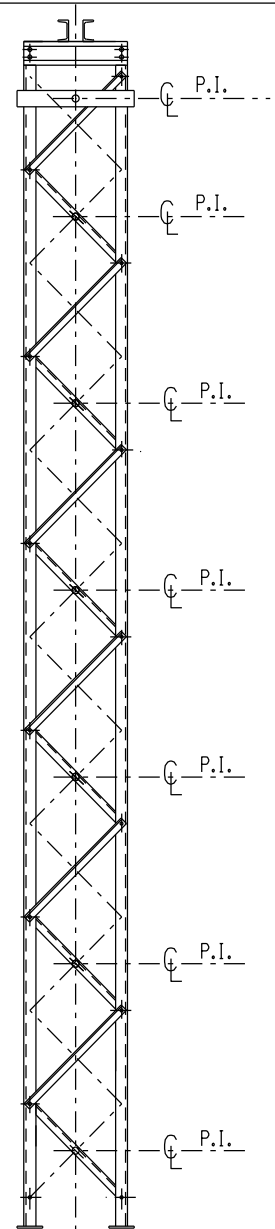

0.54/4318  
7000 HIGH SUPPORT  
(7 INSULATORS)

0		E.G.	P.C.B.	I.HILL	25/05/07	
REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	REFERENCE DRAWINGS
APPROVED BY I.HILL					ESKOM HOLDINGS LIMITED REG NO. 2002/015527/06	
DATE 25/05/07						
CHECKED BY P.C.B.		EARTHING STANDARDS  ©				
DATE 25/05/07						
DRAWN BY E.G.						
DATE MARCH 2007		0.54/393			SHEET NUMBER	REVISION
SCALE: N.T.S.					T14B	0