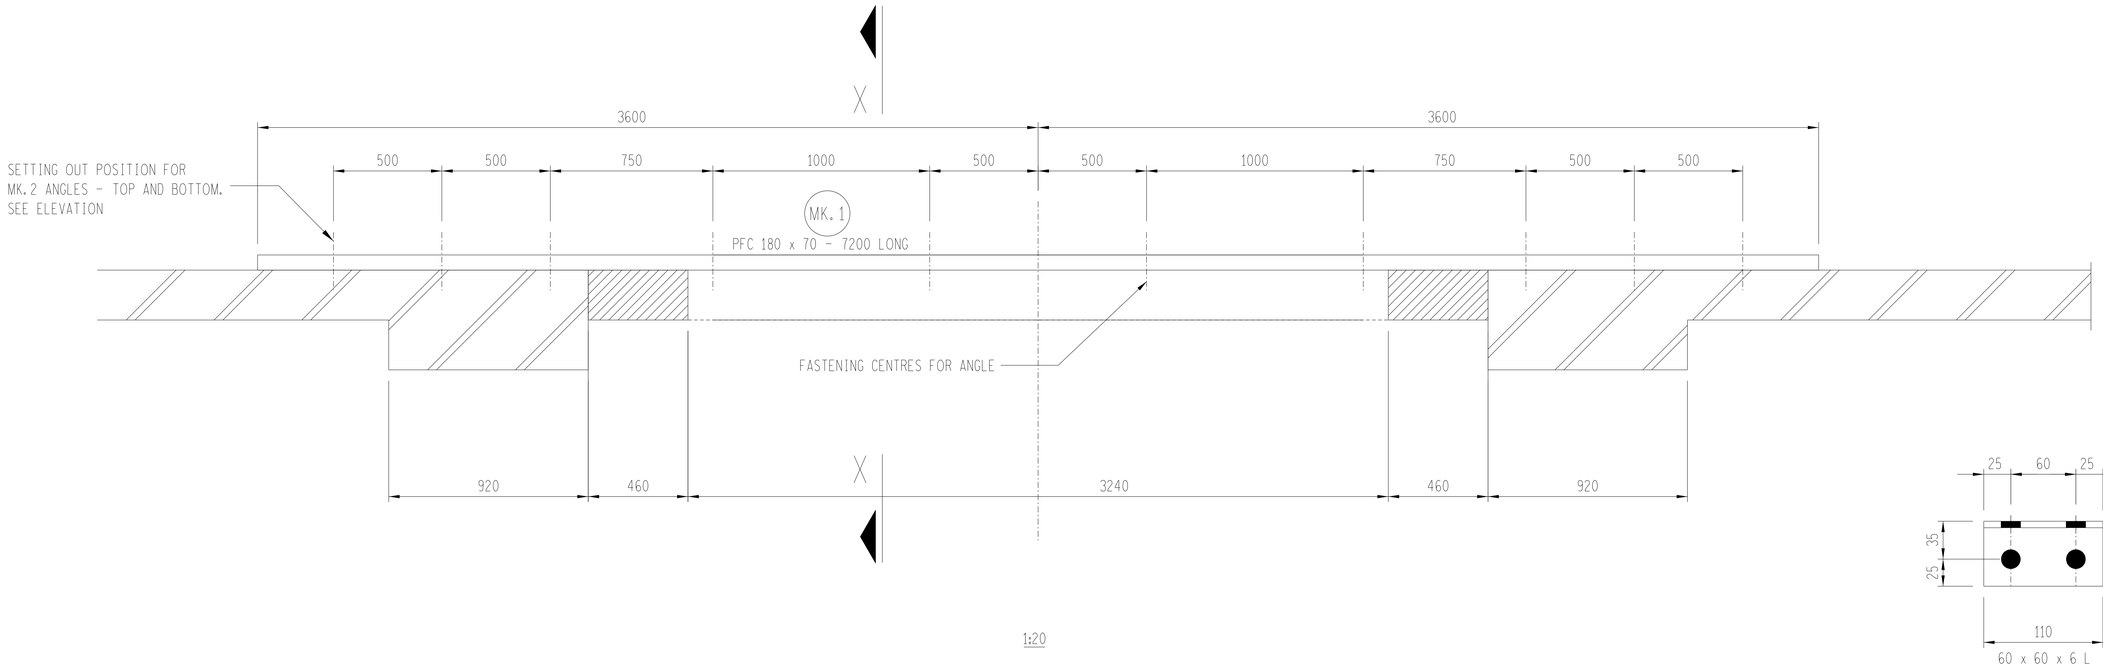

1:20



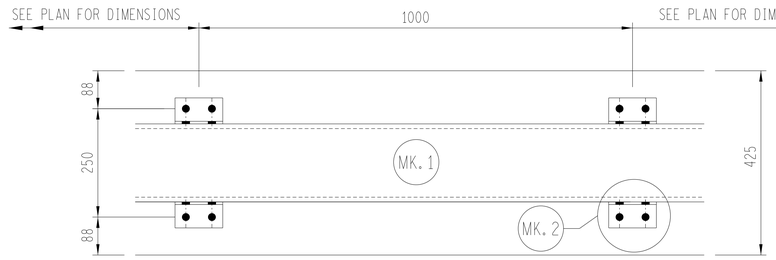

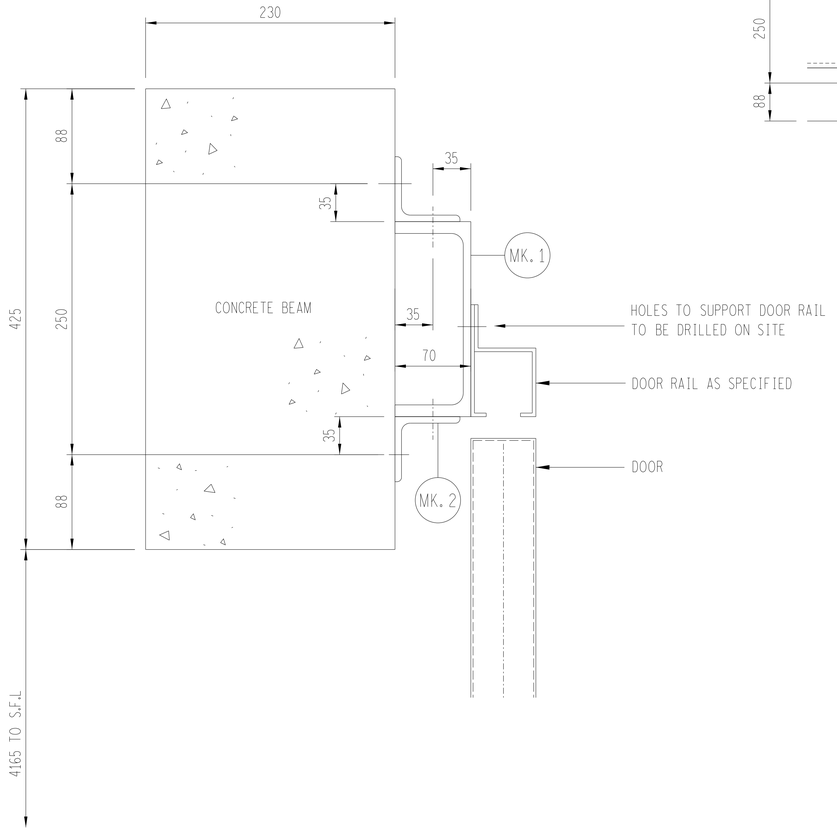

NOTES

1. ALL WORK IN ACCORDANCE WITH SANS 1200 SPECIFICATIONS
2. ALL WELDING AND WELDING SYMBOLS TO CONFORM TO SANS10044.
3. ALL STRUCTURAL USE OF STEEL TO CONFORM TO SANS 10162
4. GRADE OF STEEL TO BE GRADE 300WA TO SANS 1431.
5. ALL WELDS TO BE SEALED WELDED.
6. STEELWORK TO BE HOT DIPPED GALVANISED TO SANS 121.
7. ALL STEELWORK TO BE FABRICATED, ERECTED AND LEVELLED TO A TOLERANCE OF + OR - 1,5mm.

FINAL DESIGN
FOR CONSTRUCTION

REV	REVISION DESCRIPTION	DRAWN	CHKD	AUTH	DATE	REFERENCE DRAWINGS

APPROVED BY: A. MANELI DATE: 19-3-2021	Eskom	Eskom Holdings SOC Ltd Reg No 2002/015527/30
CHECKED BY: A. KAKA DATE: 29-1-2021	TRANSMISSION SUBSTATIONS MAINTENANCE AND STORAGE BUILDING DOOR D1 SUPPORT STEEL BEAM DETAILS AND SPECIFICATIONS	
DRAWN BY: DB NAUDE DATE: 17-8-2020 SCALE: AS SHOWN	© 0.54/8828	SHEET NUMBER: 8 REVISION: 0

SIZE GROOTTE A2L