


INSTALL AGAINST THE WALL AS SHOWN A BRASS COBRA HOSE BIBTAP 108-15 WITH 3/4" HOSE UNION + WINGNUT + LINING FOR 1/2" HOSE. SUPPLY PIPE AGAINST WALL TO BE 3/4" GALVANISED PIPE

STORAGE YARD LOCAL DATUM T.L = 0,000

PAVING AREA 620 sq.m

Ø10mm COPPER EARTH ROD TO WORKSHOP CUTTER AS SPECIFIED ON WORKSHOP BUILDING PLAN. FOR CONNECTIONS SEE DRG. 0.54/393 SHT. T19

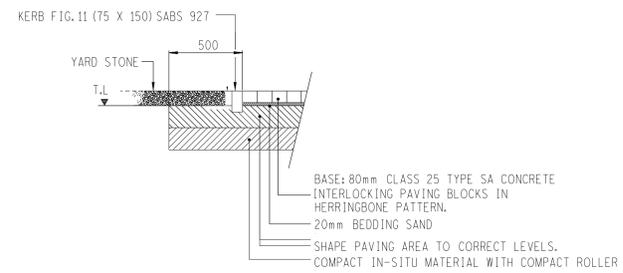

PAVING DETAILS
1:10

**DETAILED DESIGN
NOT FOR CONSTRUCTION**

REV	REVISION DESCRIPTION	DRAWN	CHKD	AUTH	DATE	REFERENCE DRAWINGS
APPROVED BY	Eskom		Eskom Holdings SOC Ltd Reg No 2002/015527/30			
DATE	ESKOM EPC SUBSTATION STORAGE YARD CONCEPT GENERAL ARRANGEMENT AND SETTING OUT					
CHECKED BY	D. NAUDE ©					
DATE	22-2-2023					
DRAWN BY	D. NAUDE ©					
DATE	22-2-2023					
SCALE	AS SHOWN		0.54/8828		SHEET NUMBER	REVISION
					13	0