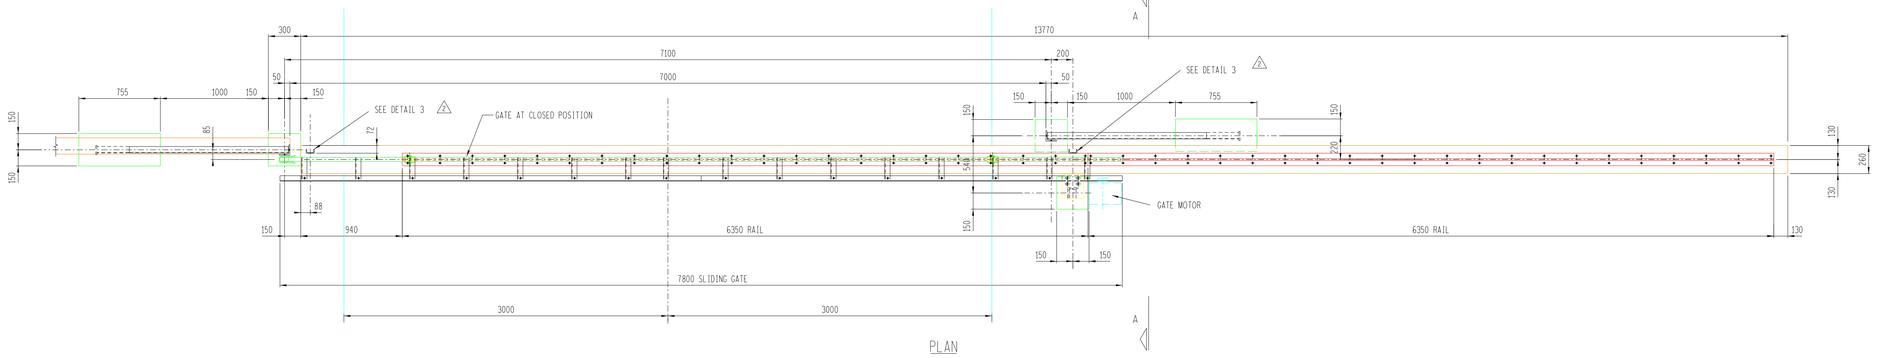

PLAN

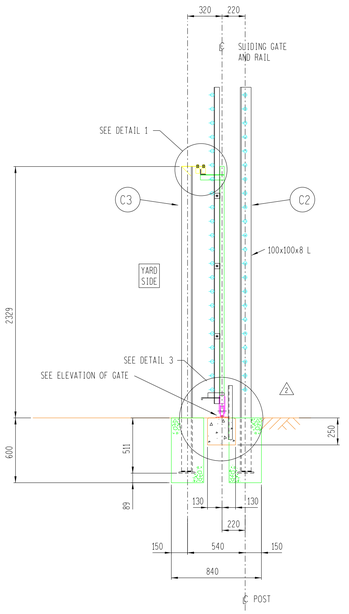

SECTION A-A

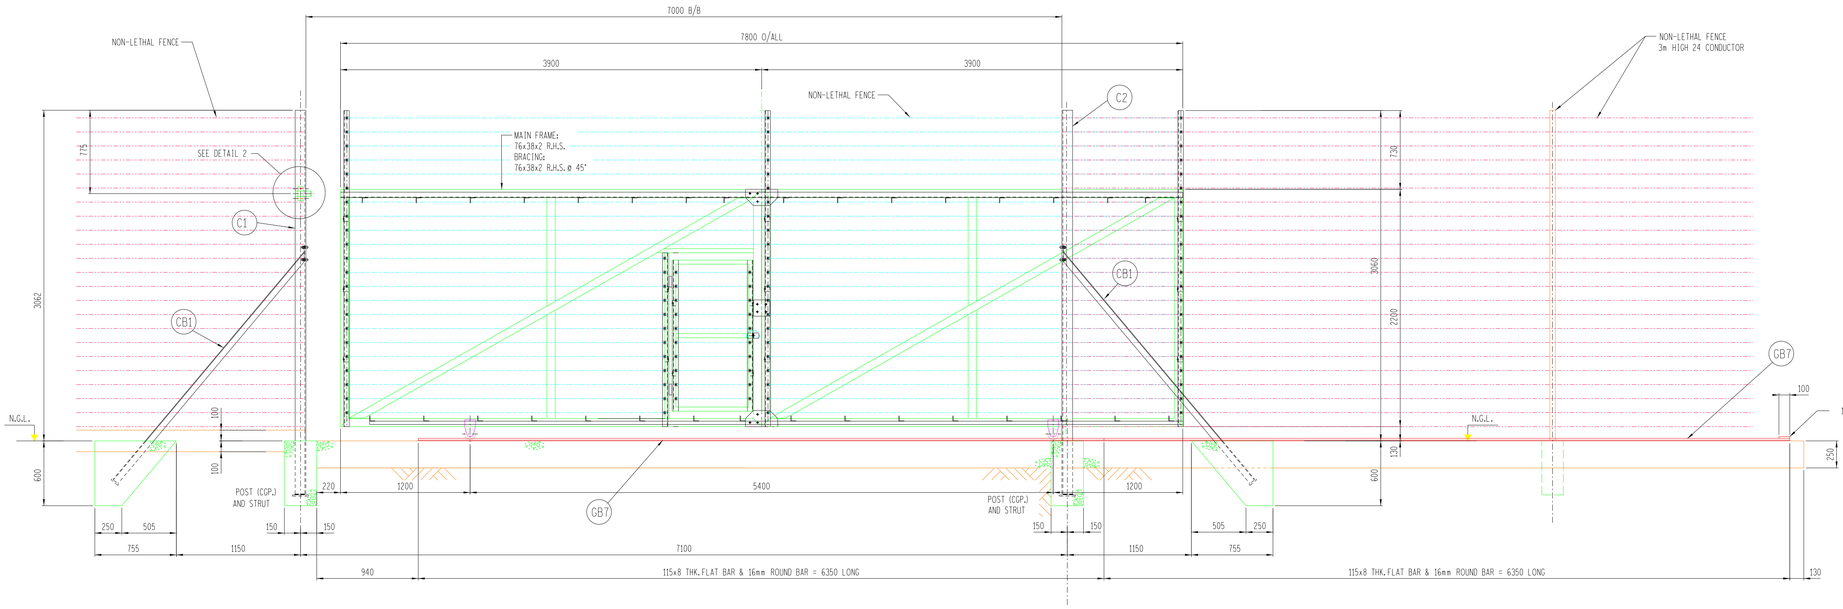

ELEVATION - 7,8m SLIDING GATE

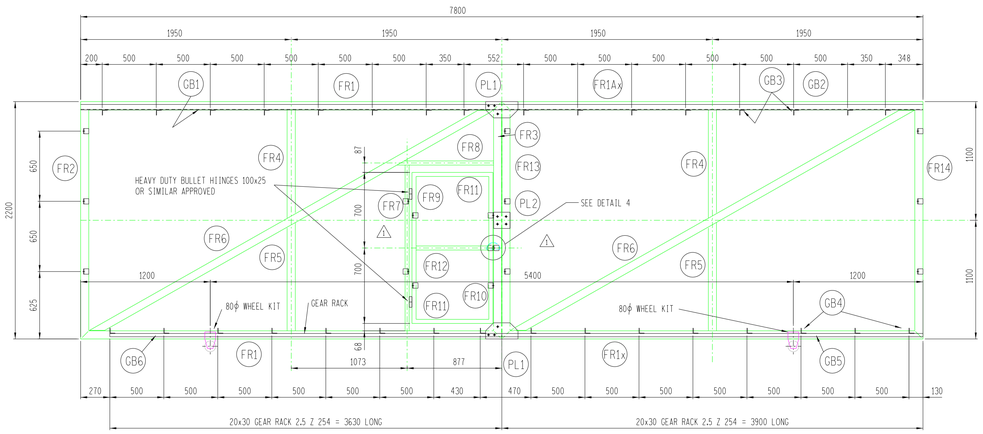

ELEVATION ON SLIDING GATE DETAIL

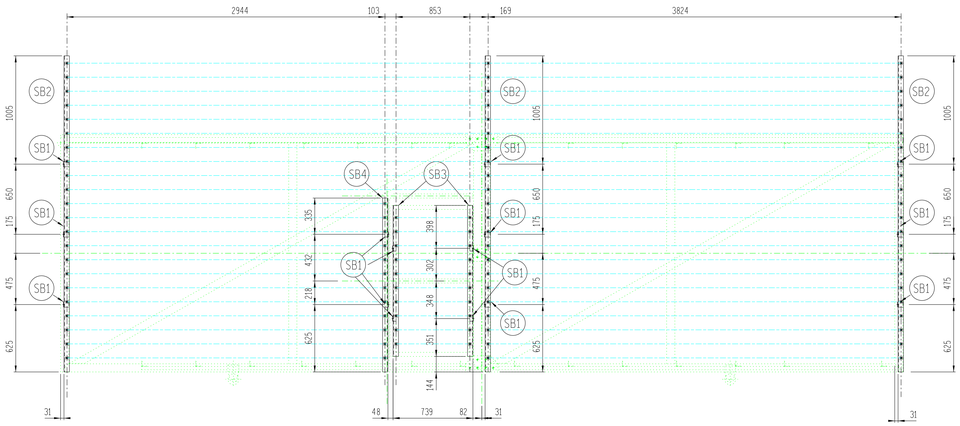

ELEVATION ON SLIDING GATE FOR ELECTIRIED FENCE POSTS

NOTES

1. ALL POSTS AND STRUTS TO BE SET IN CONCRETE GRADE 25/19.
   12mm CONSTRUCTION JOINTS TO BE FORMED EQUALLY SPACED AT 4500mm CTRS.MIN.
2. INTERMEDIATE POSTS TO BE ERECTED EQUALLY SPACED AT 4500mm CTRS.MIN.
3. WHEREVER DISTANCES BETWEEN CORNER POSTS EXCEED 90m DOUBLE STRUTTED STRAIN POSTS SHALL BE ERECTED EQUALLY SPACED AT NOT MORE THAN 60m CTRS.
4. ALL POSTS, STRUTS, ANGLES, BOLTS, NUTS, STRAIN BOLTS, HOOKS, ETC AND ALL GATES AND PANELS ARE TO BE HOT DIP GALVANISED AFTER FABRICATION IN ACCORDANCE WITH SABS ISO 1461
5. REPAIRS TO DAMAGED GALVANISING AND UNTREATED STEELWORK TO BE IN ACCORDANCE WITH SABS ISO 1460.

REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	REFERENCE DRAWINGS
2	CHANNEL ADDED	PHD	DJC.S	DJC.S	06/03/12	
1	GENERAL REVISION	PHD	DBN	DBN	21/12/11	GEN.ARRANGEMENT

APPROVED BY	DJC. SENEKAL
DATE	06/09/2011
CHECKED BY	DJC.S
DATE	06/09/2011
DRAWN BY	PAUL DOYLE
DATE	18/07/2011
SCALE	

Eskom Transmission

ESKOM HOLDINGS LIMITED
REG NO.
2002/015527/06

SECURITY FENCE

7,8m NON-LETHAL SLIDING GATE - MIDDLE STEELWORK ARRANGEMENTS

©

	SHEET NUMBER	REVISION
0.54/7470	5	2

SIZE GROOTTE A0L