

A

B

C

D

E

F

A


B

C

D

E


F

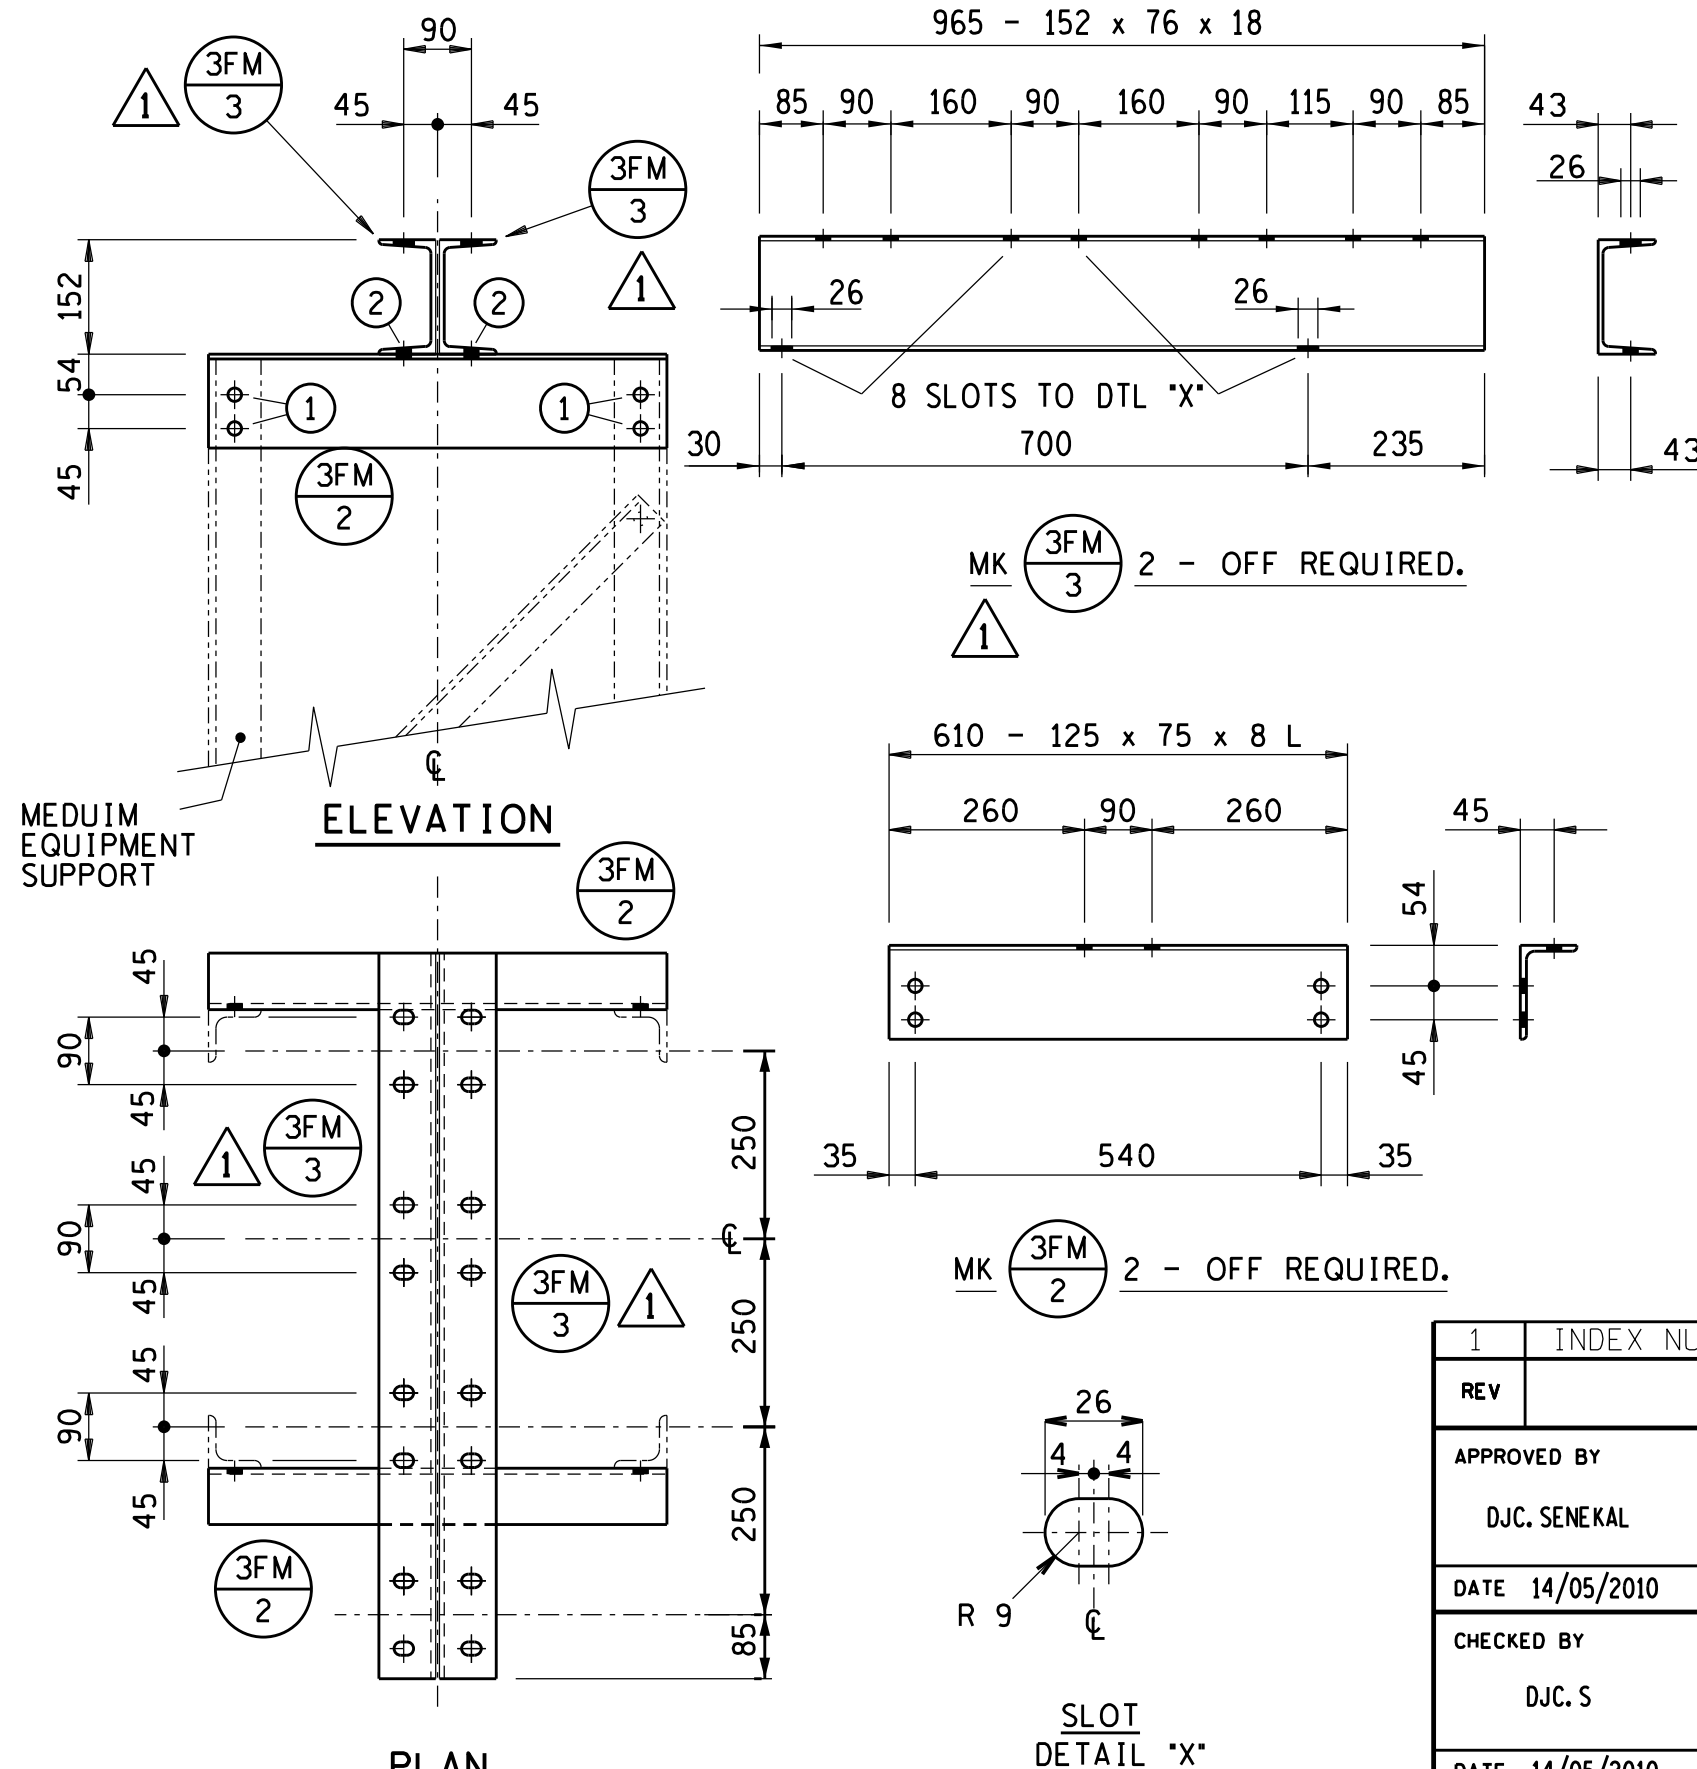

MK $\frac{3FM}{3}$ 2 - OFF REQUIRED.

MK $\frac{3FM}{2}$ 2 - OFF REQUIRED.

305	MED. SUPP. 4000 HIGH
304	MED. SUPP. 3500 HIGH
303	MED. SUPP. 3000 HIGH
302	MED. SUPP. 2500 HIGH
301	MED. SUPP. 2000 HIGH

1	INDEX NUMBER CHANGED	PHD	PHD	PHD	5/8/10	301	MED. SUPP. 2000 HIGH
REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	REFERENCE DRAWINGS	
APPROVED BY DJC. SENEKAL					ESKOM HOLDINGS LIMITED REG NO. 2002/015527/06		
DATE 14/05/2010							
CHECKED BY DJC. S		66kV TO 132kV POST INSULATOR CAP MODIFIED FOR EXTRA SUPPORT (MEDIUM EQUIPMENT SUPPORT) ©					
DATE 14/05/2010							
DRAWN BY PAUL DOYLE							
DATE 13/05/2010							
SCALE 1:10		0.54/3512				SHEET NUMBER 2	REVISION 1