

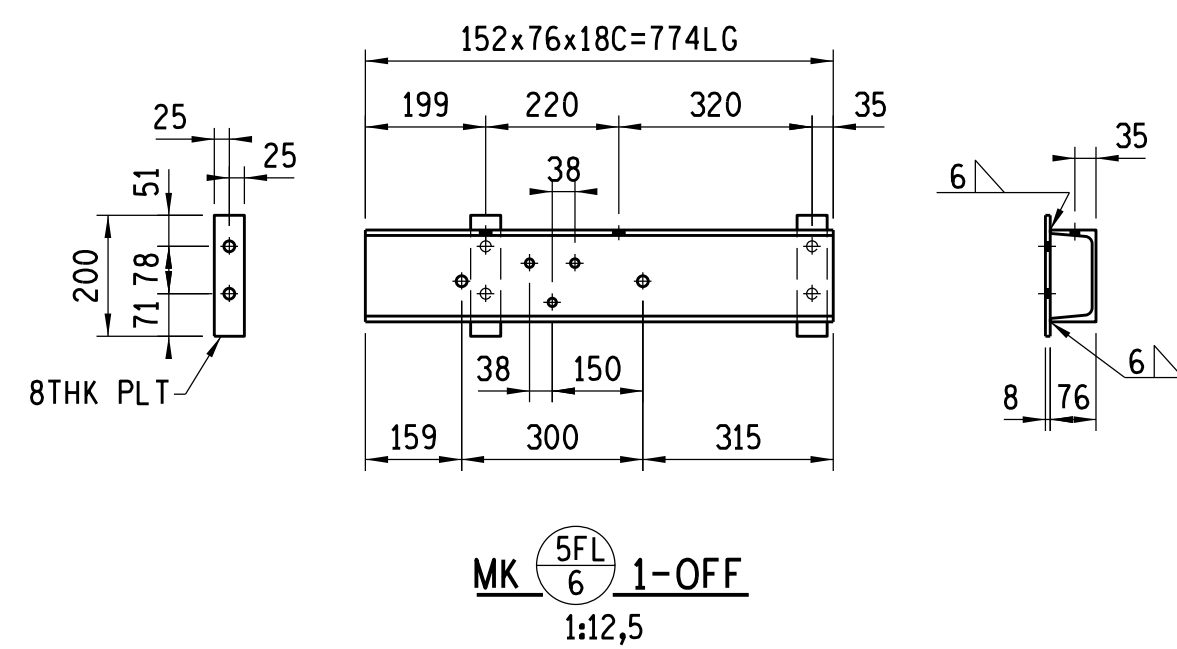
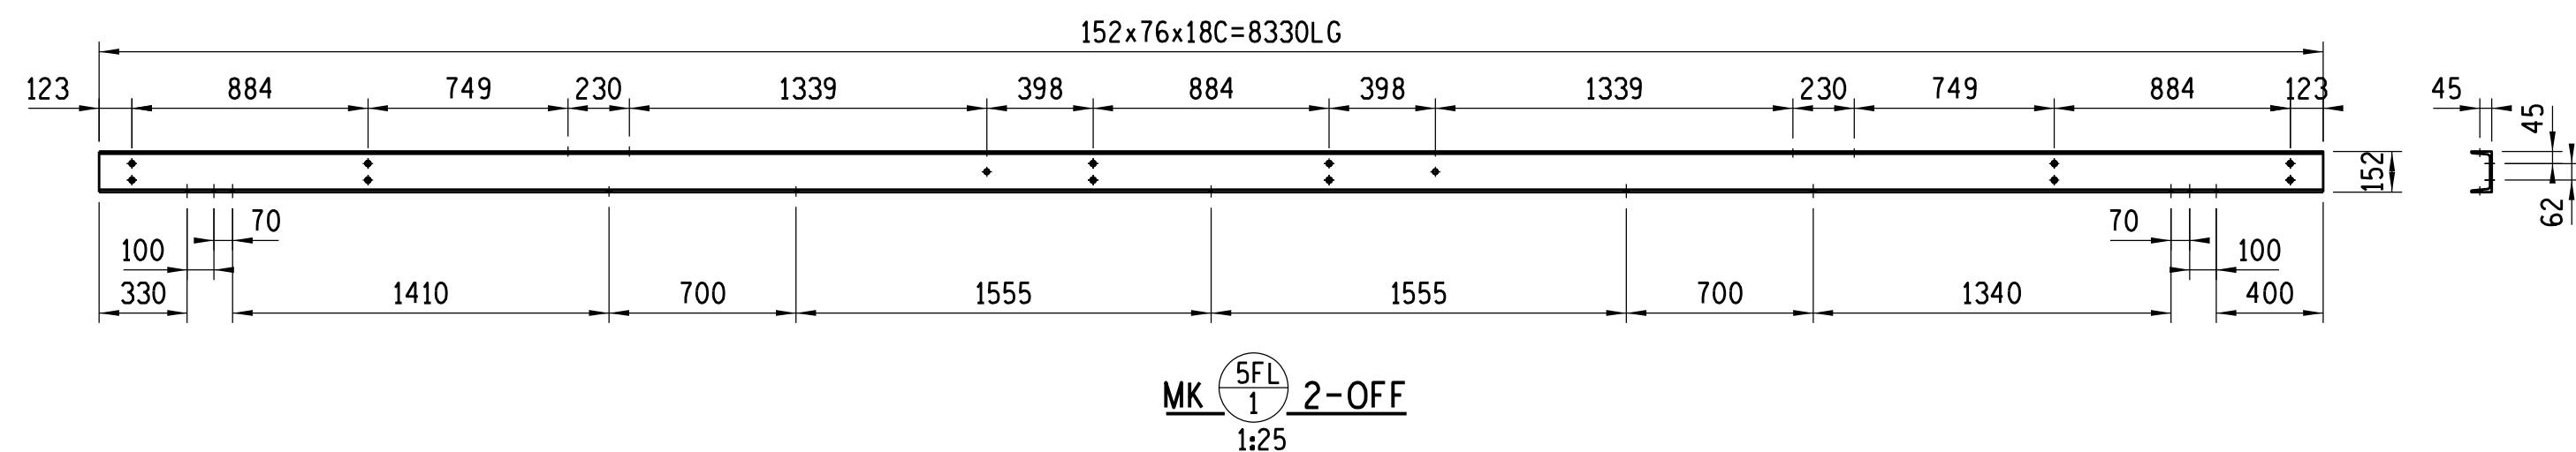
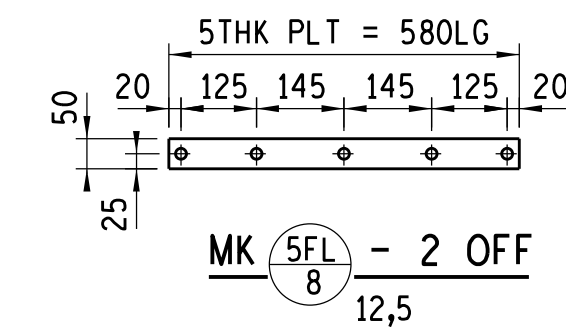
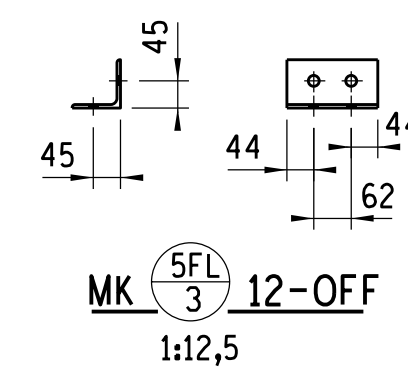


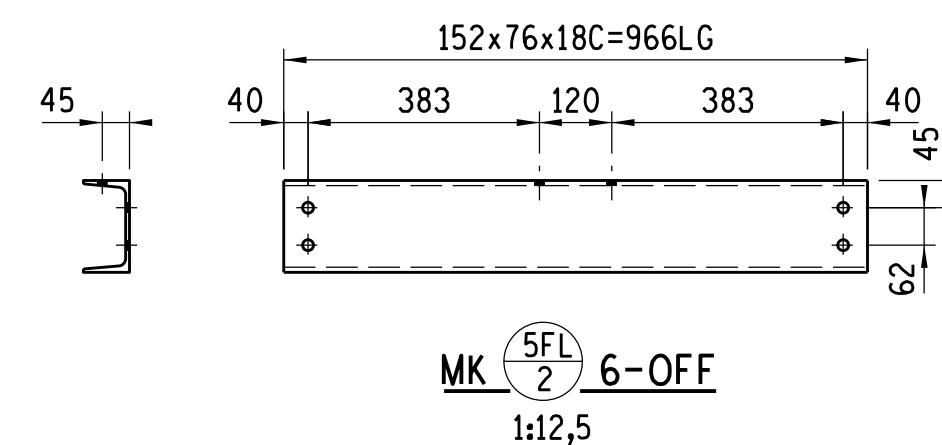


SIDE ELEVATION
1:25

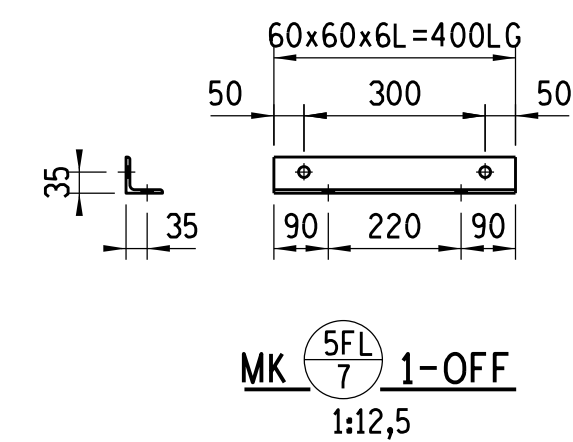

- | | | | | | | | | | | | |
|---|-------------|--|--|---|----------------------|-------|------|---|------|---------------------|---|
| 0 | FIRST ISSUE | | | REV | REVISION DESCRIPTION | DRAWN | CHKD | AUTH | DATE | . | . |
| REV | | | | | | | | | | REFERENCE: DRAWINGS | |
| APPROVED BY | | | |  Eskom | | | | Eskom Holdings SOC Ltd
Reg No 2002/015527/30 | | | |
| 
DATE 01-06-2021 | | | | | | | | | | | |
| CHECKED BY | | | | 132kV INLINE ISOLATOR CAP
3.6m PHASE SPACING | | | | | | | |
| 
DATE 01/06/2021
DRAWN BY
A.TIFLOEN | | | | | | | | | | | |
| DATE 9/12/2020 | | | | 0.54/10106 | | | | SHEET NUMBER | | REVISION | |
| SCALE 1:25 | | | | | | | | 0 | | 0 | |

BOLT SCHEDULE (STRENGTH GRADE 8.8)				
MK	DIA	LENGTH	No OFF	WASHER/BOLT
1	M 16	40	36	1 FLAT

NOTES ON BOLTS:
 1- BOLTS TO BE SUPPLIED WITH ONE NUT AND WASHER.
 2- BOLTS ERECTED WITH HEAD TO INSIDE PREFERRED.
 3- WASHER TO BE PLACED UNDER NUT.
 4- ALL BOLTS TO BE GALVANIZED.

	MASS IN kg		
STRUCTURE	BOLTS	TOTAL	
525.35	11.46	536.81	